Maximum Permissible Head Difference (MPHD) (ft)	Headwater stage range (ft)
11	<= 64.0
10	> 64.0
	Should never exceed 67.0 ft

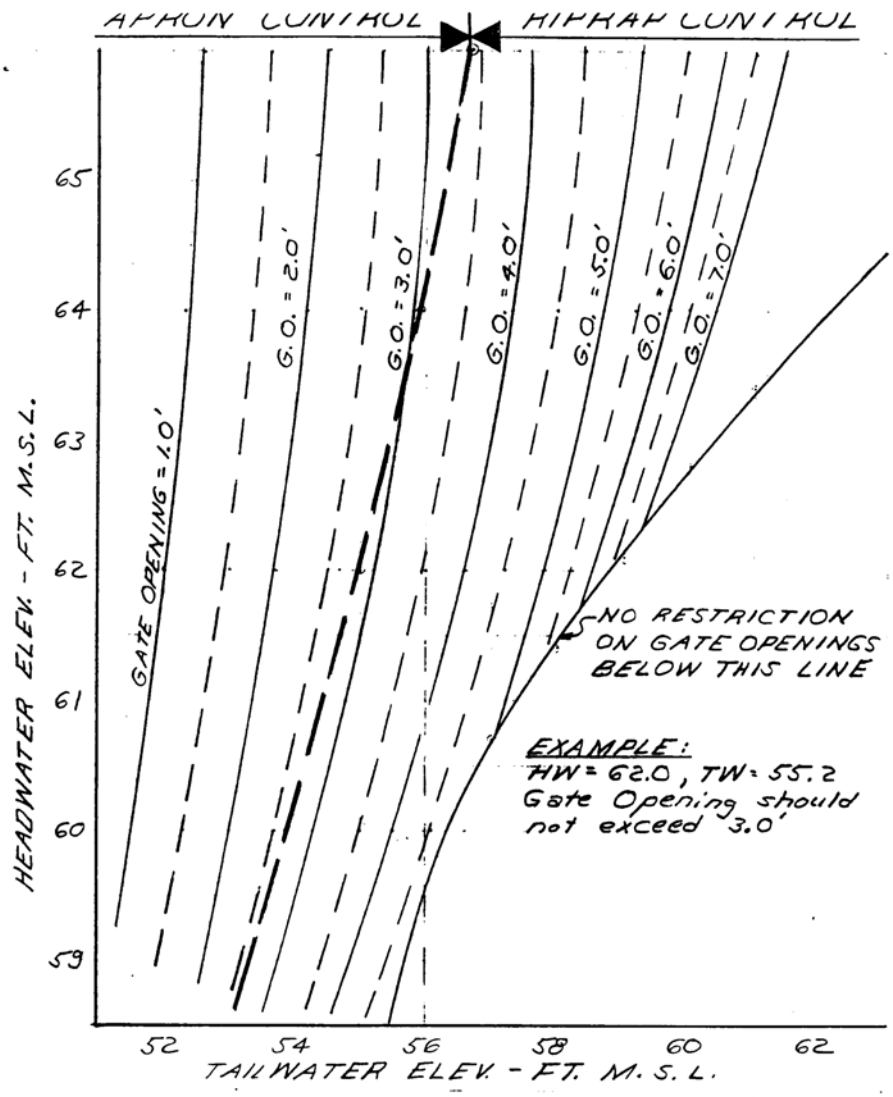

CENTRAL AND SOUTHERN FLORIDA PROJECT
MASTER WATER CONTROL MANUAL
KISSIMMEE RIVER–LAKE ISTOKPOGA BASIN

STRUCTURE 63
MAXIMUM ALLOWABLE GATE OPENING CURVE

JACKSONVILLE DISTRICT
U.S. ARMY CORPS OF ENGINEERS
AUGUST 1994

A-S63-7 10-13-69 SAJWH