

APT ANALYSIS

796500
959600

SITE: Tequesta Wellfield #5
Section 24 Township 40 S Range 42 E

REPORT: Evaluation of the Potential for Raw Water Supply Development for Village

GEOLOGIC DATA: pg. _____, Appendix A

WELL NUMBER OF WELL DESCRIBED: D2-5

Entered into Wilma as D1-5, since there is no construction into on D2-5
-CBerea 9/12/00

DEPTH (LSD)	LITHOLOGY
0-15	sand, yellow, med. to fine, unconsol.
15-33	Sand, white & brown, med to fine, unconsol
33-70	limestone, bio sparite, tan & white, sand coarse to fine, trace shell
70-79	sand, white & brown, med to silt, abundant shell fragm.
79-100	limestone, biointrasparite, w/sand layers, med to silt, abund. shell frags.
100-110	limestone, dk brown to gray & white, w/shell & fragm., abund sand med to silt size
110-115	limestone, tan, soft, poorly consol., abund, fine sand
115-138	limestone, biointrasparite, brown to tan, trace sand & shell frags.
138-145	limestone, biointrasparite, dk gray to tan, trace sand, tan silty clay
145-170	limestone, biointrasparite, tan to gray 50%, sand 20%, coarse to silt size, 30% shell
170-180	limestone 50%, tan, lithified, shell 50% whole & fragm., abundant sand

Producing zone interval: 33-170 (lsd) _____ (msl)

Aquifer name: _____

Static Water Level at the site is approximately _____ ft. msl.

WELL DESCRIPTIONS:

Well	Diam. (in)	Total Depth	Cased Depth	Scr/Open Slot Intervl	Slot Size	Radius
18	6	60	38	38-60		0
S1-5	2	63	23	23-63		51.5
S2-5	2	62	22	22-62		99.8
S3-5	2	60	20	20-60		194.7
D1-5	2	120	80	80-120		23.8

INFLUENCING FACTORS:

APT: pg. 30

Started: 5/20/80

Duration: 36 hours

Discharge: 218 gpm

Recovery: _____

Comments:

1) _____

2) _____

3) _____

CONSULTANT'S ANALYSIS: pg. Table 6.2

Method: Boulton

Results:

Well	Transmissivity (GPD/FT)	S or Sy	Leakance ()
<u>S1-5</u>	<u>227,116</u>	<u>9.8×10^{-3}</u>	_____
<u>S2-5</u>	<u>185,058</u>	<u>-</u>	_____
<u>S3-5</u>	<u>297,414</u>	<u>-</u>	_____

Comments: partially penetrating

Method: _____

Results:

Well	Transmissivity (GPD/FT)	S or Sy	Leakance ()
_____	_____	_____	_____
_____	_____	_____	_____
_____	_____	_____	_____

Comments: _____

Method: _____

Results:

Well	Transmissivity (GPD/FT)	S or Sy	Leakance ()
_____	_____	_____	_____
_____	_____	_____	_____
_____	_____	_____	_____

Comments: _____

REANALYSIS:

Method: Neuman

Results:

Well	Transmissivity (GPD/FT)	S or Sy	Leakance ()
<u>D1-5</u>	<u>139,262</u>	<u>3.7×10^{-3}</u>	<u></u>
<u></u>	<u></u>	<u></u>	<u></u>
<u></u>	<u></u>	<u></u>	<u></u>

Comments: match questionable

Method: _____

Results:

Well	Transmissivity (GPD/FT)	S or Sy	Leakance ()
<u></u>	<u></u>	<u></u>	<u></u>
<u></u>	<u></u>	<u></u>	<u></u>
<u></u>	<u></u>	<u></u>	<u></u>

Comments: _____

RECOMMENDED VALUES:

Transmissivity (GPD/FT)	Specific Yield or Storage	Leakance
<u></u>	<u></u>	<u></u>
<u></u>	<u></u>	<u></u>

REFERENCES:

Neuman Analysis

$Q = 460 \text{ gpm}$
 $r = 25'$
 $b = 120'$
 $\beta = .004$

$\checkmark t = 1 \text{ min} \quad t_s = 410 \checkmark$
 $\checkmark s = 1 \text{ ft} \quad s_d = 25 \checkmark$

$$T = \frac{114.6 Q s_d}{s}$$

$$= \frac{(114.6)(460)(25)}{1}$$

$$= 1,317,900 \text{ GPD/FT} \checkmark$$

$$S = \frac{T t}{2693 r^2 t_s}$$

$$= \frac{(1317900)(1)}{(2693)(25^2)(410)}$$

$$= 1.91 \times 10^{-3} \checkmark$$

$$K_h = T/b$$

$$= 1317900/120$$

$$= 10,982 \text{ GPD/FT}^2 \checkmark$$

$$K_d = \beta b^2 / r^2$$

$$= \frac{(.004)(120^2)}{(25^2)}$$

$$= .092 \checkmark$$

$$K_v = K_h K_d$$

$$= (10982)(.092)$$

$$= 1012.1 \text{ GPD/FT}^2 \checkmark$$

Tegueta Wellfield #2 APT Well D1-2

Streetsova Analysis

$t = 375$
 $s = 3.6$

$w = 1$
 $\theta = 10^4$

$Q = 460$
 $r = 25$
 $b = 120$
 $l' = .6$
 $y' = .6$
 $\rho' = .5$

$$T = \frac{wQ}{4\pi l's} \times 1440$$
$$= \frac{(1)(460)}{(4)(\pi)(.6)(3.6)} \times 1440$$
$$= 16.94 \times 1440 = 24,403$$

small r

$$s = \frac{4Tt}{\sigma r^2}$$
$$= \frac{(4)(16.94)(375)}{(10^4)(25^2)}$$
$$= 4.06 \times 10^{-3}$$

$$K_h = 24403/120$$
$$= 203.36$$

$$\rho = \rho' b$$
$$= (.5)(120)$$
$$= 60$$

$$\rho = \sqrt{K_v/K_h} \quad \sigma$$

$$\frac{60}{25} = \sqrt{K_v/K_h}$$

$$K_v/K_h = 5.76$$


$$K_v = (K_h)(K_v/K_h)$$
$$= (203.36)(5.76)$$
$$= 1171.35$$

WMD

TAPENO 6153
USER NO NELMS

PLOT NO 0050
DATE 86/04/24

TIME 16:23

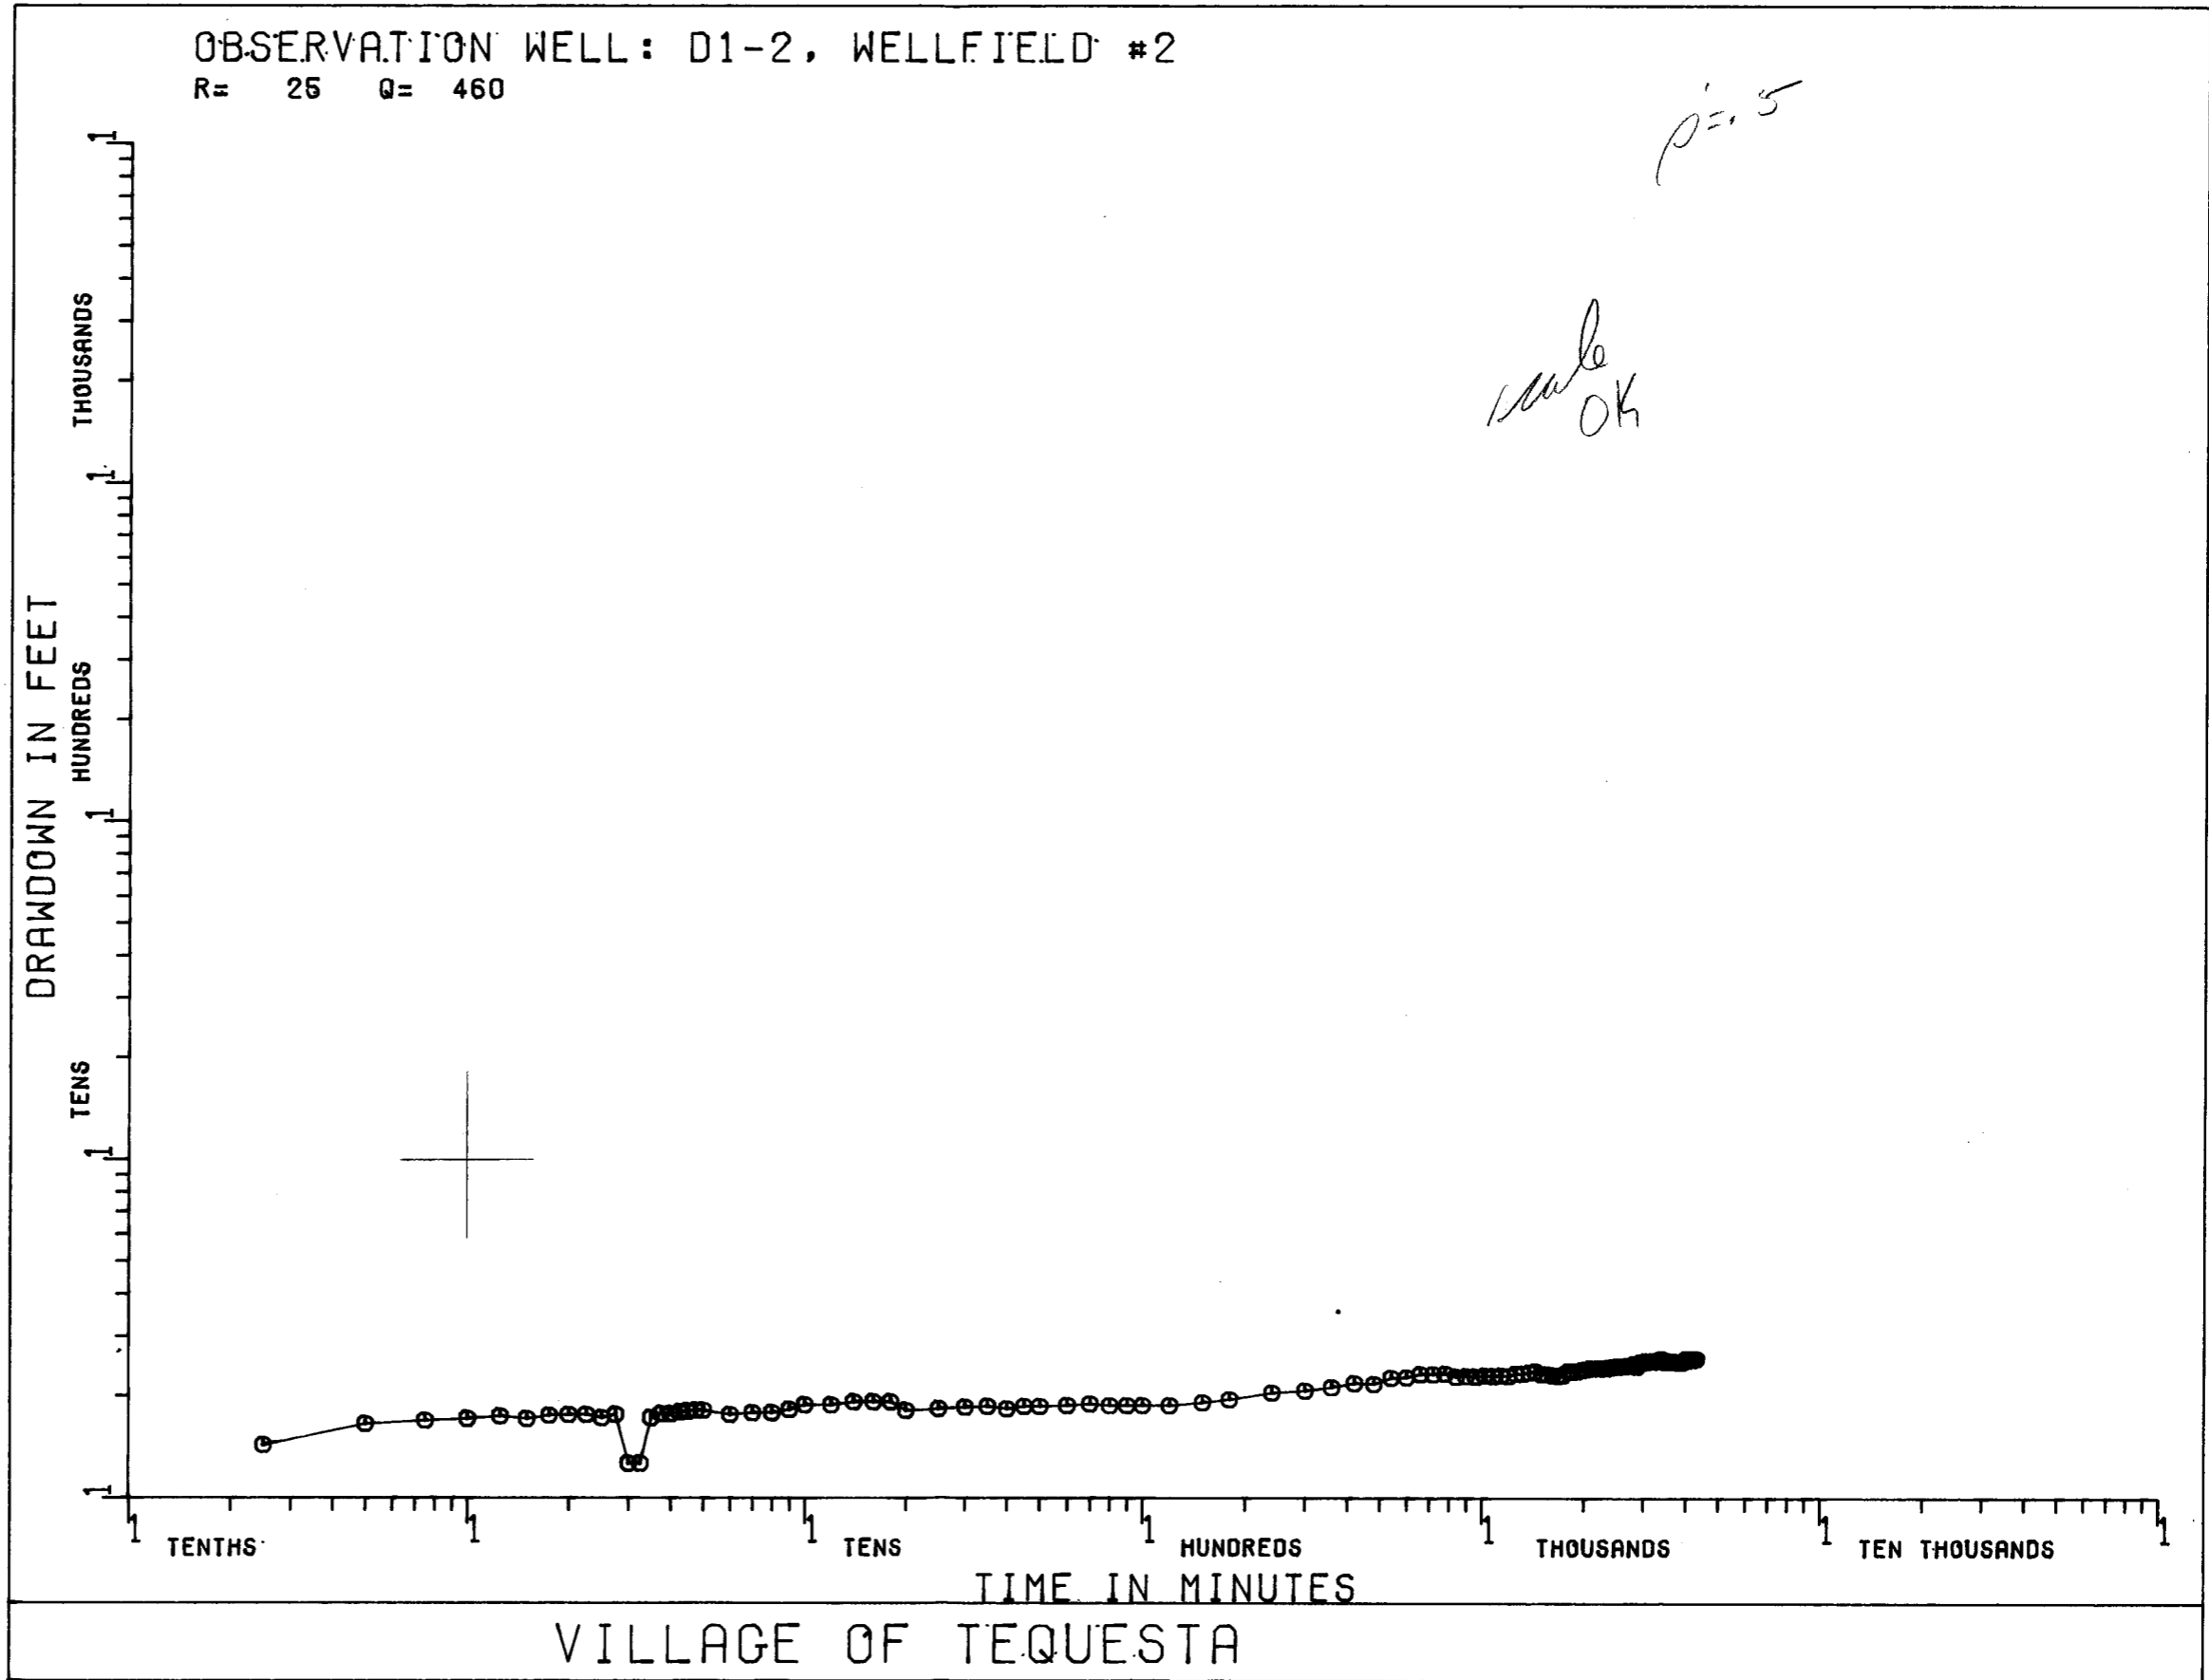

Request APT

Well D1-5

Neuman Analysis

$$z = 1 \quad z_s = 24 \checkmark$$

$$s = 1 \quad s_d = 5.6$$

$$Q = 217 \text{ gpm}$$

$$r = 24 \text{ ft}$$

$$b = 120'$$

$$B = .2$$

$$T = \frac{114.6 Q s_d}{s}$$

$$= \frac{(114.6)(217)(5.6)}{1}$$

$$= 139,262 \text{ gpd/ft}$$

match questionable
??

$$S = \frac{Tt}{2693 r^2 t_s}$$

$$= \frac{(139,262)(1)}{(2693)(24^2)(24)}$$

$$= 3.7 \times 10^{-3}$$

$$S_y = \frac{C_2 Tt}{r^2 t_s}$$

$$= \frac{.1337(139,262)(1)}{(24)^2 (6.024)}$$

$$= \frac{18619}{13824}$$

$$= 1347$$

$$h_h = T/b$$

$$= 139262/120$$

$$= 1161$$

$$k_d = B b^2 / r^2$$

$$= \frac{(1.2)(120^2)}{(24^2)}$$

$$= 5??$$


42,381 50 SHEETS 5 SQUARE
42,382 100 SHEETS 5 SQUARE
42,383 200 SHEETS 5 SQUARE
42,384 300 SHEETS 5 SQUARE
42,385 400 SHEETS 5 SQUARE
42,386 500 SHEETS 5 SQUARE
42,387 600 SHEETS 5 SQUARE
42,388 700 SHEETS 5 SQUARE
42,389 800 SHEETS 5 SQUARE
42,390 900 SHEETS 5 SQUARE
42,391 1000 SHEETS 5 SQUARE



WMD

TAPENO 6265 PLOT NO 0349
USER NO NELMS DATE 86/05/05

TIME 12:52

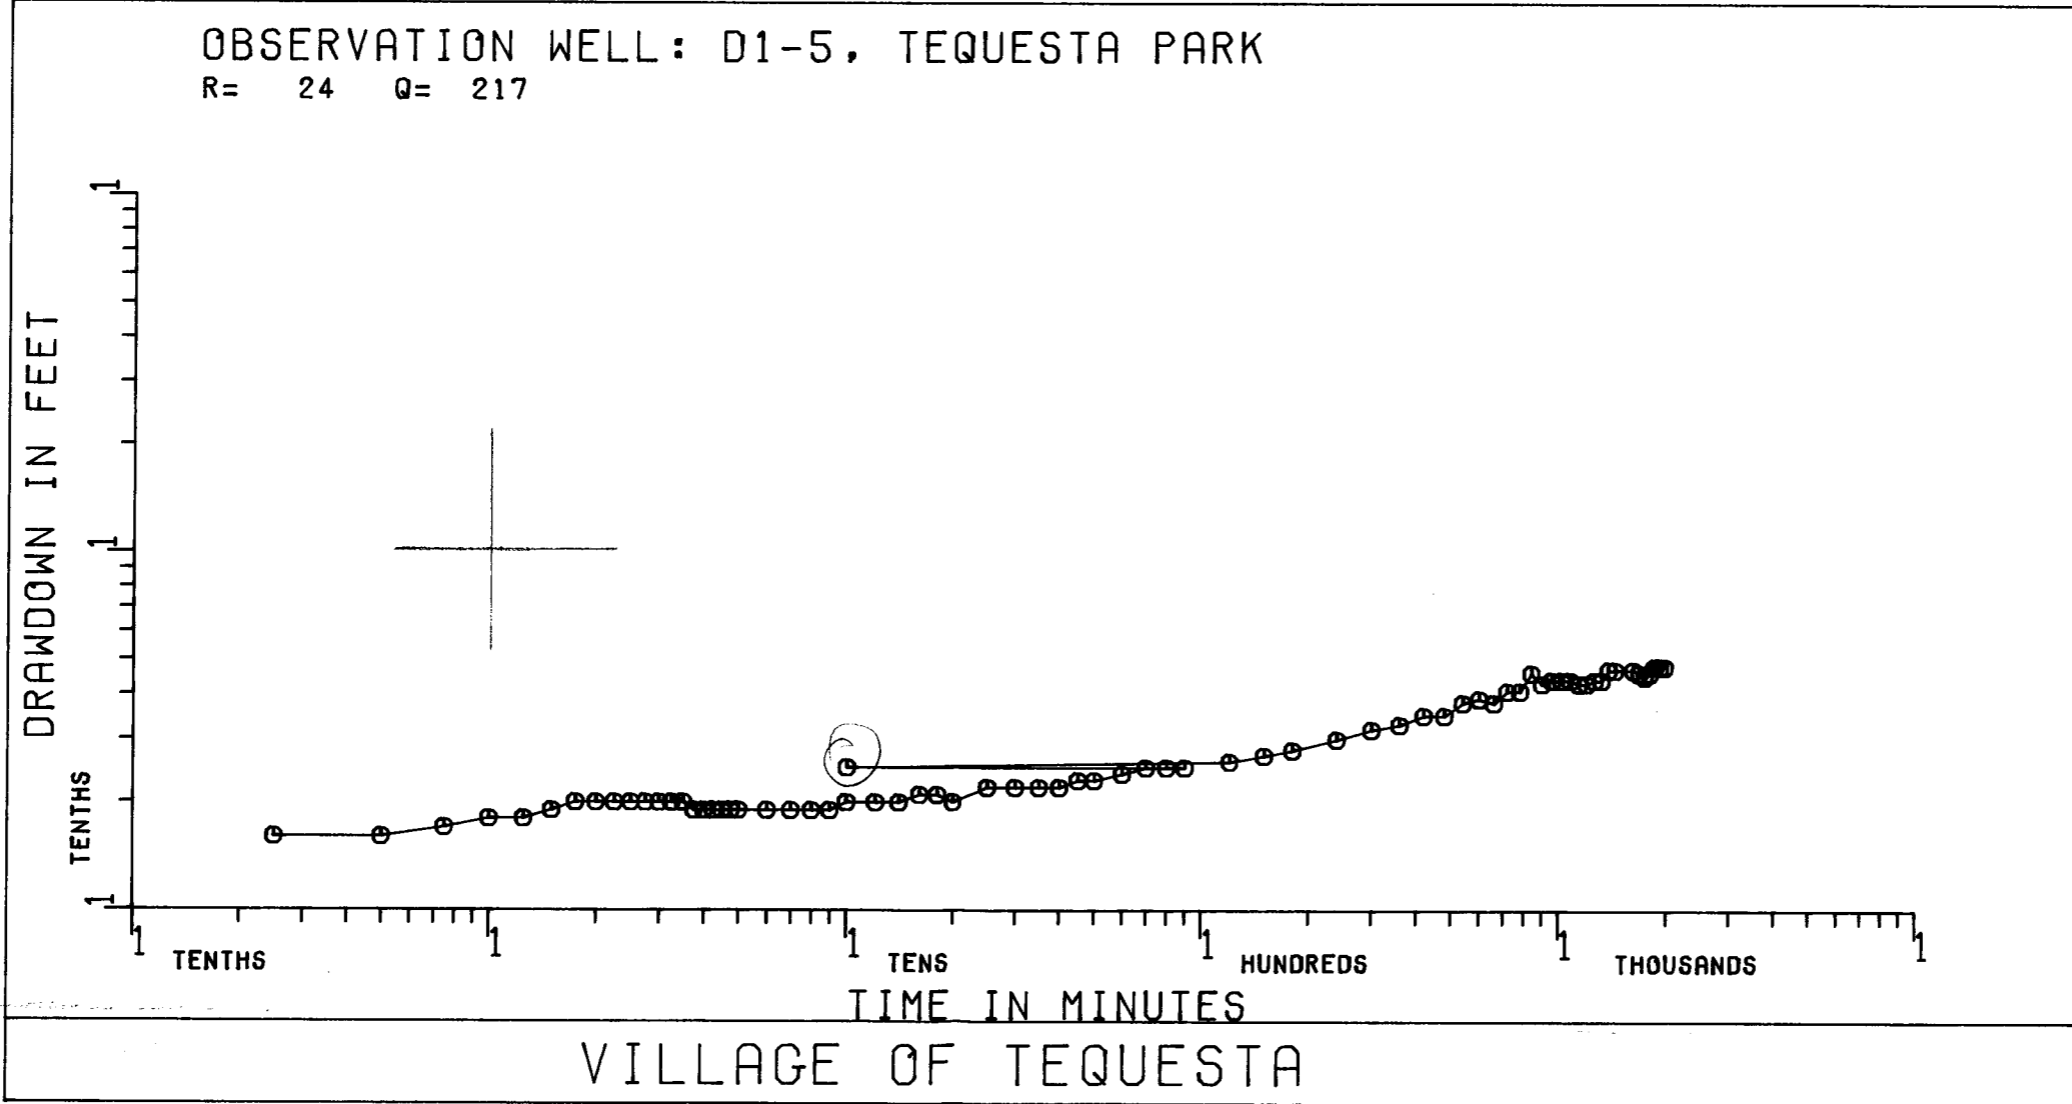

Tequesta Wellfield #2 APT Well 52-2

Streetsova Analysis

$t = 1050$ $W = 1$
 $S = .28$ $\theta = 10^\circ$

$Q = 460 \text{ gpm}$
 $r = 103'$
 $b = 120'$
 $\rho' = .6$
 $\rho = .6$
 $\rho' = .3$

$T = \frac{WQ}{4\pi \rho' S} \times 1440$

$= \frac{(1)(460)}{(4)(\pi)(.6)(.28)} \times 1440$

$= 217.89 \times 1440 = 313,763$

$S = \frac{4Tt}{\sigma r^2}$

$= \frac{(4)(217.89)(1050)}{(104)(103^2)}$

$= 8.6 \times 10^{-3}$

$K_h = \frac{T}{b}$
 $= 313763 / 120$
 $= 2614.7$

$\rho = \rho' b$
 $= (.3)(120)$
 $= 36$

$\rho = \sqrt{K_u / K_h} r$

$\frac{36}{120} = \sqrt{K_u / K_h}$

$K_u / K_h = .09$

$K_u = (K_h)(K_u / K_h)$

$= (2614.7)(.09)$
 $= 235.3$


42,381 50 SHEETS 5 SQUARE
42,382 100 SHEETS 5 SQUARE
42,383 200 SHEETS 5 SQUARE
MADE IN U.S.A.



WMD

TAPENO 6153 PLOT NO 002-1
USER: NO NELMS DATE 86/04/24 TIME 16:22

$\rho' = .3$

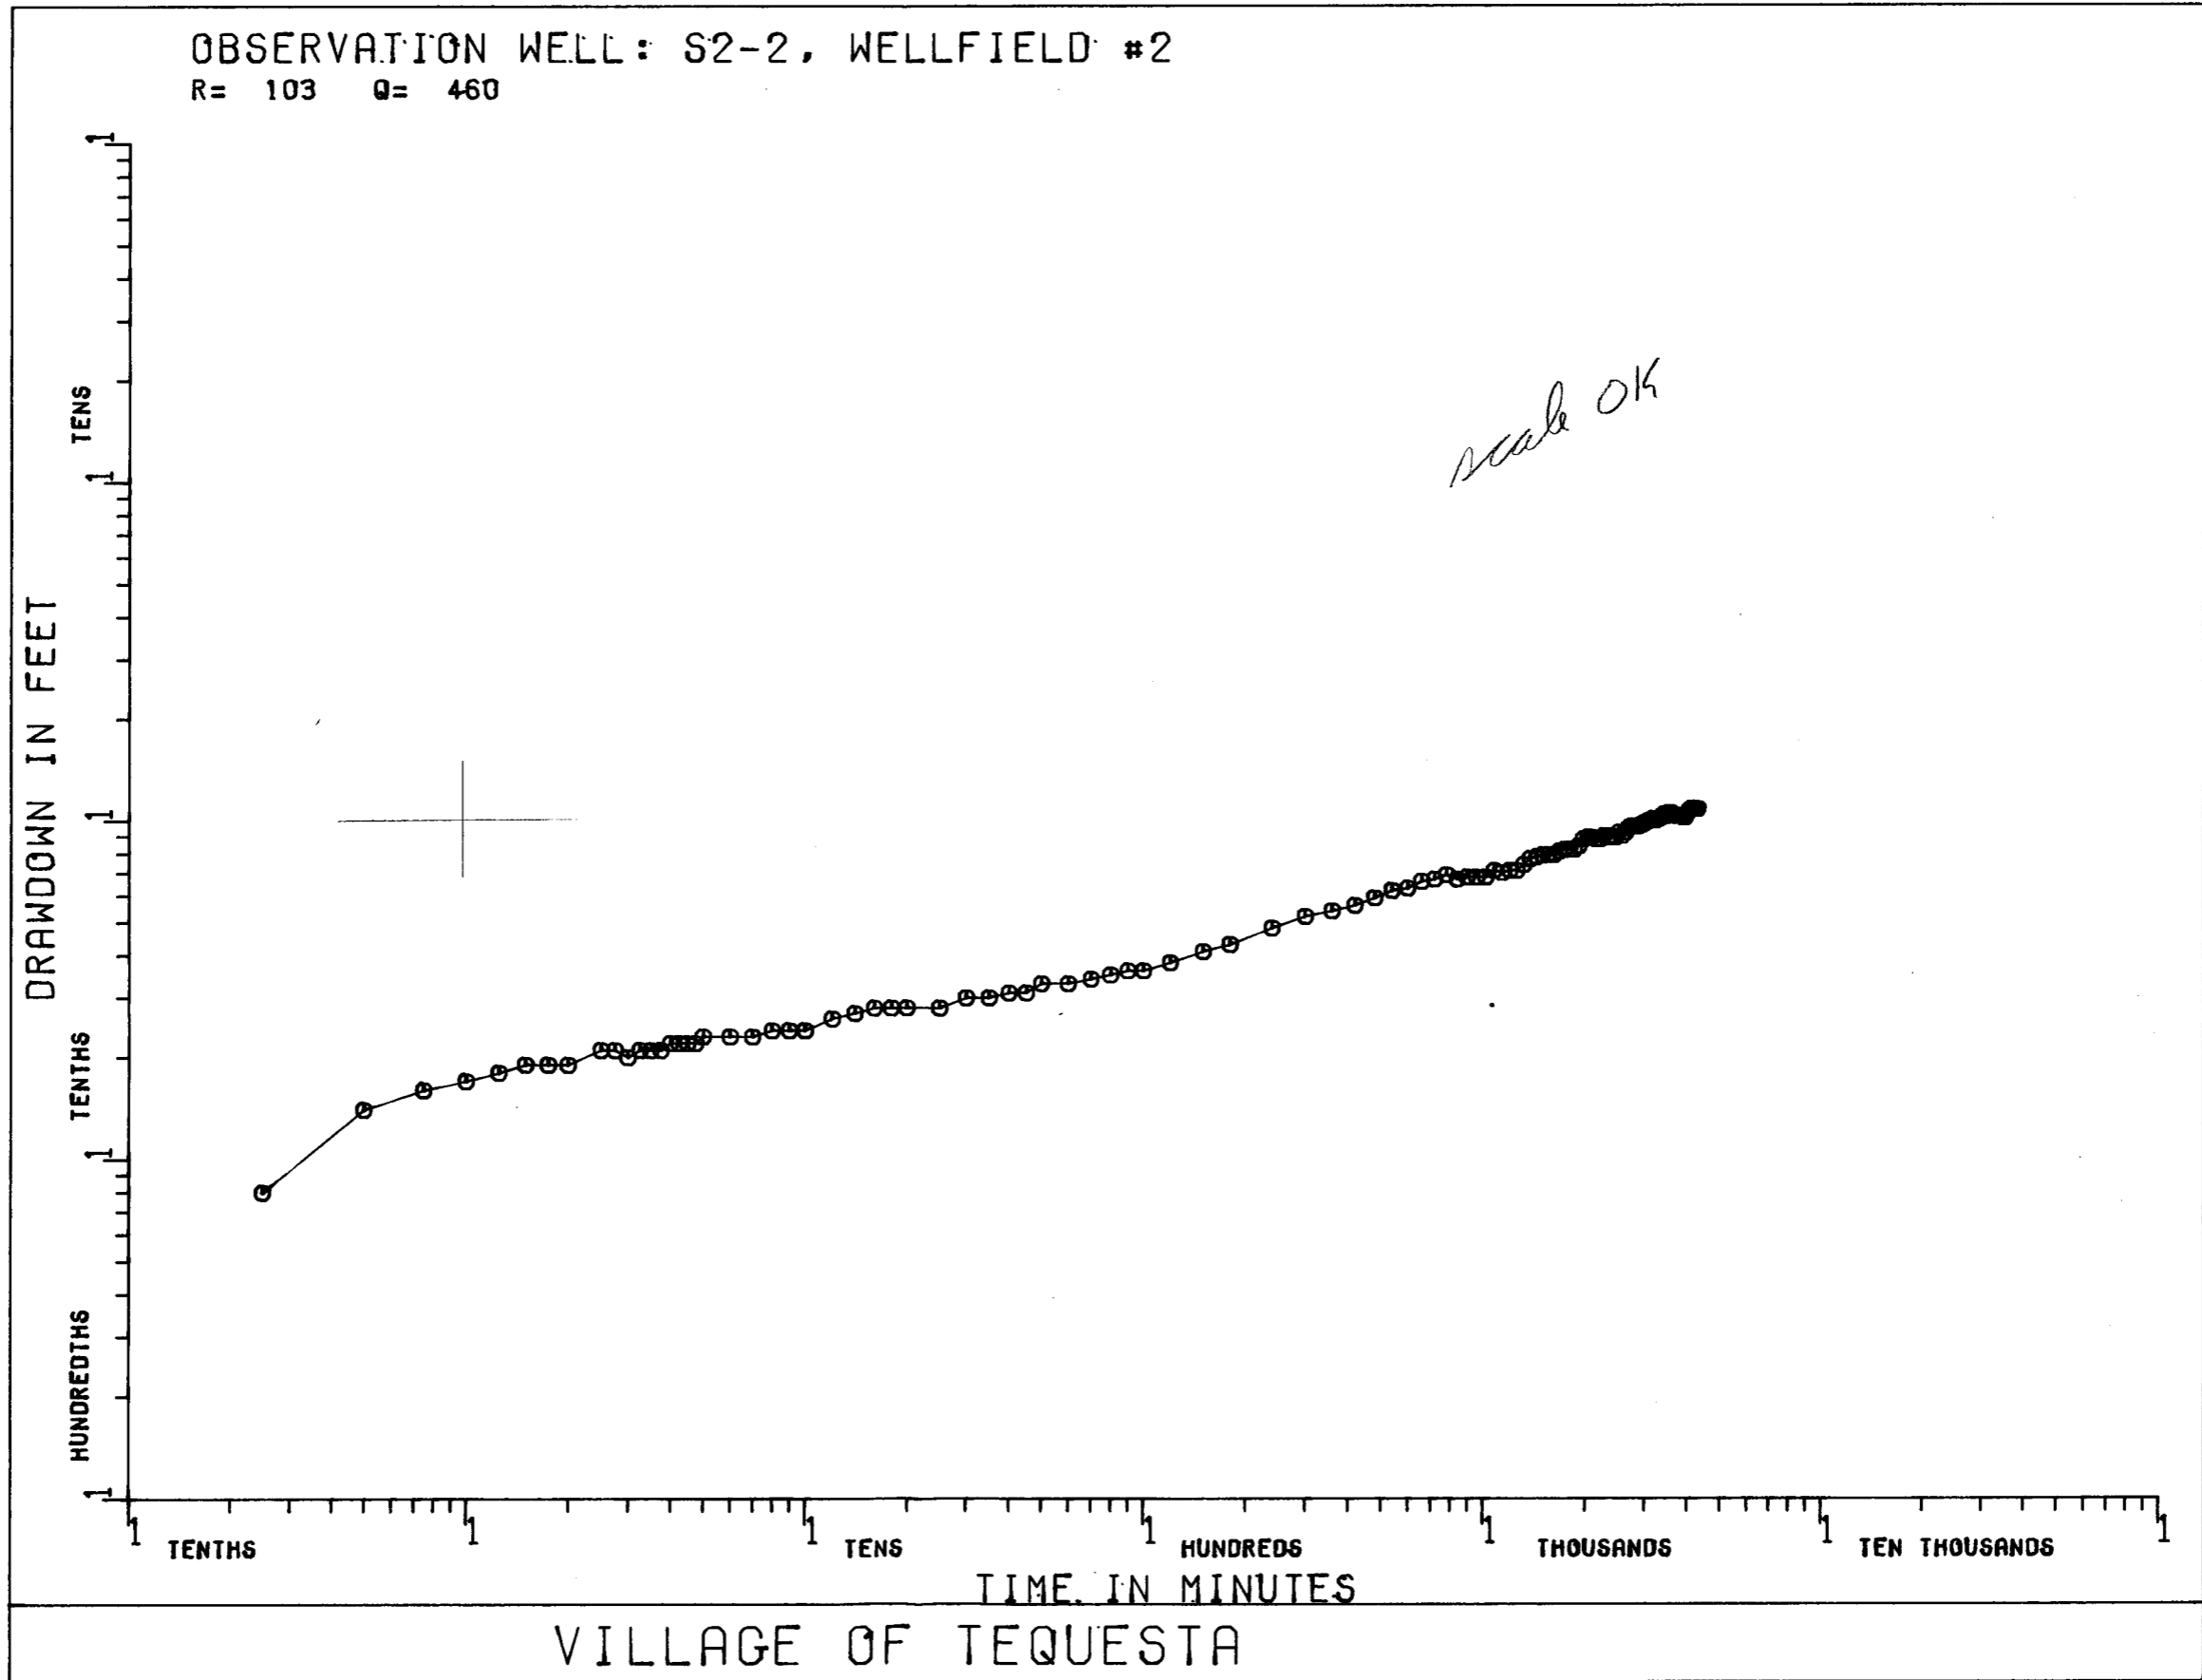

Neuman Analysis

$\checkmark t = 1 \text{ min}$ $\checkmark S_d = 1.1$
 $\checkmark s = 1 \text{ ft}$ $\checkmark t_s = 3.3$

$Q = 460 \text{ gpm}$
 $r = 194'$
 $b = 120'$
 $\beta = .4$

$T = \frac{114.6 Q S_d}{s}$

$= \frac{(114.6)(460)(1.1)}{1}$

$= 57,988 \text{ GPD/FT} \checkmark$

$S = \frac{T t}{2693 r^2 t_s}$

$= \frac{(57988)(1)}{(2693)(194^2)(3.3)}$

$1.7 \times 10^{-4} \checkmark$

$K_h = \frac{T}{b}$
 $= \frac{57988}{120}$

$= 483.2 \text{ GPD/FT}^2 \checkmark$

$K_d = \beta b^2 / r^2$

$= \frac{(.4)(120^2)}{194^2}$

$= .15 \checkmark$

$K_z = K_h K_d$
 $= (483.2)(.15)$

$= 73.9 \text{ GPD/FT}^2 \checkmark$

match very questionable

$S_y = \frac{C_2 T t}{r^2 t_y}$
 $= \frac{.337(57988)(1)}{(194^2)(.033)}$
 $= \frac{7753}{1242}$
 $= 6.2$

Poor Match (1)

Streissauer Analysis

$t = 4900$ $W = 1$
 $s = 1.1$ $\sigma = 10^4$

$$T = \frac{WQ}{4\pi l' s} \times 1440$$

$$= \frac{(1)(460)}{(4)(\pi)(.6)(1.1)} \times 1440$$

$= 55.46 \times 1440 = 79,867$

$$S = \frac{4Tt}{\sigma r^2}$$

$$= \frac{(4)(55.46)(4900)}{(10^4)(194^2)}$$

$= 2.9 \times 10^{-3}$

$$K_h = T/b$$

$$= 79867/120$$

$$= 665.6$$

$$K_v = (K_h)(K_u/K_h)$$

$$= (665.6)(.86)$$

$$= 573.0$$

$Q = 460 \text{ gpm}$
 $r = 194'$
 $b = 120'$
 $l' = .6$
 $s = 1.1$
 $\rho = 1.5?$

match extremely questionable

$$\rho = \rho' h$$

$$= (1.5)(120)$$

$$= 180$$

$$\rho = \sqrt{K_u/K_h} \cdot r$$

$$\frac{180}{194} = \sqrt{K_u/K_h}$$


$$K_u/K_h = .86$$

WMD

TAPENO 6153 PLOT NO 0047
USER NO NELMS DATE 86/04/24 TIME 16:23

$\rho = 1.5$

OBSERVATION WELL: S3-2, WELLFIELD #2
R= 194 Q= 460

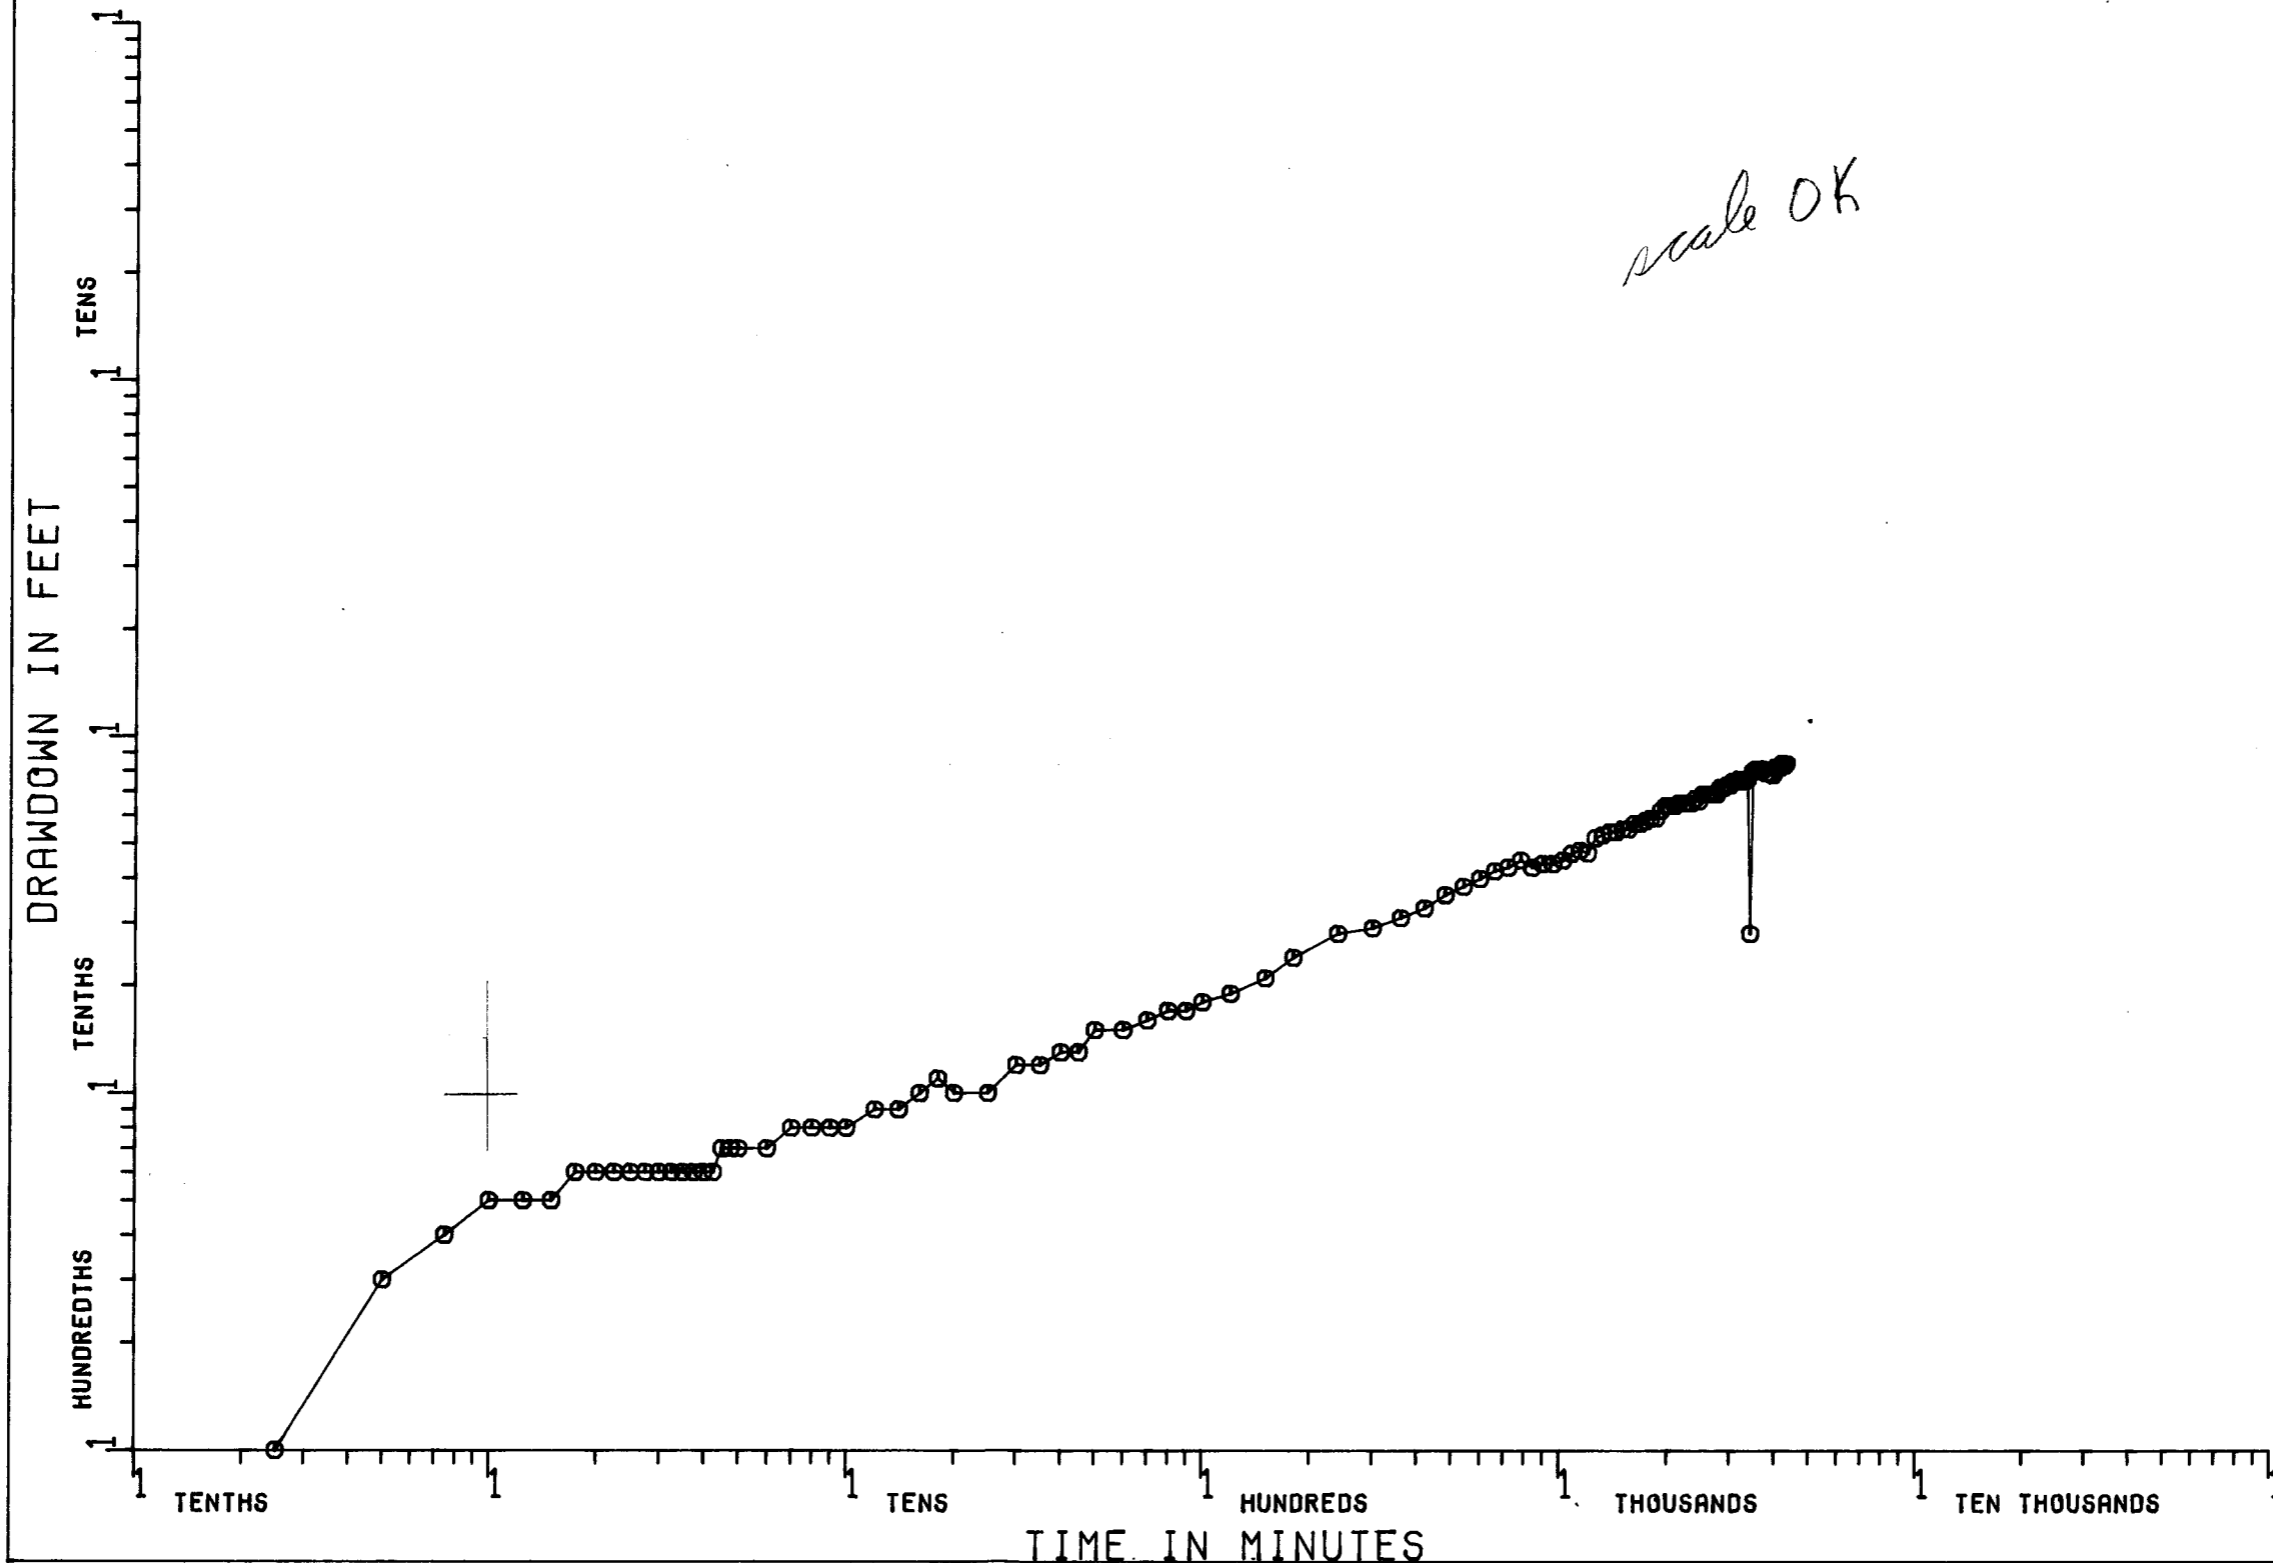

VILLAGE OF TEQUESTA

Neuman Analysis

$\checkmark t = 1 \text{ min}$ $\checkmark S_d = 22$
 $\checkmark s = 1 \text{ ft}$ $\checkmark t_s = 100$

$Q = 460 \text{ gpm}$
 $r = 103'$
 $b = 120'$
 $\beta = .001$

$T = \frac{114.6 Q S_d}{s}$

$= \frac{(114.6)(460)(22)}{1}$

$= 1,159,752 \text{ GPD/FT} \checkmark (155,047 \text{ FT}^2/\text{DAY})$

$S = \frac{T t}{2693 r^2 t_s}$

$= \frac{(1159752)(1)}{(2693)(103^2)(100)}$

$= 4.06 \times 10^{-4} \checkmark$

$K_h = T/b$

$= 1157952/120$

$= 9649.6 \text{ GPD/FT}^2 \checkmark (1290 \text{ FT/DAY})$

$K_d = \beta \frac{b^2}{r^2}$

$= \frac{(.001)(120^2)}{(103^2)}$

$= .001 \checkmark$

$K_z = K_h K_d$


$= (9649.6)(.0013)$

$= 13.09 \text{ GPD/FT}^2 \checkmark (1.75 \text{ FT/DAY})$

Poor Match (1) Points after 10 min. didn't fit, curve never levelled


Tequesta APT - Wellfield #2

$Q = 450 \text{ gpm}$ $t = 72 \text{ hours}$

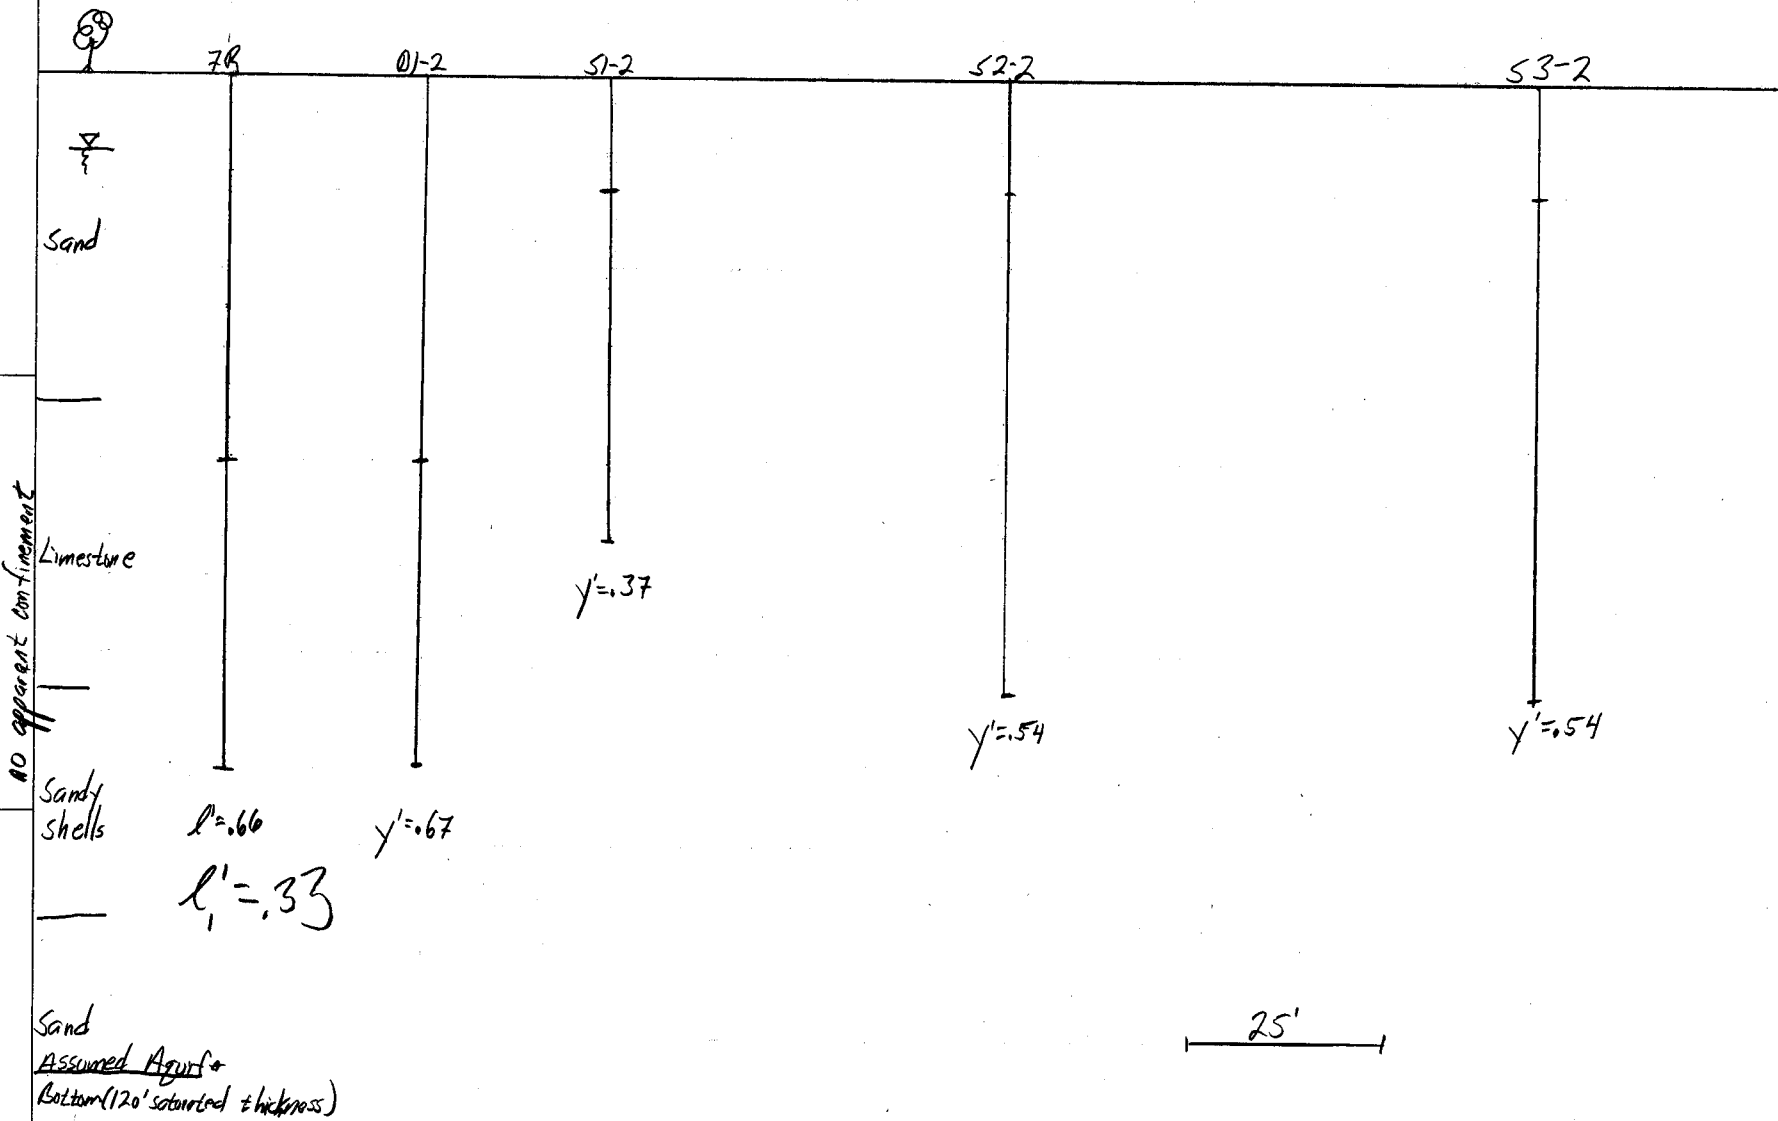


Tegusta APT. Wellfield #3

$Q = 460 \text{ gpm}$ $t = 72 \text{ hours}$

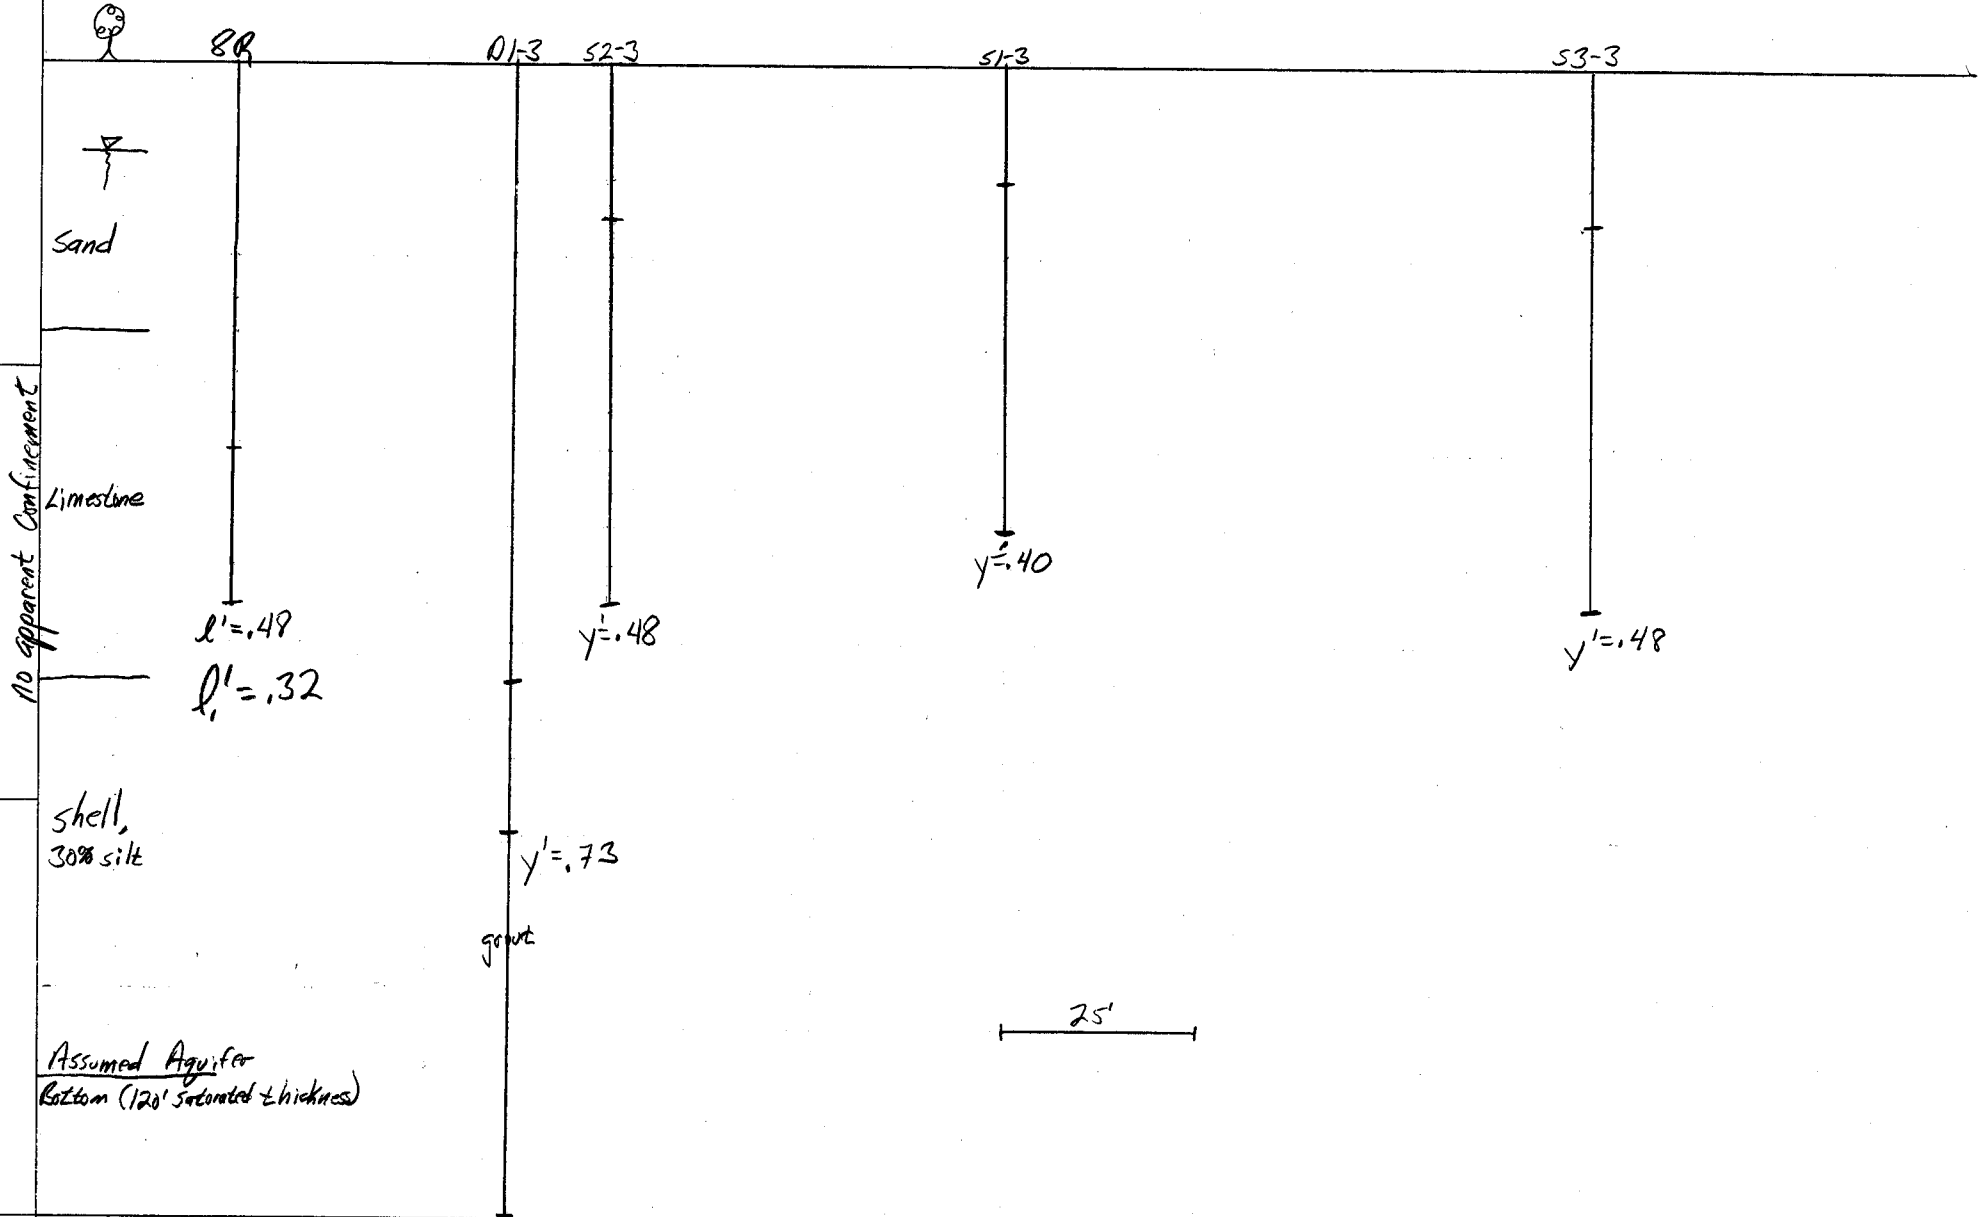

Tegesta APT - Wellfield #5

$Q = 218 \text{ GPM}, t = 36 \text{ hours}$

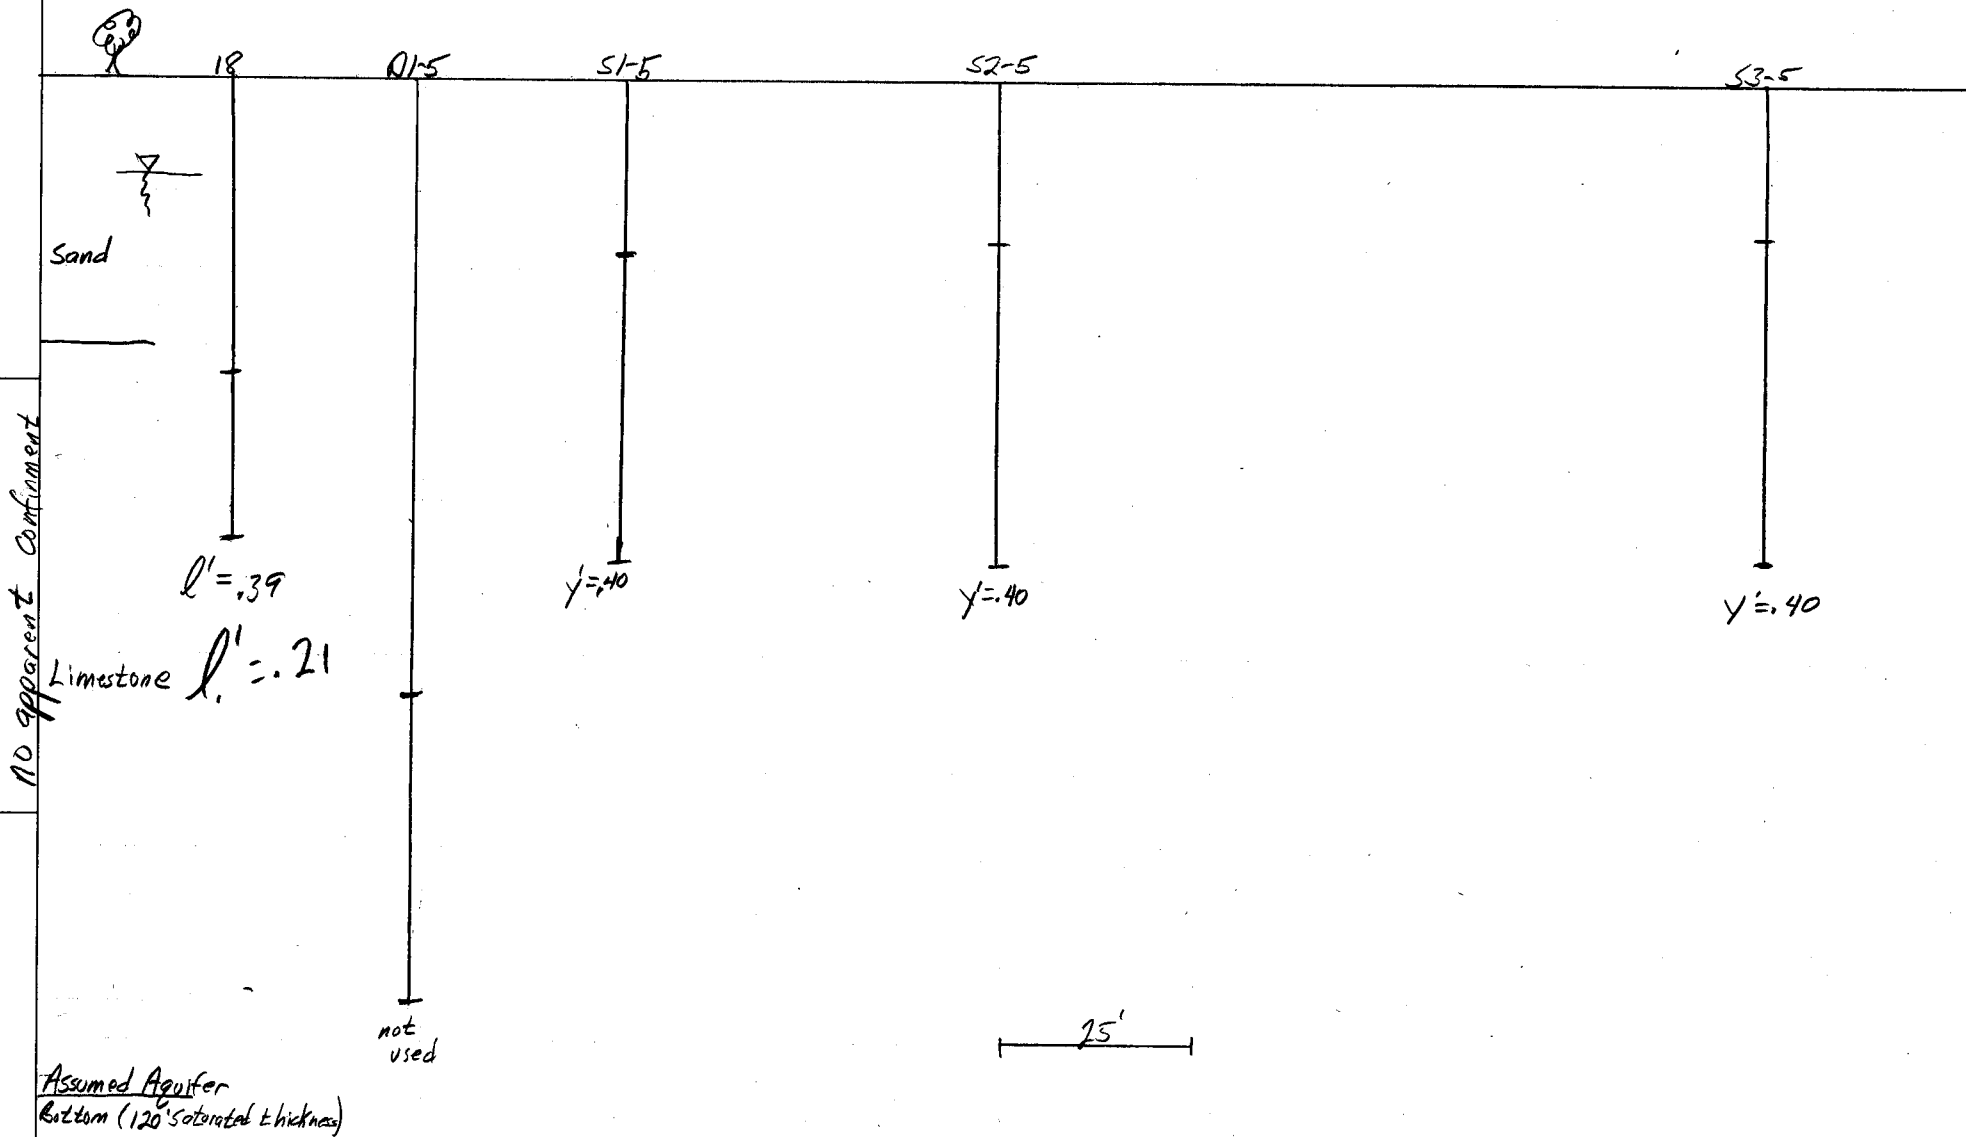

NO apparent confinement

Assumed Aquifer Bottom (120' saturated thickness)

Teguesta

BOULTON TO NEUMAN

Wellfield 2 Obs. Well S1-2

INPUT DATA:

AQUIFER THICKNESS = 200 FT
DISTANCE PUMP WELL TO OBS WELL = 48.5 FT
TRANSMISSIVITY = 290957 GPD/FT
SPECIFIC YIELD = .02
ALPHA = 0
r/B = .2

RESULTS:

HORIZONTAL HYDRAULIC CONDUCTIVITY = 1454.785 (GPD/FT²)
VERTICAL HYDRAULIC CONDUCTIVITY = 235.069 (GPD/FT²)
ANISOTROPY RATIO = .1615833 (GPD/FT²)

BOULTON TO NEUMAN

Wellfield 2 Obs. Well S2-2

INPUT DATA:

AQUIFER THICKNESS = 200 FT
DISTANCE PUMP WELL TO OBS WELL = 103 FT
TRANSMISSIVITY = 361187 GPD/FT
SPECIFIC YIELD = .06
ALPHA = 0
r/B = .6

RESULTS:

HORIZONTAL HYDRAULIC CONDUCTIVITY = 1805.935 (GPD/FT²)
VERTICAL HYDRAULIC CONDUCTIVITY = 674.8705 (GPD/FT²)
ANISOTROPY RATIO = .3736959 (GPD/FT²)

BOULTON TO NEUMAN

Wellfield 2 Obs. Well S3-2

INPUT DATA:

AQUIFER THICKNESS = 200 FT
DISTANCE PUMP WELL TO OBS WELL = 194.5 FT
TRANSMISSIVITY = 402863 GPD/FT
SPECIFIC YIELD = .07
ALPHA = 0
r/B = 1.5

RESULTS:

HORIZONTAL HYDRAULIC CONDUCTIVITY = 2014.315 (GPD/FT²)
VERTICAL HYDRAULIC CONDUCTIVITY = 1523.493 (GPD/FT²)
ANISOTROPY RATIO = .756333 (GPD/FT²)

BOULTON TO NEUMAN

Wellfield 2 Obs. Well D1-2

INPUT DATA:

AQUIFER THICKNESS = 200 FT
DISTANCE PUMP WELL TO OBS WELL = 25 FT
TRANSMISSIVITY = 133263 GPD/FT
SPECIFIC YIELD = .3
ALPHA = 0
r/B = .1

RESULTS:

HORIZONTAL HYDRAULIC CONDUCTIVITY = 666.315 (GPD/FT²)
VERTICAL HYDRAULIC CONDUCTIVITY = 93.28747 (GPD/FT²)
ANISOTROPY RATIO = .1400051 (GPD/FT²)

BOULTON TO NEUMAN

Wellfield 3 Obs. Well S1-3

INPUT DATA:

AQUIFER THICKNESS = 200 FT
DISTANCE PUMP WELL TO OBS WELL = 100.4 FT
TRANSMISSIVITY = 766090 GPD/FT
SPECIFIC YIELD = .011
ALPHA = 0
r/B = .4

RESULTS:

HORIZONTAL HYDRAULIC CONDUCTIVITY = 3830.45 (GPD/FT²)
VERTICAL HYDRAULIC CONDUCTIVITY = 632.348 (GPD/FT²)
ANISOTROPY RATIO = .1650845 (GPD/FT²)

BOULTON TO NEUMAN

Wellfield 3 Obs. Well S2-3

INPUT DATA:

AQUIFER THICKNESS = 200 FT
DISTANCE PUMP WELL TO OBS WELL = 49.5 FT
TRANSMISSIVITY = 362900 GPD/FT
SPECIFIC YIELD = .03
ALPHA = 0
r/B = .1

RESULTS:

HORIZONTAL HYDRAULIC CONDUCTIVITY = 1814.5 (GPD/FT²)
VERTICAL HYDRAULIC CONDUCTIVITY = 64.7993 (GPD/FT²)
ANISOTROPY RATIO = 3.571193E-02 (GPD/FT²)

BOULTON TO NEUMAN

Wellfield 3 Obs Well S3-3

INPUT DATA:

AQUIFER THICKNESS = 200 FT
DISTANCE PUMP WELL TO OBS WELL = 177.45 FT
TRANSMISSIVITY = 756042 GPD/FT
SPECIFIC YIELD = .31
ALPHA = 0
r/B = 1

RESULTS:

HORIZONTAL HYDRAULIC CONDUCTIVITY = 3780.21 (GPD/FT²)
VERTICAL HYDRAULIC CONDUCTIVITY = 1428.513 (GPD/FT²)
ANISOTROPY RATIO = .3778924 (GPD/FT²)

BOULTON TO NEUMAN

Wellfield 3 Obs. Well D1-3

INPUT DATA:

AQUIFER THICKNESS = 200 FT
DISTANCE PUMP WELL TO OBS WELL = 37.8 FT
TRANSMISSIVITY = 435480 GPD/FT
SPECIFIC YIELD = .41
ALPHA = 0
r/B = .1

RESULTS:

HORIZONTAL HYDRAULIC CONDUCTIVITY = 2177.4 (GPD/FT²)
VERTICAL HYDRAULIC CONDUCTIVITY = 133.3455 (GPD/FT²)
ANISOTROPY RATIO = .0612407 (GPD/FT²)

BOULTON TO NEUMAN

INPUT DATA:

AQUIFER THICKNESS = 200 FT
DISTANCE PUMP WELL TO OBS WELL = 51.5 FT
TRANSMISSIVITY = 227116 GPD/FT
SPECIFIC YIELD = .17
ALPHA = 0
r/B = .4

RESULTS:

HORIZONTAL HYDRAULIC CONDUCTIVITY = 1135.58 (GPD/FT²)
VERTICAL HYDRAULIC CONDUCTIVITY = 712.4871 (GPD/FT²)
ANISOTROPY RATIO = .6274213 (GPD/FT²)

BOULTON TO NEUMAN

Wellfield 5 Obs. Well S2-5

INPUT DATA:

AQUIFER THICKNESS = 200 FT
DISTANCE PUMP WELL TO OBS WELL = 99.8 FT
TRANSMISSIVITY = 185058 GPD/FT
SPECIFIC YIELD = .17
ALPHA = 0
r/B = 1

RESULTS:

HORIZONTAL HYDRAULIC CONDUCTIVITY = 925.29 (GPD/FT²)
VERTICAL HYDRAULIC CONDUCTIVITY = 1105.445 (GPD/FT²)
ANISOTROPY RATIO = 1.194701 (GPD/FT²)

BOULTON TO NEUMAN

Wellfield 5 Obs. Well S3-5

INPUT DATA:

AQUIFER THICKNESS = 200 FT
DISTANCE PUMP WELL TO OBS WELL = 194.7 FT
TRANSMISSIVITY = 297414 GPD/FT
SPECIFIC YIELD = .2
ALPHA = 0
r/B = 1.5

RESULTS:

HORIZONTAL HYDRAULIC CONDUCTIVITY = 1487.07 (GPD/FT²)
VERTICAL HYDRAULIC CONDUCTIVITY = 1122.411 (GPD/FT²)
ANISOTROPY RATIO = .75478 (GPD/FT²)

BOULTON TO NEUMAN



Wellfield 5 Obs. Well D1-5

INPUT DATA:

AQUIFER THICKNESS = 200 FT
DISTANCE PUMP WELL TO OBS WELL = 23.8 FT
TRANSMISSIVITY = 390356 GPD/FT
SPECIFIC YIELD = .25
ALPHA = 0
r/B = .3

RESULTS:

HORIZONTAL HYDRAULIC CONDUCTIVITY = 1951.78 (GPD/FT²)
VERTICAL HYDRAULIC CONDUCTIVITY = 3103.338 (GPD/FT²)
ANISOTROPY RATIO = 1.590004 (GPD/FT²)

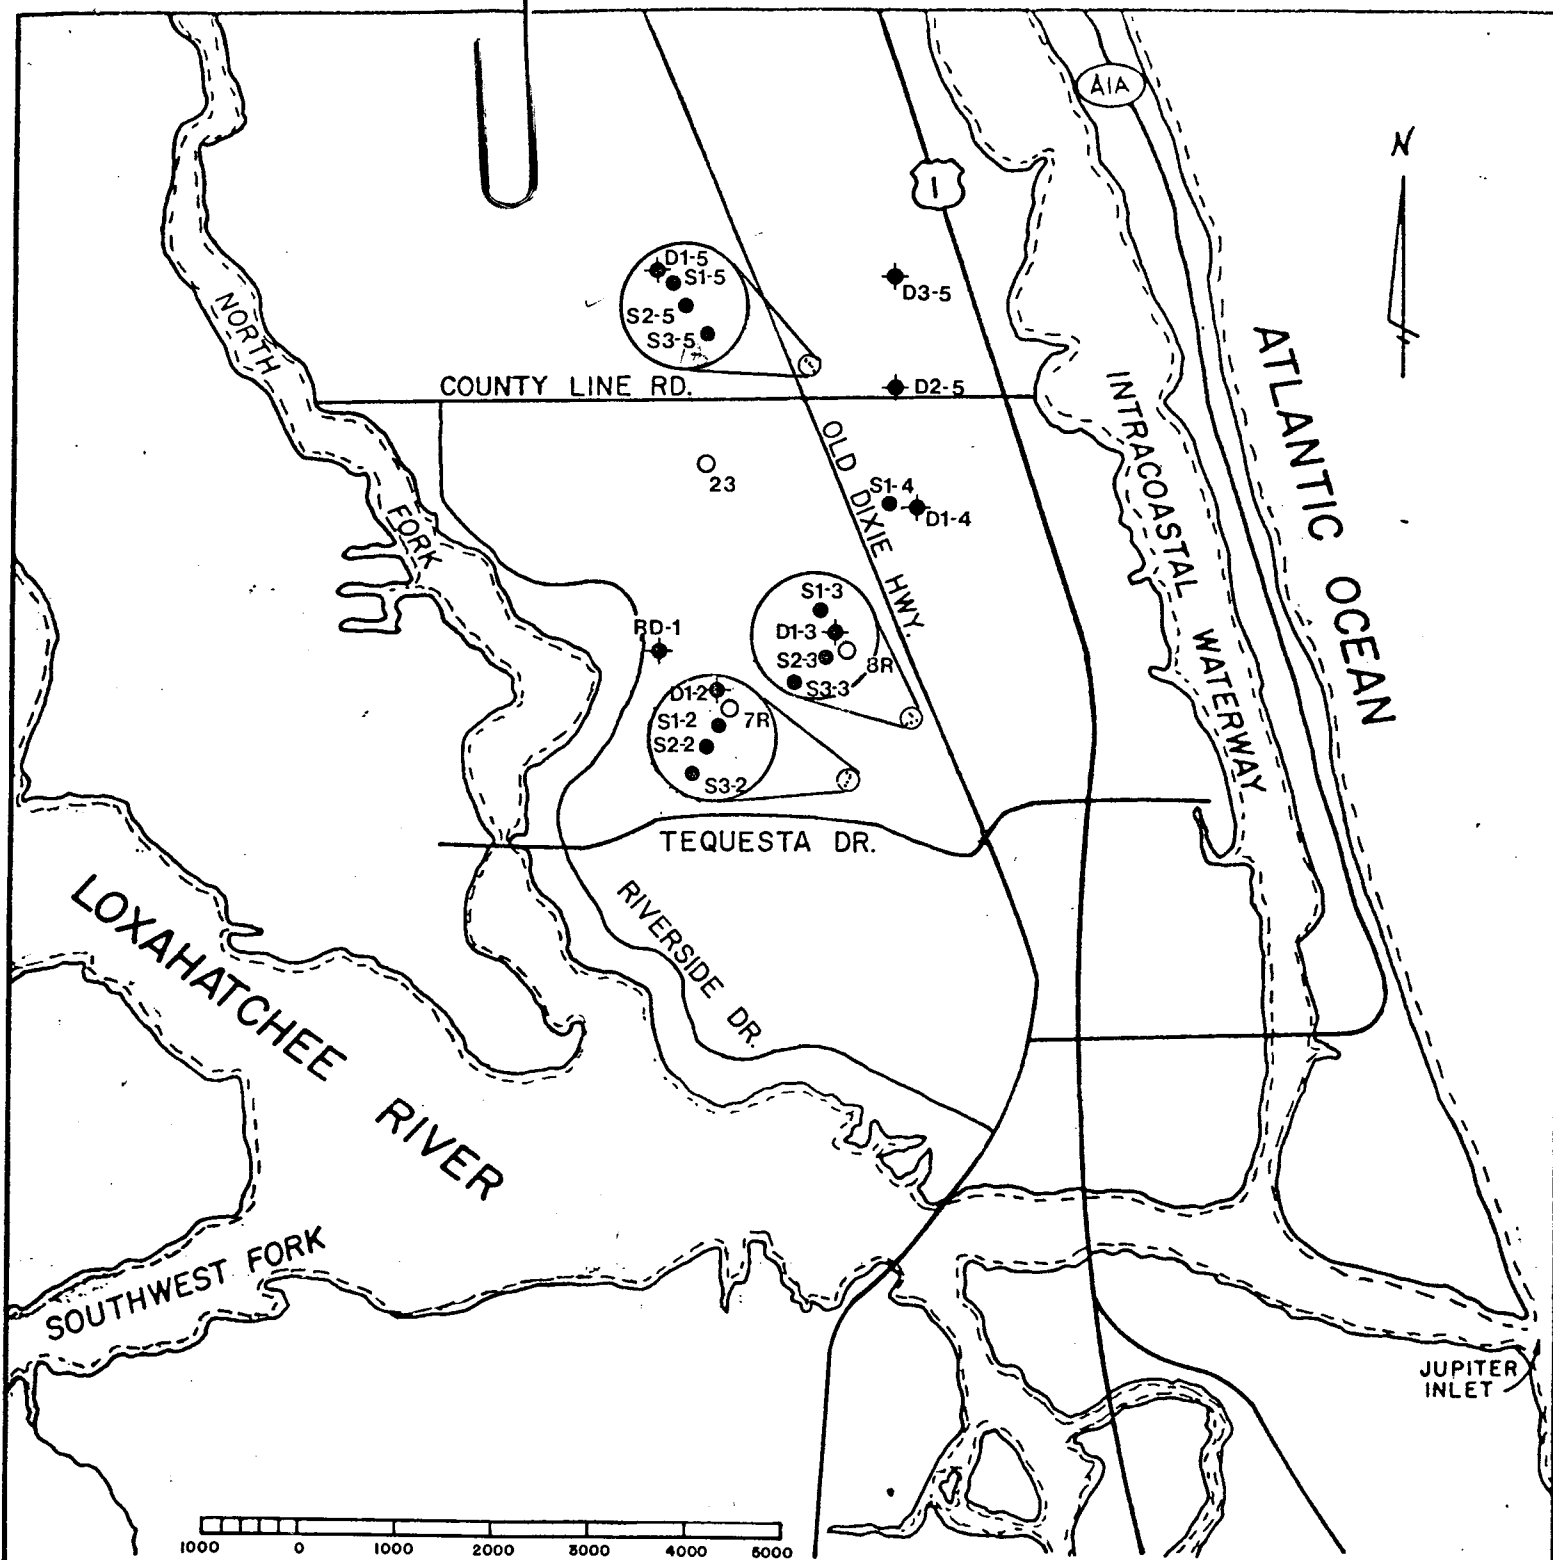

SCALE IN FEET

LEGEND

- TEST SUPPLY WELL
- ◆ DEEP OBSERVATION WELL
- SHALLOW OBSERVATION WELL

OBSERVATION AND TEST SUPPLY

WELL LOCATIONS

GEE & JENSON ENGINEERS-ARCHITECTS-PLANNERS, INC.
WEST PALM BEACH, FLORIDA



TABLE 4.2

TEST SUPPLY WELL CONSTRUCTION DATA
VILLAGE OF TEQUESTA

Location	Well No.	Casing Diameter (in.)	Cased Interval (ft.)	Screen Diameter (in.)	Screened Interval (ft.)	Total Depth (ft.)	Date Constructed
Wellfield No. 2	7R	16(Outer) ¹ 10(Inner) ²	0-50	8	50-90 ³	90	6/17/80 to 6/28/80
Wellfield No. 3	8R	16(Outer) ¹ 10(Inner) ²	0-50	8	50-70 ³	70	7/22/80 to 7/30/80
West End of Wingo Street	23	16(Outer) ¹ 10(Inner) ²	0-45	8	45-70 ³	70	3/2/81 to 3/16/81

- 1 Steel
- 2 Schedule 40 PVC
- 3 #100 Slot Schedule 40 PVC


Wellfield 2, Well 7R
T = 352,000 gpd/ft
S = 0.05

Wellfield 3, Well 8R and Well 23
T = 762,000 gpd/ft
S = 0.02

Wellfield 5, Well 18
T = 237,000 gpd/ft
S = 0.18

Transmissivity values appear to increase northward in response to a higher average water table and greater aquifer thickness. The significantly lower transmissivity observed in Wellfield 5 is primarily a result of the shallow penetration (35 feet) into the aquifer of the pumped well. Transmissivity is a function of aquifer thickness. Presuming an available aquifer thickness of 120 feet for this area, as indicated by test data, a fully penetrating well would produce transmissivity values nearly triple (700,000 gpd/ft) those calculated for Well 18 (237,000 gpd/ft).

Raw Data Available

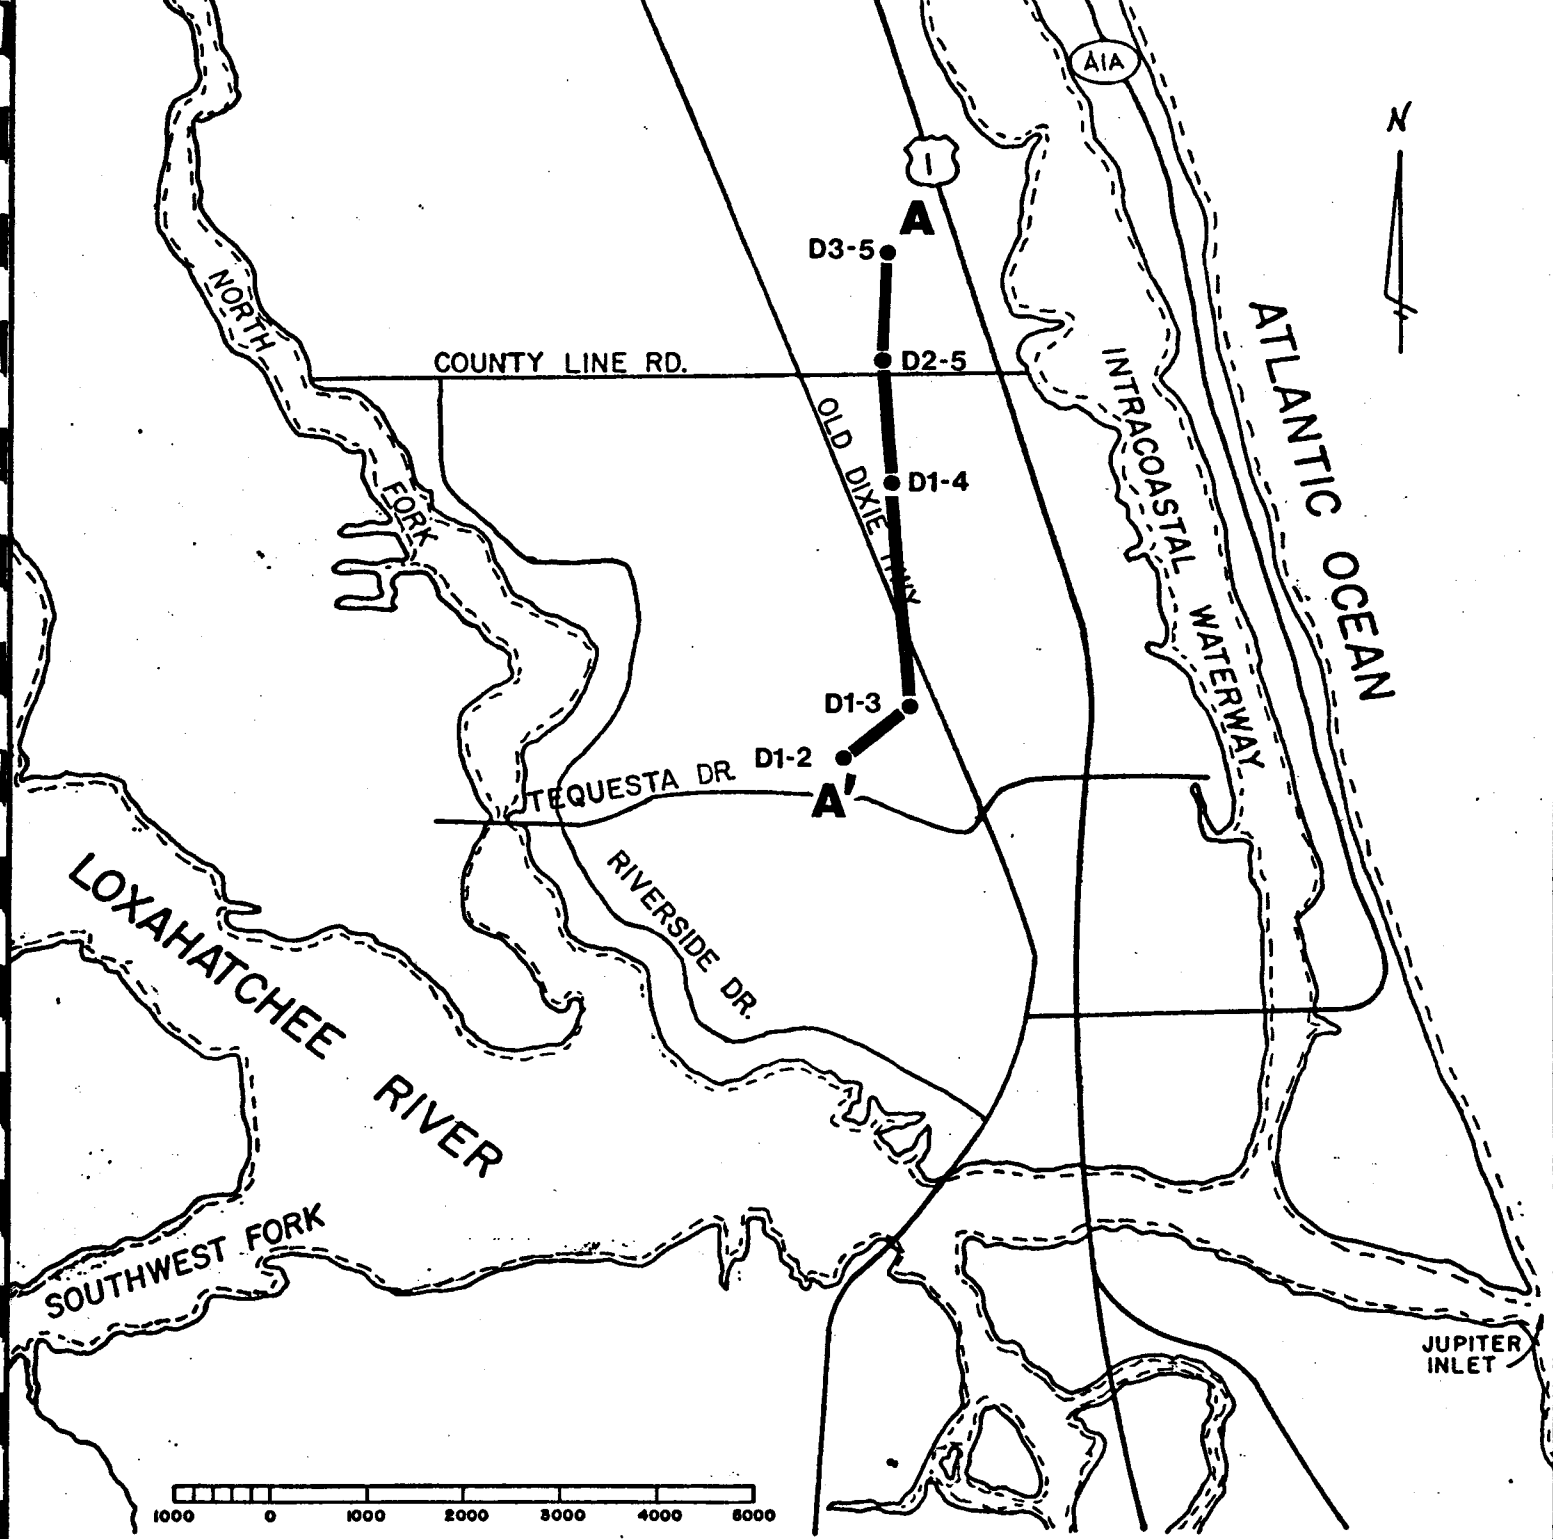


LEGEND

● DEEP OBSERVATION WELL

LOCATION OF LITHOLOGIC CROSS-SECTION

GEE & JENSON ENGINEERS-ARCHITECTS-PLANNERS, INC.
WEST PALM BEACH, FLORIDA

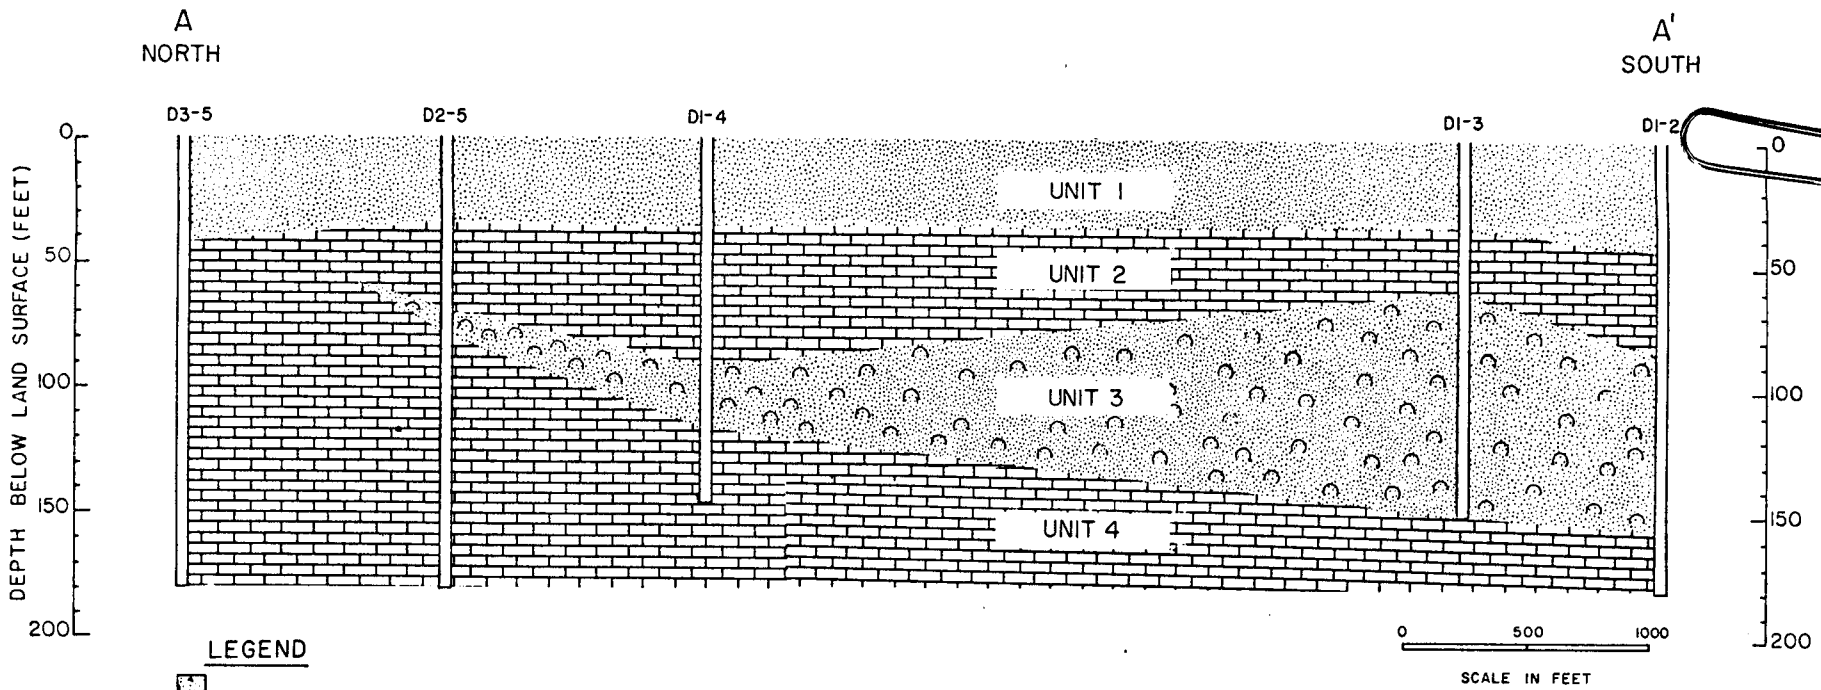

- LEGEND**
- 1 SAND
 - 2 LIMESTONE
 - 3 SAND AND SHELL
 - 4 LIMESTONE

LITHOLOGIC CROSS-SECTION

GEE & JENSON ENGINEERS-ARCHITECTS-PLANNERS, INC.
WEST PALM BEACH, FLORIDA

78-224

FIGURE 52

PB103



TABLE 6.1

WELL CONSTRUCTION DATA FOR AQUIFER TEST GROUPS
VILLAGE OF TEQUESTA

<u>Location</u>	<u>Well No.</u>	<u>Casing Diameter (in.)</u>	<u>Cased Interval (ft.)</u>	<u>Screen Diameter (in.)</u>	<u>Screened Interval (ft.)</u>	<u>Total Depth (ft.)</u>	<u>Distance from Pumped Well (ft.)</u>
Wellfield No. 2	7R	16(Outer) 10(Inner)	0-50(Outer) 0-50(Inner)	8	50-90	90	0.0
	S1-2	2	0-15	2	15-58	58	48.5
	S2-2	2	0-15	2	15-79	79	103.0
	S3-2	2	0-15	2	15-80	80	194.4
	D1-2	2	0-50	2	50-180	89 ¹	25.0
Wellfield No. 3	8R	16(Outer) 10(Inner)	0-50(Outer) 0-50(Outer)	8	50-70	70	0.0
	S1-3	2	0-15	2	15-60	60	100.3
	S2-3	2	0-20	2	20-70	70	49.5
	S3-3	2	0-20	2	20-70	70	177.4
	D1-3	2	0-80	2	80-151	97 ²	37.8
Wellfield No. 5	18	6	0-38	6	38-60	60	0.0
	S1-5	2	0-23	2	23-63	63	51.5
	S2-5	2	0-22	2	22-62	62	99.8
	S3-5	2	0-20	2	20-60	60	194.7
	D1-5	2	0-80	2	80-120	120	23.8

¹ Grouted to 89 feet on July 7, 1980

² Grouted to 97 feet on August 20, 1980

TABLE 6.2

SUMMARY OF AQUIFER PARAMETERS ¹
VILLAGE OF TEQUESTA

Well 7R Wellfield 2	Q=457 gpm	TRANSMISSIVITY (gpd/ft.)		STORAGE COEFFICIENT	
		Early Time	Late Time	Early Time	Late Time
D1-2 (r=25 ft.)		²	133,263 ³	²	0.30
S1-2 (r=48.5 ft.)		308,072	290,957	1.4 x 10 ⁻³	0.02
S2-2 (r=103 ft.)		402,863	361,187	1.4 x 10 ⁻³	0.06
S3-2 (r=194.5 ft.)		374,087	<u>402,863</u>	1.4 x 10 ⁻³	<u>0.07</u>
			351,669		0.05
Well 8R					
Wellfield 3	Q=950 gpm				
S2-3 (r=49.5 ft.)		²	362,900 ³	²	0.03
S1-3 (r=100.35 ft.)		²	766,090	²	0.01
S3-3 (r=177.45 ft.)		745,685	<u>756,042</u>	9.9 x 10 ⁻⁴	<u>0.03</u> ^
			761,066		0.02
Well 18					
Wellfield 5	Q=218 gpm				
S1-5 (r=51.5 ft.)		227,116	227,116	9.8 x 10 ⁻³	0.17
S2-5 (r=99.8 ft.)		²	185,058	²	0.17
S3-5 (r=194.7 ft.)		²	<u>297,414</u>	²	<u>0.20</u>
			237,196		0.18

¹ Results obtained using Boulton Method of Analysis

² Field data could not be curve-matched.


³ Not used in computing average values.

TABLE 6.6
SUMMARY OF SPECIFIC CAPACITY TEST DATA
VILLAGE OF TEQUESTA

<u>Well No.</u>	<u>Discharge gpm</u>	<u>Drawdown (ft.)</u>	<u>Specific Capacity (gpm/ft)</u>	<u>Duration of Test (min.)</u>	<u>Screened Interval (ft.)</u>	<u>Slot Size</u>	<u>Transmissivity (gpd/ft)</u>
7R	457	9.02	50	4,320	40	100	352,000
8R	950	20.77	46	4,380	20	100	762,000
18	218	10.16	21 ¹	2,160	25	20	237,000
23	855	14.40	59	300	25	100	²

¹ Specific capacity of Well 18 is anomalously low due to method of well construction. (Slot size and diameter of screen)

² Comparing pumping rate, screened interval and specific capacity indicates the transmissivity of Well 23 is in the same range or greater than Well 8R (762,000 gpd/ft).

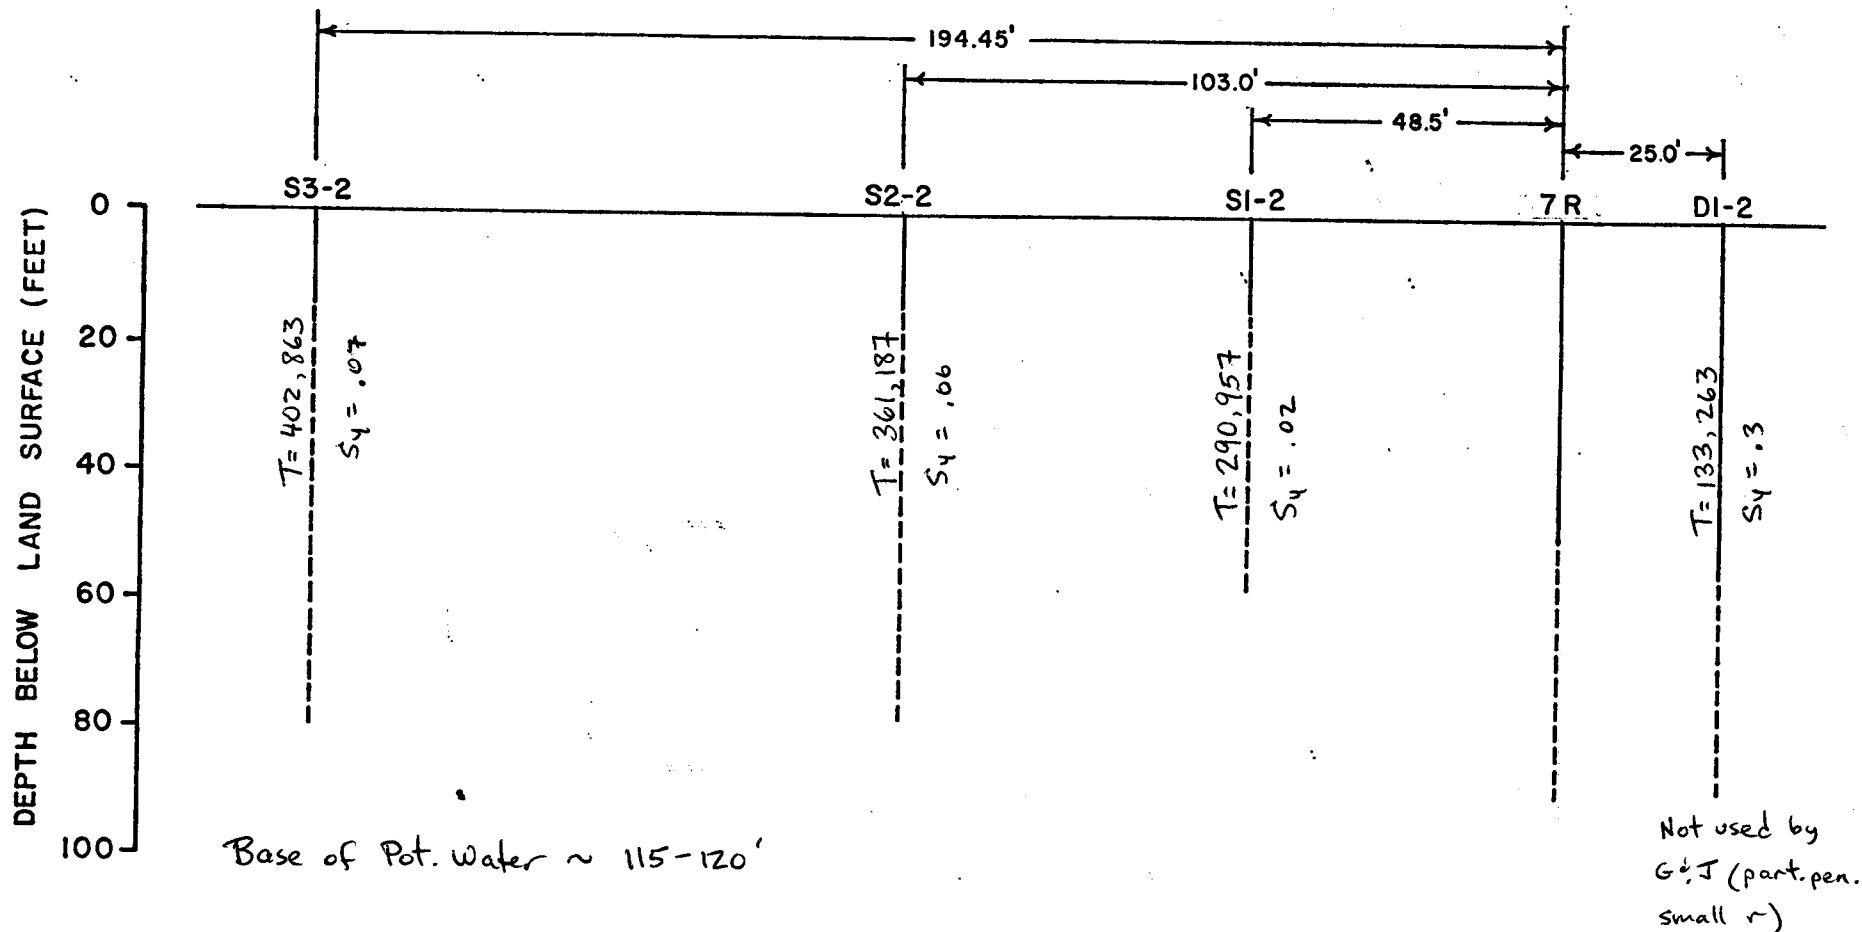

Boulton Analysis

$\bar{T} = 352,000 \text{ GPD/FT}$

$\bar{S} = .05$

LEGEND

S2-2 WELL NO.

CASED
INTERVAL

SCREENED
INTERVAL

$T = \text{GPD/FT}$

TEQUESTA

WELL FIELD 2

AQUIFER TEST WELL CONFIGURATION

$Q = 457 \text{ g.p.m.}$

72 hour test





FIGURE 6.1

DEPTH BELOW LAND SURFACE (FEET)
0
20
40
60
80
100
120
140
160

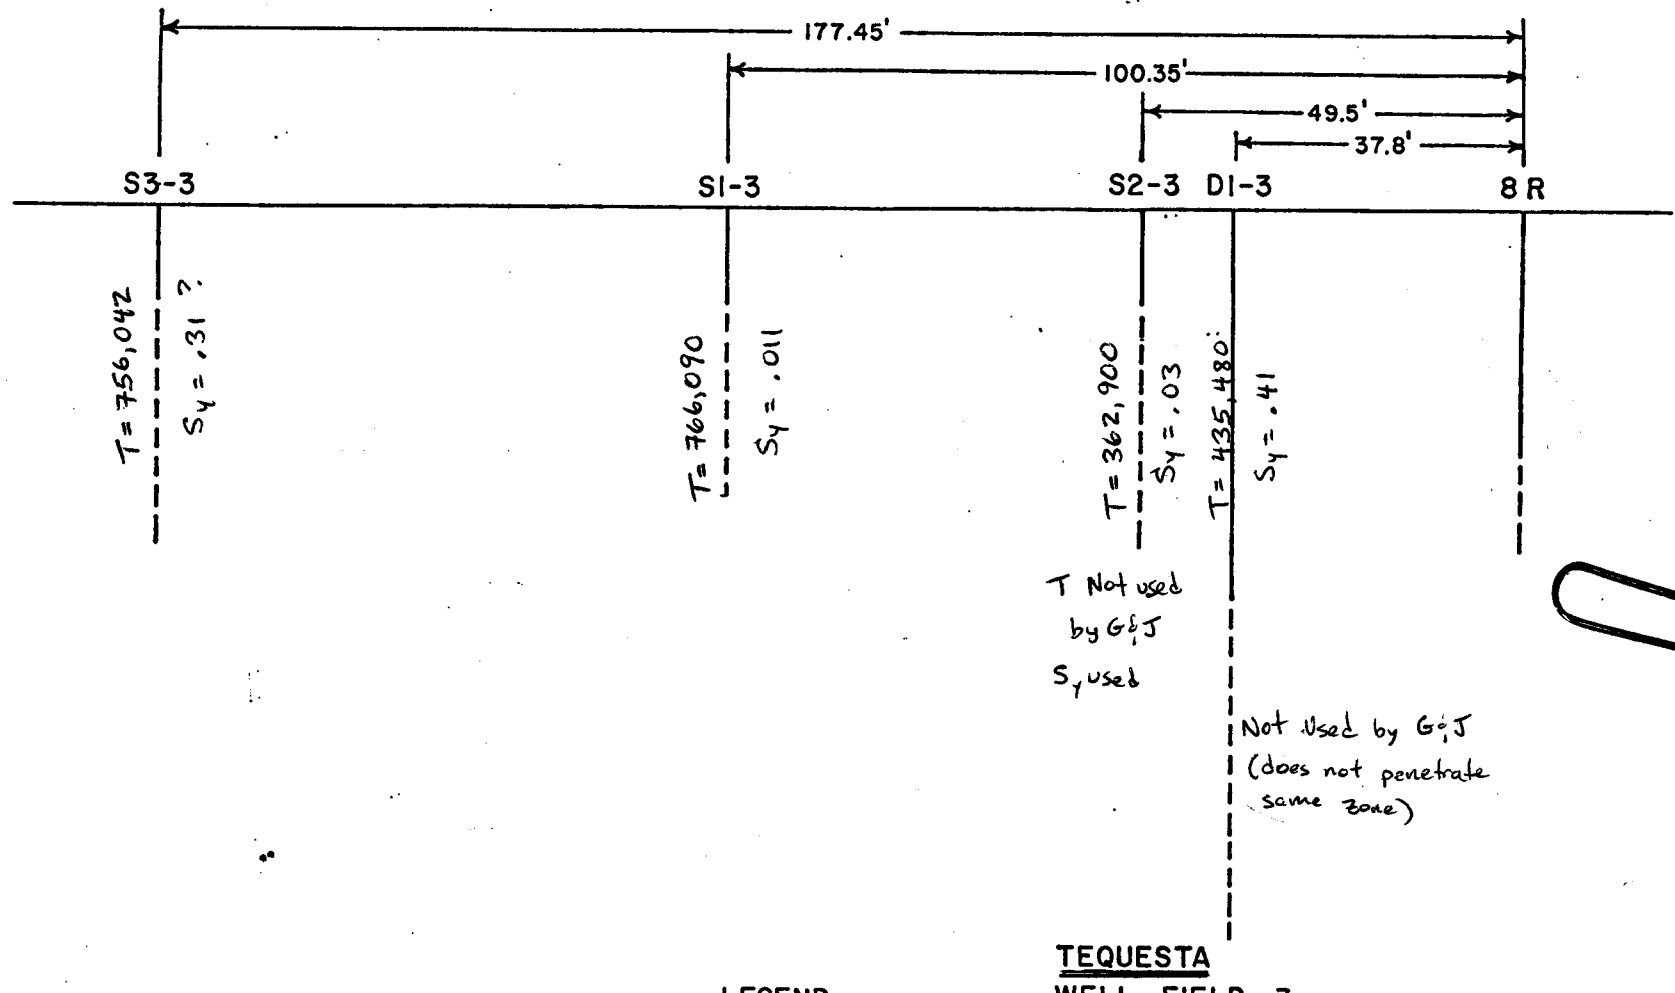


Boulton Analysis
 $\bar{T} = 760,000 \text{ GPD/FT}$
 $S_y = .026$

LEGEND
 S2-3 WELL NO.
 ——— CASED INTERVAL
 - - - SCREENED INTERVAL
 T = GPD/FT

TEQUESTA
WELL FIELD 3
AQUIFER TEST WELL CONFIGURATION
 $Q = 950 \text{ g.p.m.}$
74 hour test

0 20 40
 FEET
 SCALE

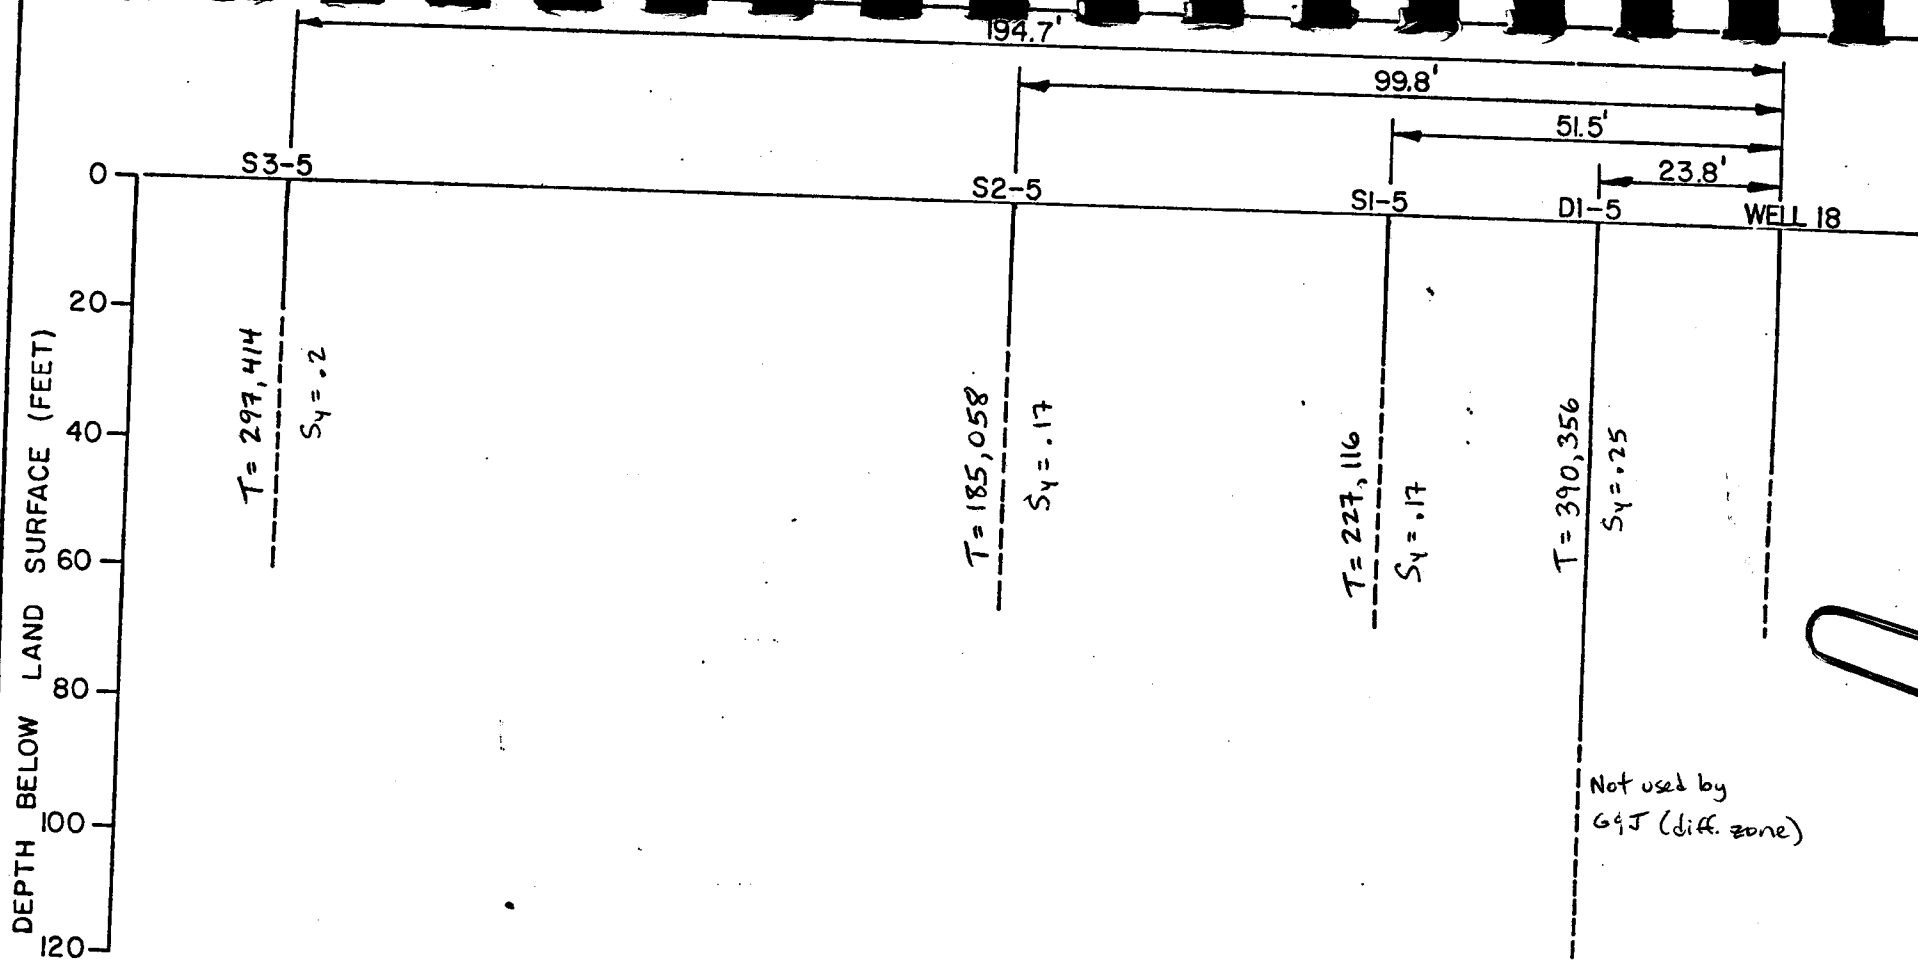

Boulton Analysis
 $T = 237,000 \text{ GPD/FT}$
 $S_y = .18$

LEGEND
 S2-5 WELL NO.
 CASED INTERVAL
 SCREENED INTERVAL
 $T = \text{GPD/FT}$

WELLFIELD 5
AQUIFER TEST WELL CONFIGURATION
 $Q = 218 \text{ g.p.m.}$
 36 hour test
 FEET
 0 20 40
 SCALE

FIGURE 615

JOB NO. 78-224

GEE & JENSON ENGINEERS-ARCHITECTS-PLANNERS, INC.
 WEST PALM BEACH, FLORIDA



WELL CONSTRUCTION

Well No. 7R
Driller: Drilling Services Inc.
Samples: Cuttings X, Core _____
Casing: Depth 0-50 feet
Diameter Inner: 10 inch
Outer: 16 inch
Material Inner: PVC Schedule 40
Outer: Steel Casing

Location: Wellfield No. 2
Recorded by: RW
Date Drilled: 7/22/80 to 7/30/80
Screen: Depth 50-90 feet
Diameter 8 inch
Material 100 slot telescopic
PVC

DEPTH BELOW
LAND SURFACE
(FEET)

LITHOLOGY DESCRIPTION

- 0-5 Sand: silica, white, medium to fine grained subrounded to subangular, unconsolidated.
- 5-25 Sand: silica, white and orange-brown, medium to fine grained, subrounded to subangular, with shell fragments, color getting lighter with depth, unconsolidated.
- 25-35 Sand: silica, white to light tan, fine to very fine grained, subrounded to subangular, unconsolidated.
- 35-41 Sand: silica, white to light tan, fine grained, subrounded to subangular, with shell fragments, unconsolidated.
- 41-83 Limestone: biosparite, white, gray and tan, coarse to fine grained, with shell fragments.
- 83-90 Shell: fragmental, light to dark gray, 50 percent.
Sand: silica, fine to medium grained, subrounded to subangular, unconsolidated, 50 percent.



WELL CONSTRUCTION

Well No. <u>8R</u>	Location: <u>Wellfield No. 3</u>
Driller: <u>Drilling Services, Inc.</u>	Recorded by: <u>RW</u>
Samples: Cuttings <u>X</u> , Core <u> </u>	Date Drilled: <u>6/17/80 to 6/28/80</u>
Casing: Depth <u>0-50 feet</u>	Screen: Depth <u>50-70 feet</u>
Outer: <u>16 inch</u>	Diameter <u>8 inch</u>
Diameter Inner: <u>10 inch</u>	Material <u>100 slot telescopic</u>
Outer: <u>Steel Casing</u>	<u>PVC</u>
Material Inner: <u>PVC Schedule 40</u>	

DEPTH BELOW
LAND SURFACE
(FEET)

LITHOLOGY DESCRIPTION

0-8	Sand: silica, white and gray, medium to fine grained subangular to subrounded, unconsolidated.
8-39	Sand: silica, white and tan, medium to fine grained, subrounded to subangular, unconsolidated.
39-70	Limestone: biosparite, trace of sand, coarse to fine grained with shell fragment, hard and soft layers.



WELL CONSTRUCTION

Well No. D1-4 Location: Wellfield No. 4
 Driller: Drilling Services Inc. Recorded by: JE
 Samples: Cuttings X, Core _____ Date Drilled: 5/16/80
 Casing: Depth 0-80 feet Screen: Depth 80-145 feet
 Diameter 2 inch Diameter 2 inch
 Material Schedule 40 PVC Material 40 Slot PVC

DEPTH BELOW
LAND SURFACE
(FEET)

LITHOLOGY DESCRIPTION

0-7 Sand: silica, white, very fine to medium grained, rounded to subrounded, trace very fine heavy minerals, unconsolidated.

7-36 Sand: silica, light orange-brown (iron stain), very fine to coarse grained, predominantly fine to medium grained, rounded to subrounded, trace of very fine heavy minerals, in upper 10 feet thin beds of orange silty sand, slightly cemented, unconsolidated.

36-42 Limestone: biosparite, very light brown to tan, abundant silica sand, trace shell fragments and oolites, weathered zone, consolidated, poorly lithified.

42-57 Limestone: biointrasparite, very light brown-gray, abundant shell and oolites, well lithified to poorly lithified in 0.5 to 1 foot seams.

57-73 Limestone: biosparite, dolomitic, dark brown, large shell fragments, trace silica, well lithified.

73-80 Limestone: biosparite, very light brownish gray, shells and oolites, sandy, well lithified to poorly lithified in 0.5 to 1.0 foot seams.

80-90 Limestone: biosparite, light grayish brown to light brownish gray, cemented shell and fragments, well lithified to friable, 80 percent.

Shell: unconsolidated, fine to medium grained whole and fragmental pelecypods, 20 percent.



WELL CONSTRUCTION

Well No. D1-4 (Cont'd) Location: Wellfield No. 4
Driller: Drilling Services, Inc. Recorded by: JE
Samples: Cuttings X, Core _____ Date Drilled: 5/16/80
Casing: Depth 0-80 feet Screen: Depth 80-145 feet
Diameter 2 inch Diameter 2 inch
Material Schedule 40 PVC Material 40 Slot PVC

DEPTH BELOW
LAND SURFACE
(FEET)

LITHOLOGY DESCRIPTION

90-110 Shell: fragmental and whole shell (pelecypod, Turitella sp. and Oliva sp. gastropod, 50 percent.
Sand: silica, light gray, very fine to medium grained, rounded to subrounded, trace of heavy minerals, trace of calcareous silty clay, 50 percent.

110-115 Shell and Sand: same as 90-110, but with a trace of poorly lithified biosparite and minor gray-green soft silty clay.

115-125 Limestone: biomicrite, light brownish gray to light brown, trace of heavy minerals present, unconsolidated shells and shell fragments, trace of very fine to medium grained silica sand, well lithified to poorly lithified thin seams.

125-130 Limestone: same as 115-125, but with an increase in silica sand.

130-135 Shell and Sand: same as 90-110.

135-137 Silty Clay: dark green, soft, trace of sand to pebble sized phosphatic shell and particles, unconsolidated.

137-146 Limestone: light gray brown, possibly dolomitic, honeycombed, trace of dark green clay, lithified to poorly lithified.



WELL CONSTRUCTION

Well No. D1-5
Driller: Drilling Services Inc.
Samples: Cuttings X, Core _____
Casing: Depth 0-80 feet
Diameter 2 inch
Material Schedule 40 PVC

Location: Wellfield No. 5
Recorded by: JE
Date Drilled: 5/13/80
Screen: Depth 80-120 feet
Diameter 2 inch
Material 40 Slot PVC

DEPTH BELOW
LAND SURFACE
(FEET)

LITHOLOGY DESCRIPTION

- 0-7 Sand: silica, white, very fine to coarse grained, rounded to subrounded, trace heavy minerals, unconsolidated.
- 7-35 Sand: silica, light brown-orange (iron-stain), very fine to coarse, rounded to subrounded, trace heavy minerals, thin layers dark orange silty sand, slightly cemented in upper part, medium to coarse grained near bottom, unconsolidated.
- 35-57 Limestone: biosparite, very light brown cream, uniform cuttings, abundant silica sand and shell fragments, lithified.
- 57-65 Limestone: biosparite, very light brown cream, very fine to 10 mm pelecypod fragments, well lithified.
- 65-85 Limestone: biointrasparite, very light tan, abundant interbedded silica, inclusions of gray-green silty clay, abundant shell fragments, lithified.
- 85-90 Limestone: as 65-85 feet, but with 20-30 percent biomicrite, gray, dense, fine grained.
- 90-115 Limestone: biointrasparite, very light tan, interbedded silica, partial dolomite replacement, poorly lithified, 50 percent.
Limestone: biointramicrite, gray, very fine grained, poorly lithified, 50 percent.
- 115-120 Limestone: micrite, brown, fossiliferous, porous, dolomitic, abundant pelecypod fragments, trace of silica, lithified.



WELL CONSTRUCTION

Well No. D2-5 Location: Wellfield No. 5
Driller: Drilling Services Inc. Recorded by: RW
Samples: Cuttings X, Core _____ Date Drilled: 7/17/80
Casing: Depth 0-40 feet Screen: Depth 40-180 feet
Diameter 2 inch Diameter 2 inch
Material Schedule 40 PVC Material 40 Slot PVC

DEPTH BELOW
LAND SURFACE
(FEET)

LITHOLOGY DESCRIPTION

0-15 Sand: silica, yellow, medium to fine grained, subangular to subrounded, unconsolidated.

15-33 Sand: silica, white and brown, medium to fine grained, subangular to subrounded, unconsolidated.

33-70 Limestone: biosparite, tan and white, sand coarse to fine grained, subangular to subrounded, trace of shell fragments, lithified.

70-79 Sand: silica, white and brown, medium to silt grained, subangular to subrounded, abundant shell fragments, unconsolidated.

79-100 Limestone: biointrasparite, gray-brown and white, with silica sand layers, medium to silt grained, with abundant shell fragments, lithified.

100-110 Limestone: biointrasparite, dark brown to gray and white, with shell and shell fragments, abundant silica sand, with medium to silt sized grains, hard and soft layers, lithified to consolidated.

110-115 Limestone: biointrasparite, tan, soft, abundant fine grained unconsolidated silica sand, poorly lithified.

115-138 Limestone: biointrasparite, brown to tan, trace of silica sand and shell fragments, lithified.

138-145 Limestone: biointrasparite, dark gray to tan, trace of silica sand and tan silty clay, lithified.



WELL CONSTRUCTION

Well No. <u>D2-5 (Cont'd)</u>	Location: <u>Wellfield No. 5</u>
Driller: <u>Drilling Services Inc.</u>	Recorded by: <u>RW</u>
Samples: Cuttings <u>X</u> , Core _____	Date Drilled: <u>7/17/80</u>
Casing: Depth <u>0-40 feet</u>	Screen: Depth <u>40-180 feet</u>
Diameter <u>2 inch</u>	Diameter <u>2 inch</u>
Material <u>Schedule 40 PVC</u>	Material <u>40 Slot PVC</u>

DEPTH BELOW
LAND SURFACE
(FEET)

LITHOLOGY DESCRIPTION

145-170	Limestone: biointrasparite, tan to gray, lithified, 50 percent. Sand: silica, coarse to silt sized grains, sub-angular to subrounded, 20 percent.
145-170	Shell: fragmental and whole, 30 percent.
170-180	Limestone: biointrasparite, tan, lithified, 50 percent. Shell: fragmental and whole, with abundant silica sand, 50 percent.



WELL CONSTRUCTION

Well No. D3-5 Location: Wellfield No. 5
Driller: Drilling Services Inc. Recorded by: RW
Samples: Cuttings X, Core _____ Date Drilled: 8/25/80
Casing: Depth 0-100 feet Screen: Depth 100-178 feet
Diameter 2 inch Diameter 2 inch
Material Schedule 40 PVC Material 40 Slot PVC

DEPTH BELOW
LAND SURFACE
(FEET)

LITHOLOGY DESCRIPTION

0-25 Sand: silica, light brownish orange, fine to very fine grained, subangular to angular, unconsolidated.

25-42 Sand: silica, light brownish orange, medium to fine grained, subrounded to rounded, trace of white and brown shell fragments, unconsolidated.

42-70 Limestone: biosparite, tan, trace of white shell fragments, well lithified.

70-105 Limestone: biointrasparite, light brown abundant very fine grained shell fragments, trace of fine grained silica, possible dolomitization, well lithified.

105-120 Limestone: biointrasparite, very light tan, abundant white fine grained shell fragments, trace of fine grained silica sand, well lithified.

120-130 Limestone: biointrasparite, light gray, with abundant fragmented white and tan pelecypods, trace of fine grained phosphate, lithified.

130-140 Sand: carbonate, very light gray, very fine to silt sized grains, unconsolidated.

140-170 Limestone: biointrasparite, gray, friable and very sandy, with white pelecypod fragments, abundant fine grained silica, abundant phosphate particles, consolidated.

170-180 Limestone: Same as 140-170, but with abundant gray silty clay, consolidated.



WELL CONSTRUCTION

Well No. RD-1
Driller: Drilling Services, Inc.
Samples: Cuttings X, Core _____
Casing: Depth 0-20 feet
Diameter 2 inch
Material Schedule 40 PVC

Location: Tequesta (Riverside Drive)
Recorded by: RW
Date Drilled: 8/27/80
Screen: Depth 20-178.5 feet
Diameter 2 inch
Material 40 Slot PVC

DEPTH BELOW
LAND SURFACE
(FEET)

LITHOLOGY DESCRIPTION

0-30 Sand: silica, light brown, fine to very fine grained, angular to subrounded, unconsolidated.

30-35 Limestone: sorted biosparite, very light brown, abundant pelecypods, well lithified.

35-65 Shell: white, whole and fragmental pelecypods, abundant large well-rounded pelecypod fragments, unconsolidated, 70 percent.

65-70 Sand: silica, very light brown, fine to very fine grained, unconsolidated, 30 percent.

70-95 Limestone: unsorted biosparite, light gray, lithified.

95-110 Shell and Sand: same as 35-65 feet, but with thin biosparite limestone stringers, lithified.

110-120 Shell and Sand: same as 35-65 feet, but with shell fragments ranging in color from light brown to dark gray.

120-130 Sand: silica, very light gray, very fine to silt sized grains, abundant fine grained carbonates, unconsolidated.

130-140 Shell and Sand: same as 95-110 feet.

140-175 Sand: same as 110-120 feet, but with fine grained carbonates increasing to 25 percent.

175-180 Limestone: micrite, light gray to very light gray, trace of pelecypod fragments from 140-145 feet, poorly consolidated.

Silty Clay: light gray, poorly consolidated.



WELL CONSTRUCTION

Well No. S1-4 Location: Wellfield No. 4
Driller: Drilling Services Inc. Recorded by: RW
Samples: Cuttings X, Core Date Drilled: 6/17/80
Casing: Depth 0-15 feet Screen: Depth 15-65 feet
Diameter 2 inch Diameter 2 inch
Material Schedule 40 PVC Material 40 Slot PVC

DEPTH BELOW LAND SURFACE (FEET)

LITHOLOGY DESCRIPTION

- 0-10 Sand: silica, white, medium to fine grained, subangular to subrounded, unconsolidated.
10-32 Sand: silica, white, tan and orange, medium to fine grained, subangular to subrounded, unconsolidated.
32-50 Limestone: biosparite, white to tan, coarse to fine grained, subangular to subrounded, with white unconsolidated shell fragments, lithified.
50-60 Limestone: biosparite, gray to tan, medium to very fine grained, with shell fragments, lithified.
60-65 Limestone: biosparite, dark brown, trace tan silty clay, trace shell fragments, trace fine to medium grained silica sand, lithified.



WELL CONSTRUCTION

Well No. <u>S3-3</u>	Location: <u>Wellfield No. 3</u>
Driller: <u>Drilling Services Inc.</u>	Recorded by: <u>RW</u>
Samples: Cuttings <u>X</u> , Core _____	Date Drilled: <u>7/31/80</u>
Casing: Depth <u>0-20 feet</u>	Screen: Depth <u>20-70</u>
Diameter <u>2 inch</u>	Diameter <u>2 inch</u>
Material <u>PVC Schedule 40</u>	Material <u>40 slot PVC</u>

DEPTH BELOW
LAND SURFACE
(FEET)

LITHOLOGY DESCRIPTION

0-10	Sand: silica, white to light tan, medium to fine grained, subangular to subrounded with shell fragments, unconsolidated.
10-37	Sand: silica, white to brown, medium to fine grained, subangular to subrounded with shell fragments, unconsolidated.
37-70	Limestone: biospartie, sand coarse to fine grained, subangular to subrounded with shell fragments, hard and soft layers, very loosely cemented.



WELL CONSTRUCTION

Well No. S3-5 Location: Wellfield No. 5
Driller: Drilling Services Inc. Recorded by: JE
Samples: Cuttings X, Core _____ Date Drilled: 5/7/80
Casing: Depth 0-20 feet Screen: Depth 20-60 feet
Diameter 2 inch Diameter 2 inch
Material Schedule 40 PVC Material 40 Slot PVC

DEPTH BELOW
LAND SURFACE
(FEET)

LITHOLOGY DESCRIPTION

0-8 Sand: silica, white, very fine to coarse grained, rounded to subrounded, trace heavy minerals, unconsolidated.


8-32 Sand: silica, light brownish orange (iron-stain) very fine to coarse grained, rounded to subrounded, trace heavy minerals, thin layers dark orange silty sand, slightly cemented in upper part, unconsolidated.

32-60 Limestone: biosparite, very light brown cream, uniform cuttings, trace of silica sand and shell fragments, well lithified.

WMD

TAPENO 6265 PLOT NO 0337
USER NO NELMS DATE 86/05/05


TIME 12:47

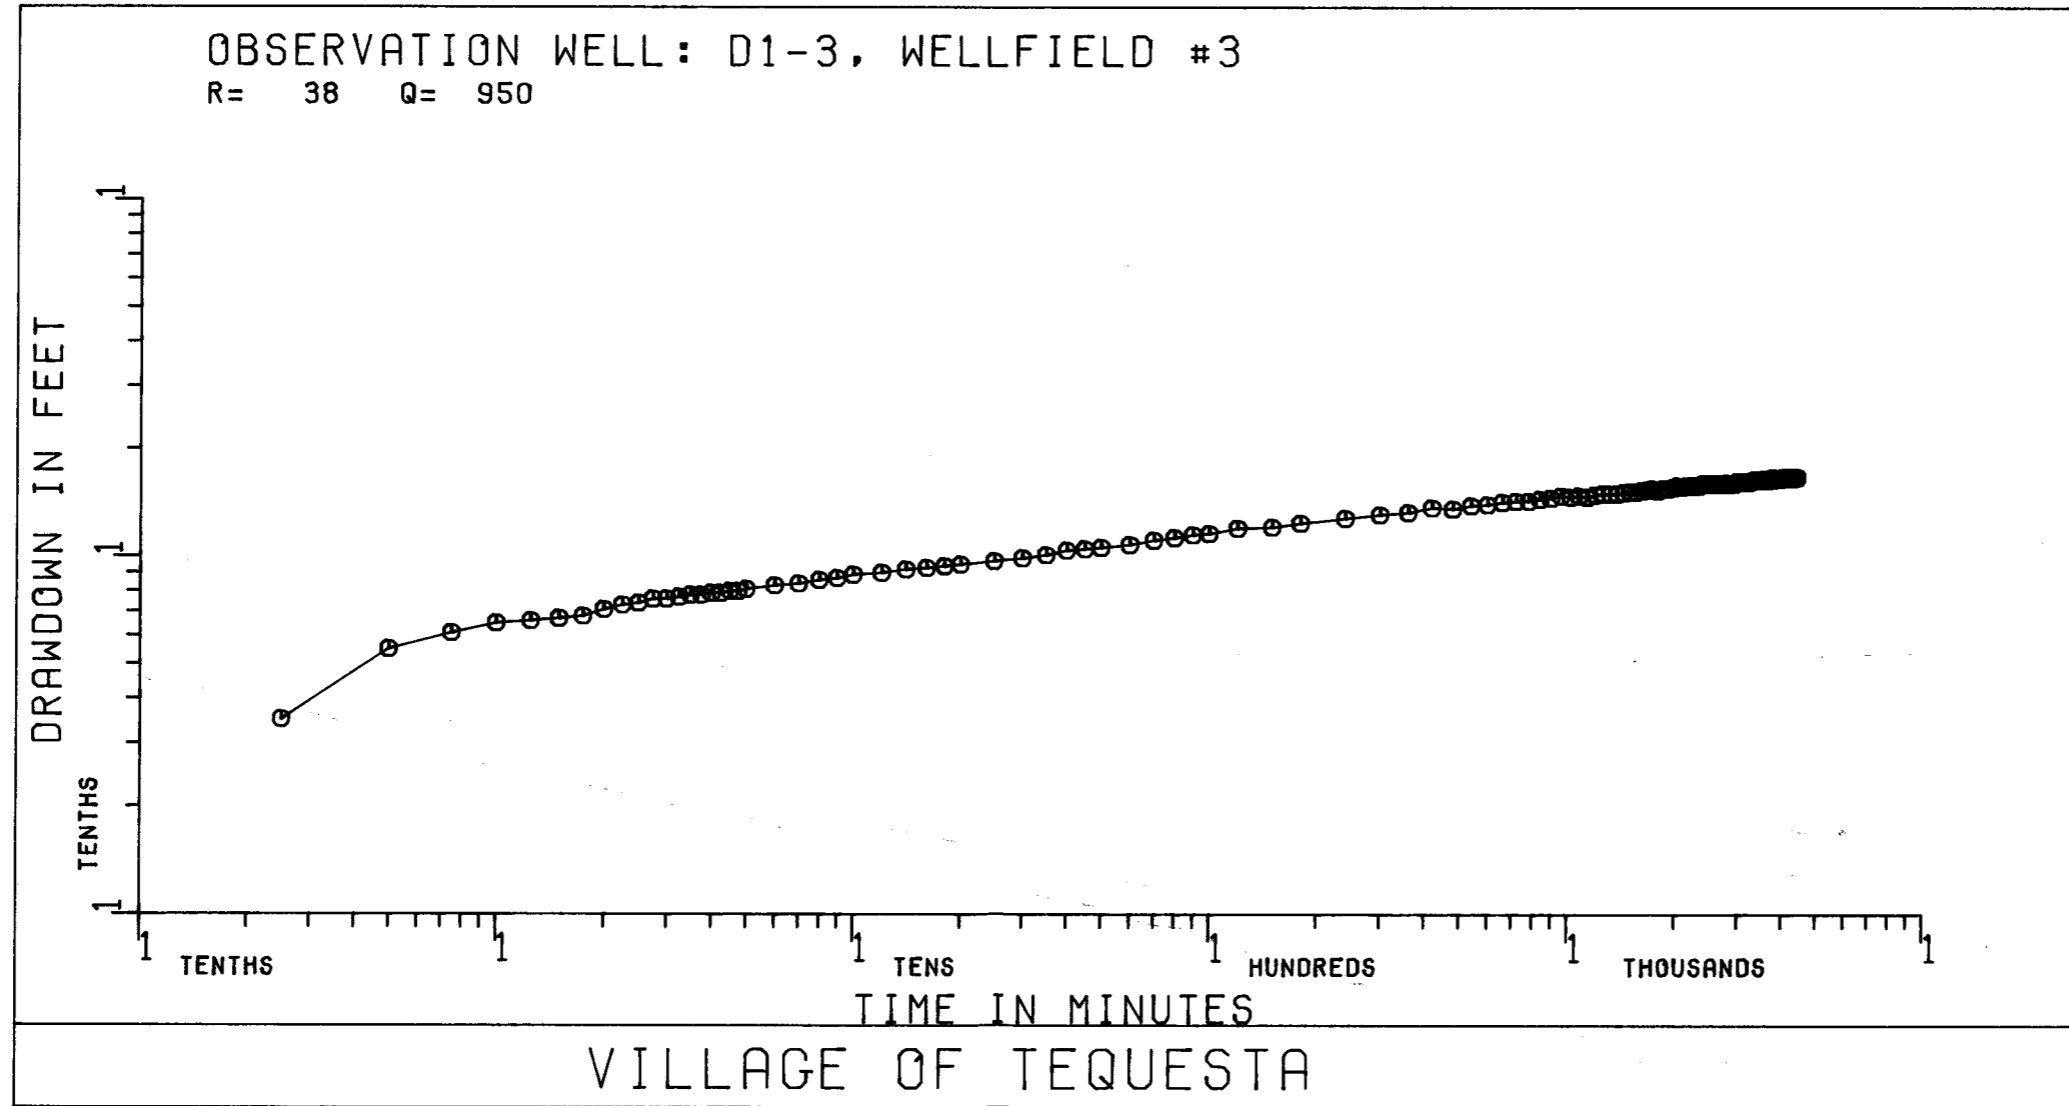

WMD

TAPENO 6265 PLOT NO 0352
USER NO NELMS DATE 86/05/05 TIME 12:52

M. M. M.

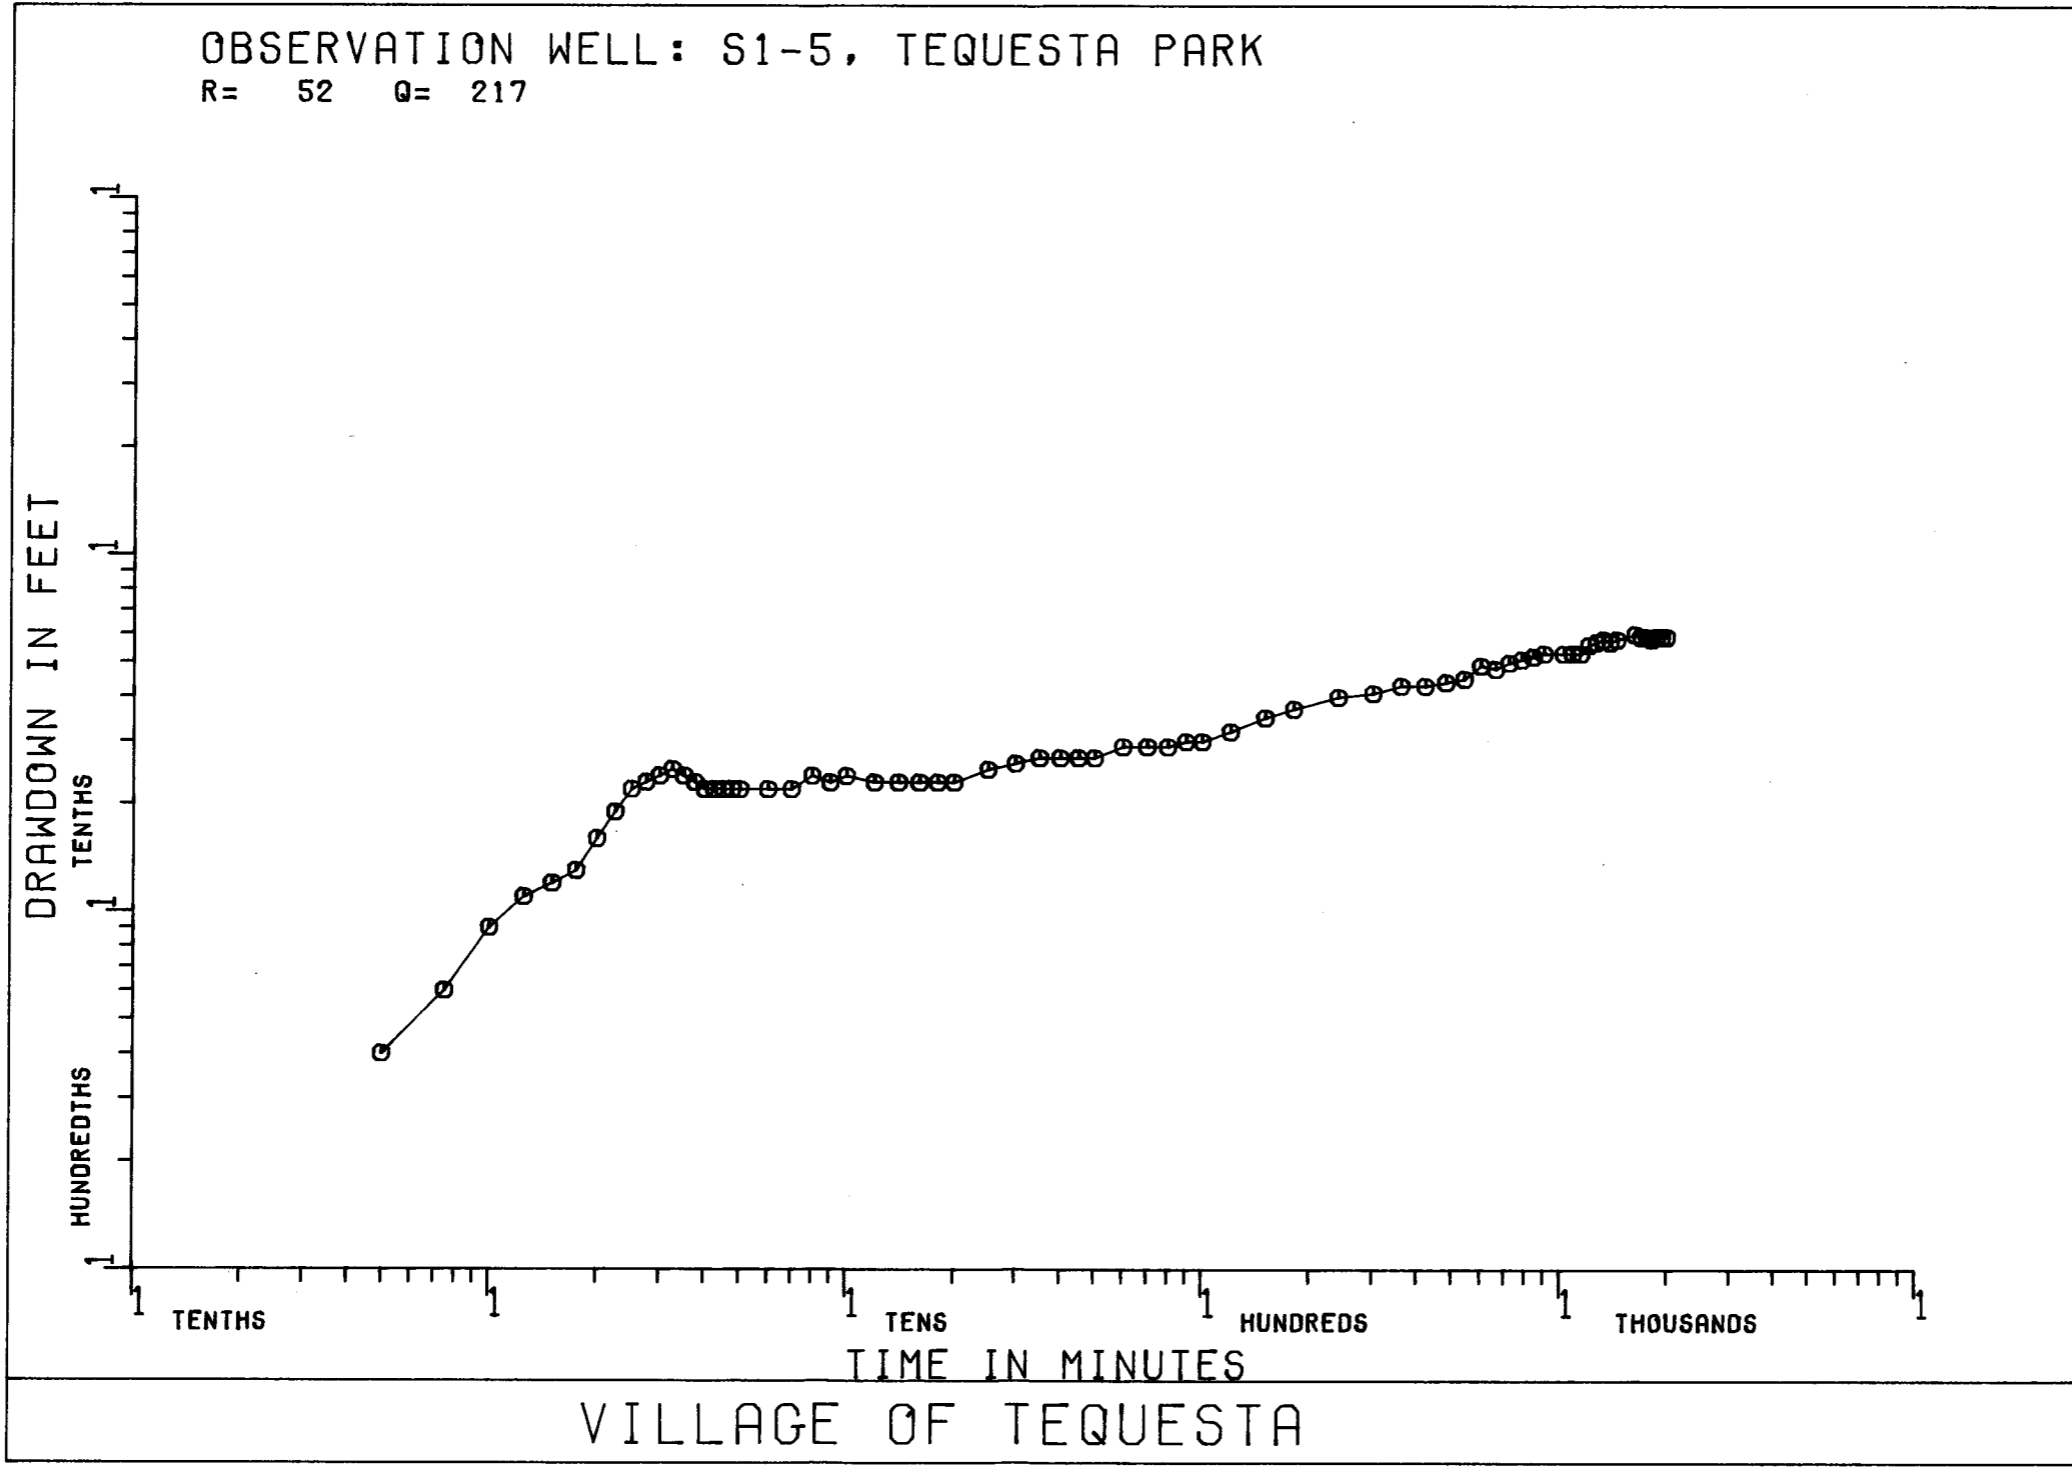


WMD

TAPENO 6265 PLOT NO 0343
USER NO NELMS DATE 86/05/05


TIME 12:49

no match

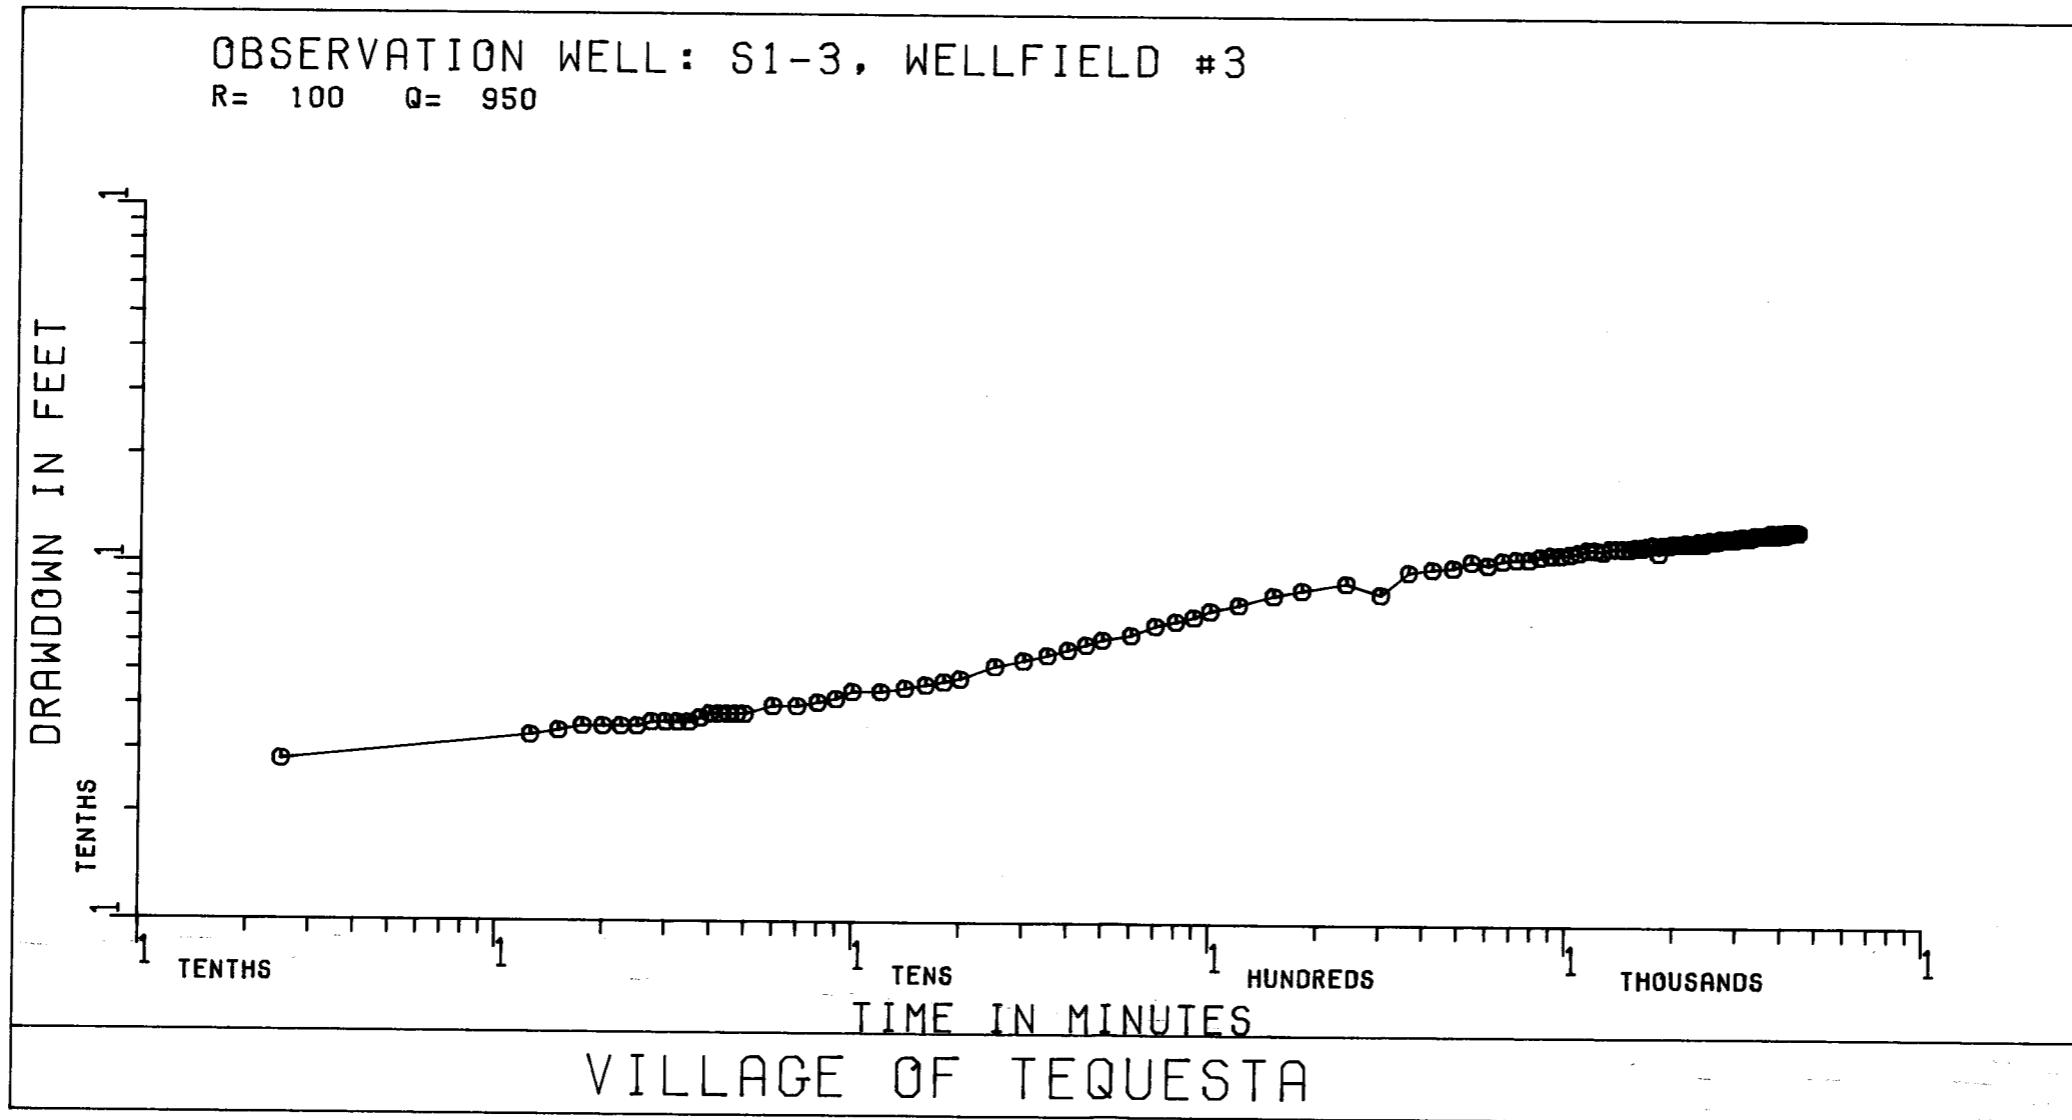

WMD

TAPENO 6153 PLOT NO 0040
USER NO NELMS DATE 86/04/24 TIME 16:20

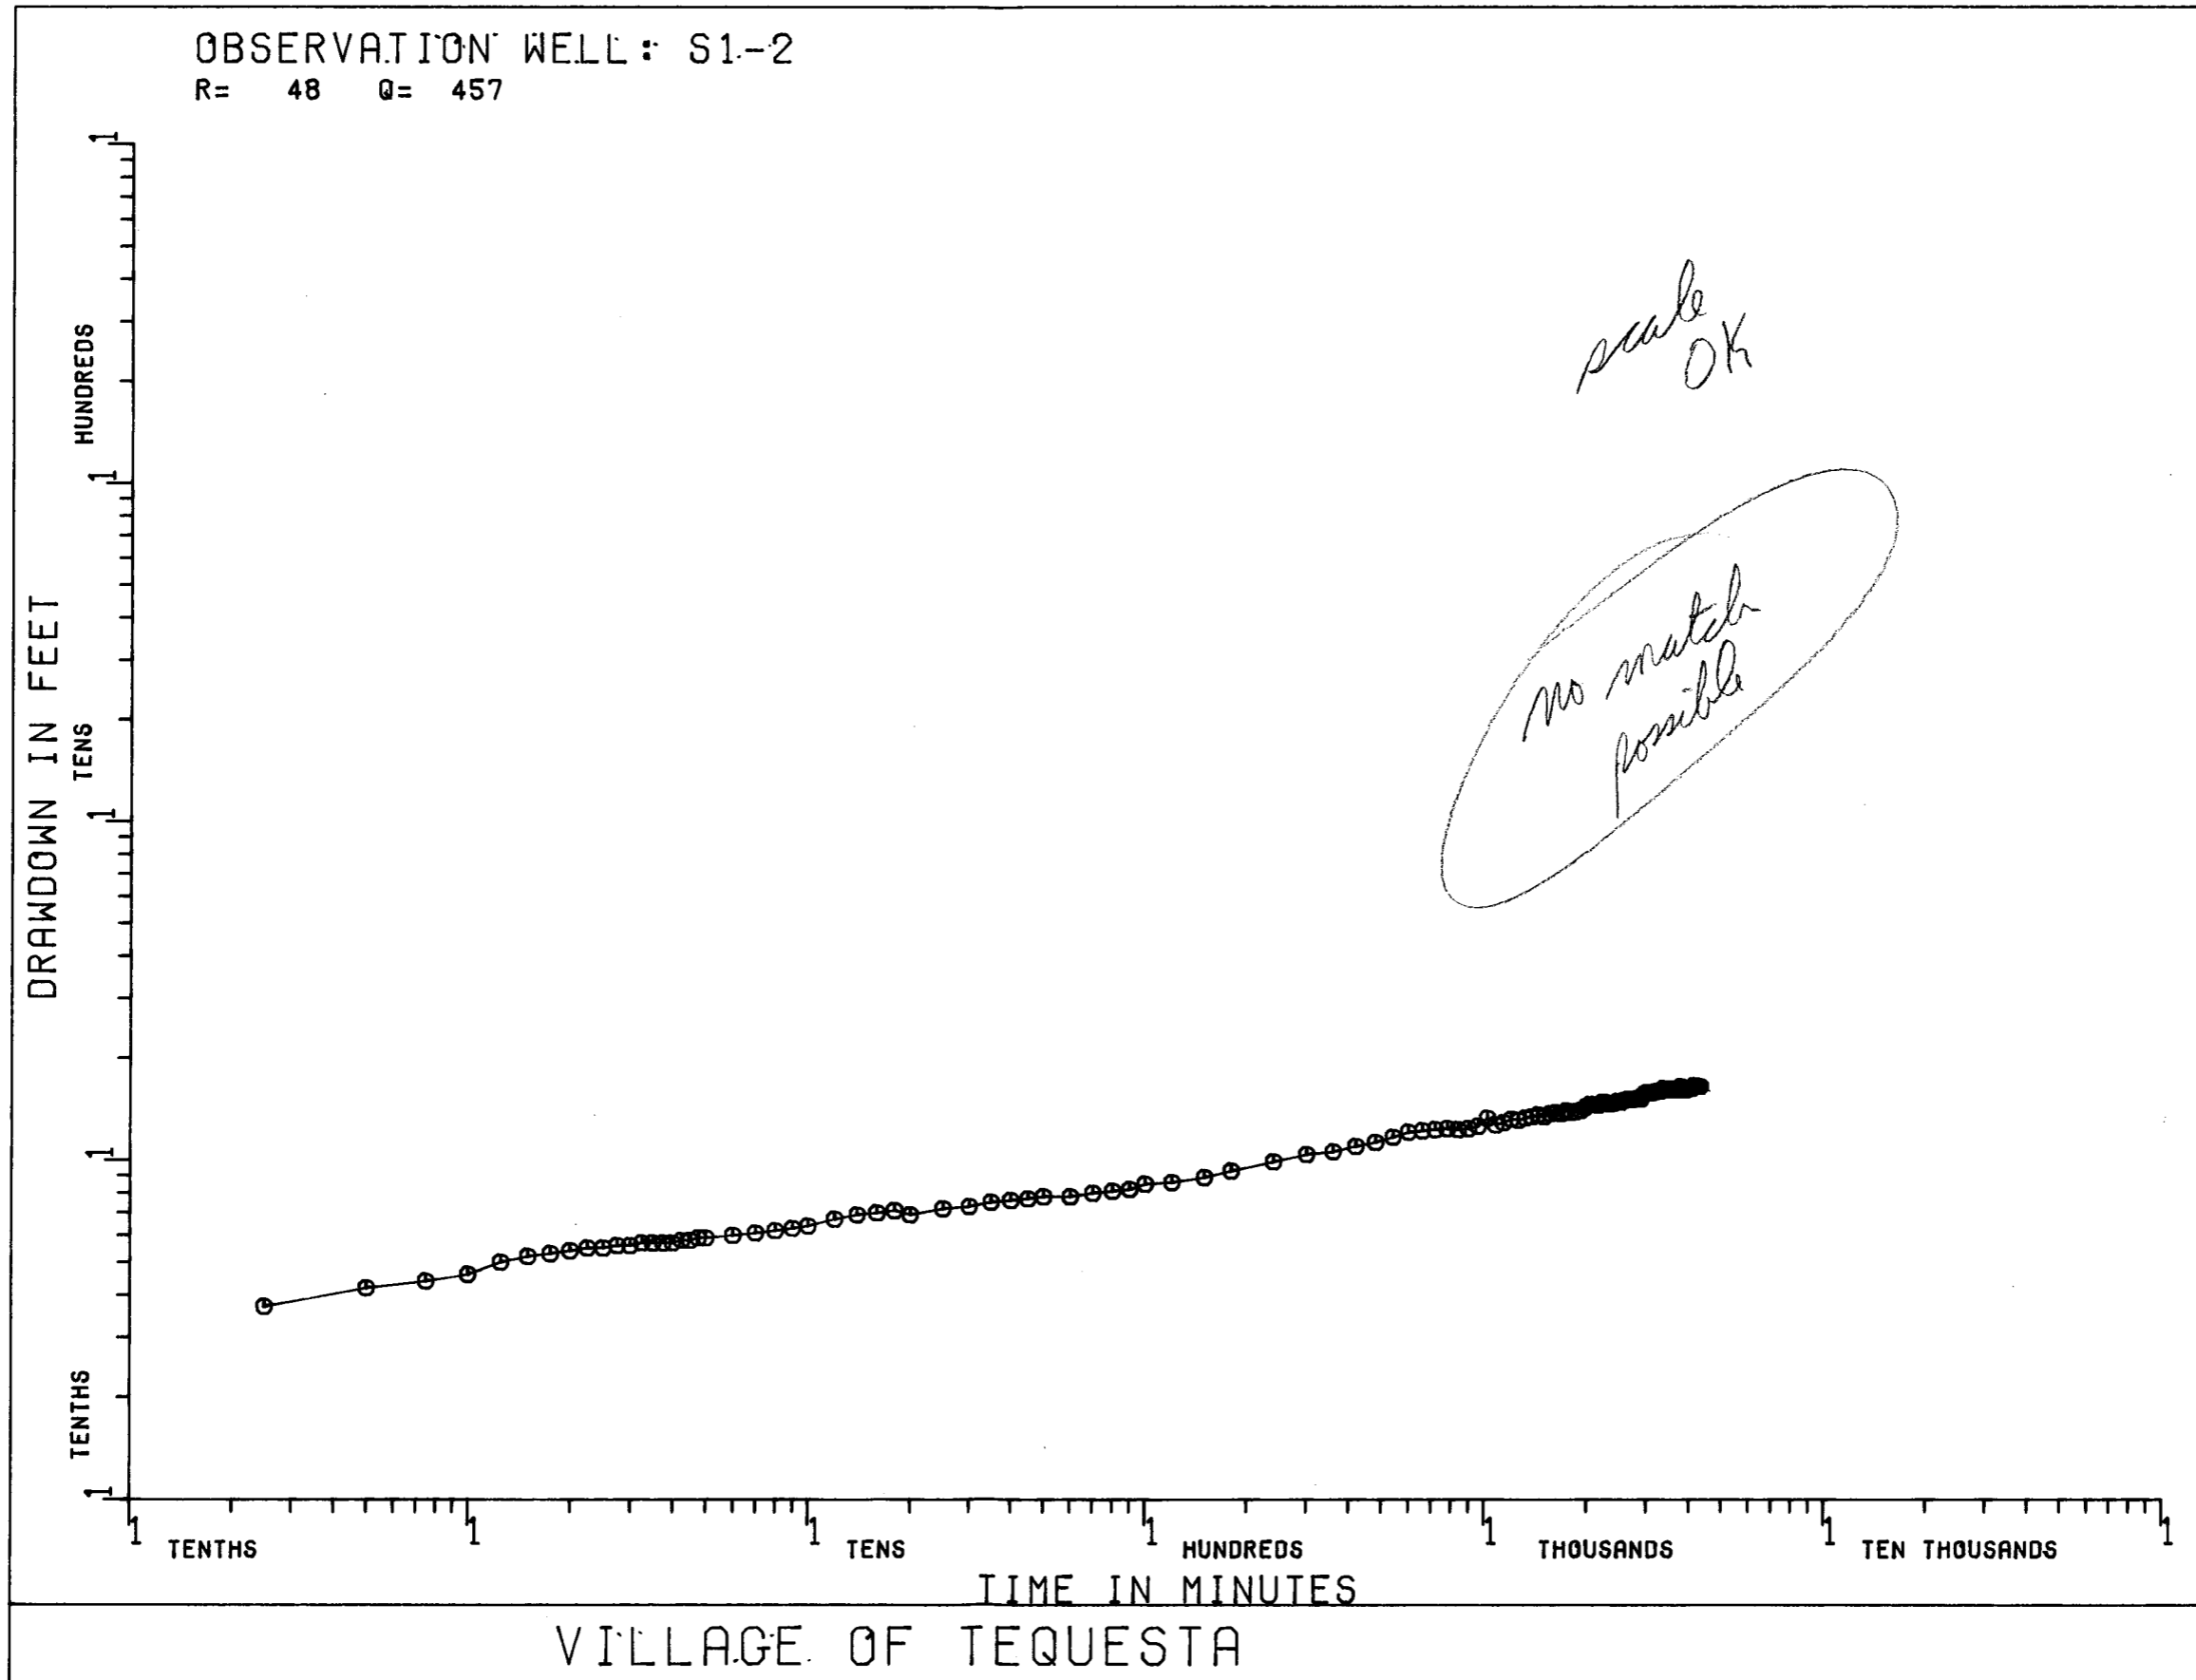

WMD


TAPENO 6265
USER NO NELMS

PLOT NO 0355

DATE 86/05/05

TIME 12:52


ms

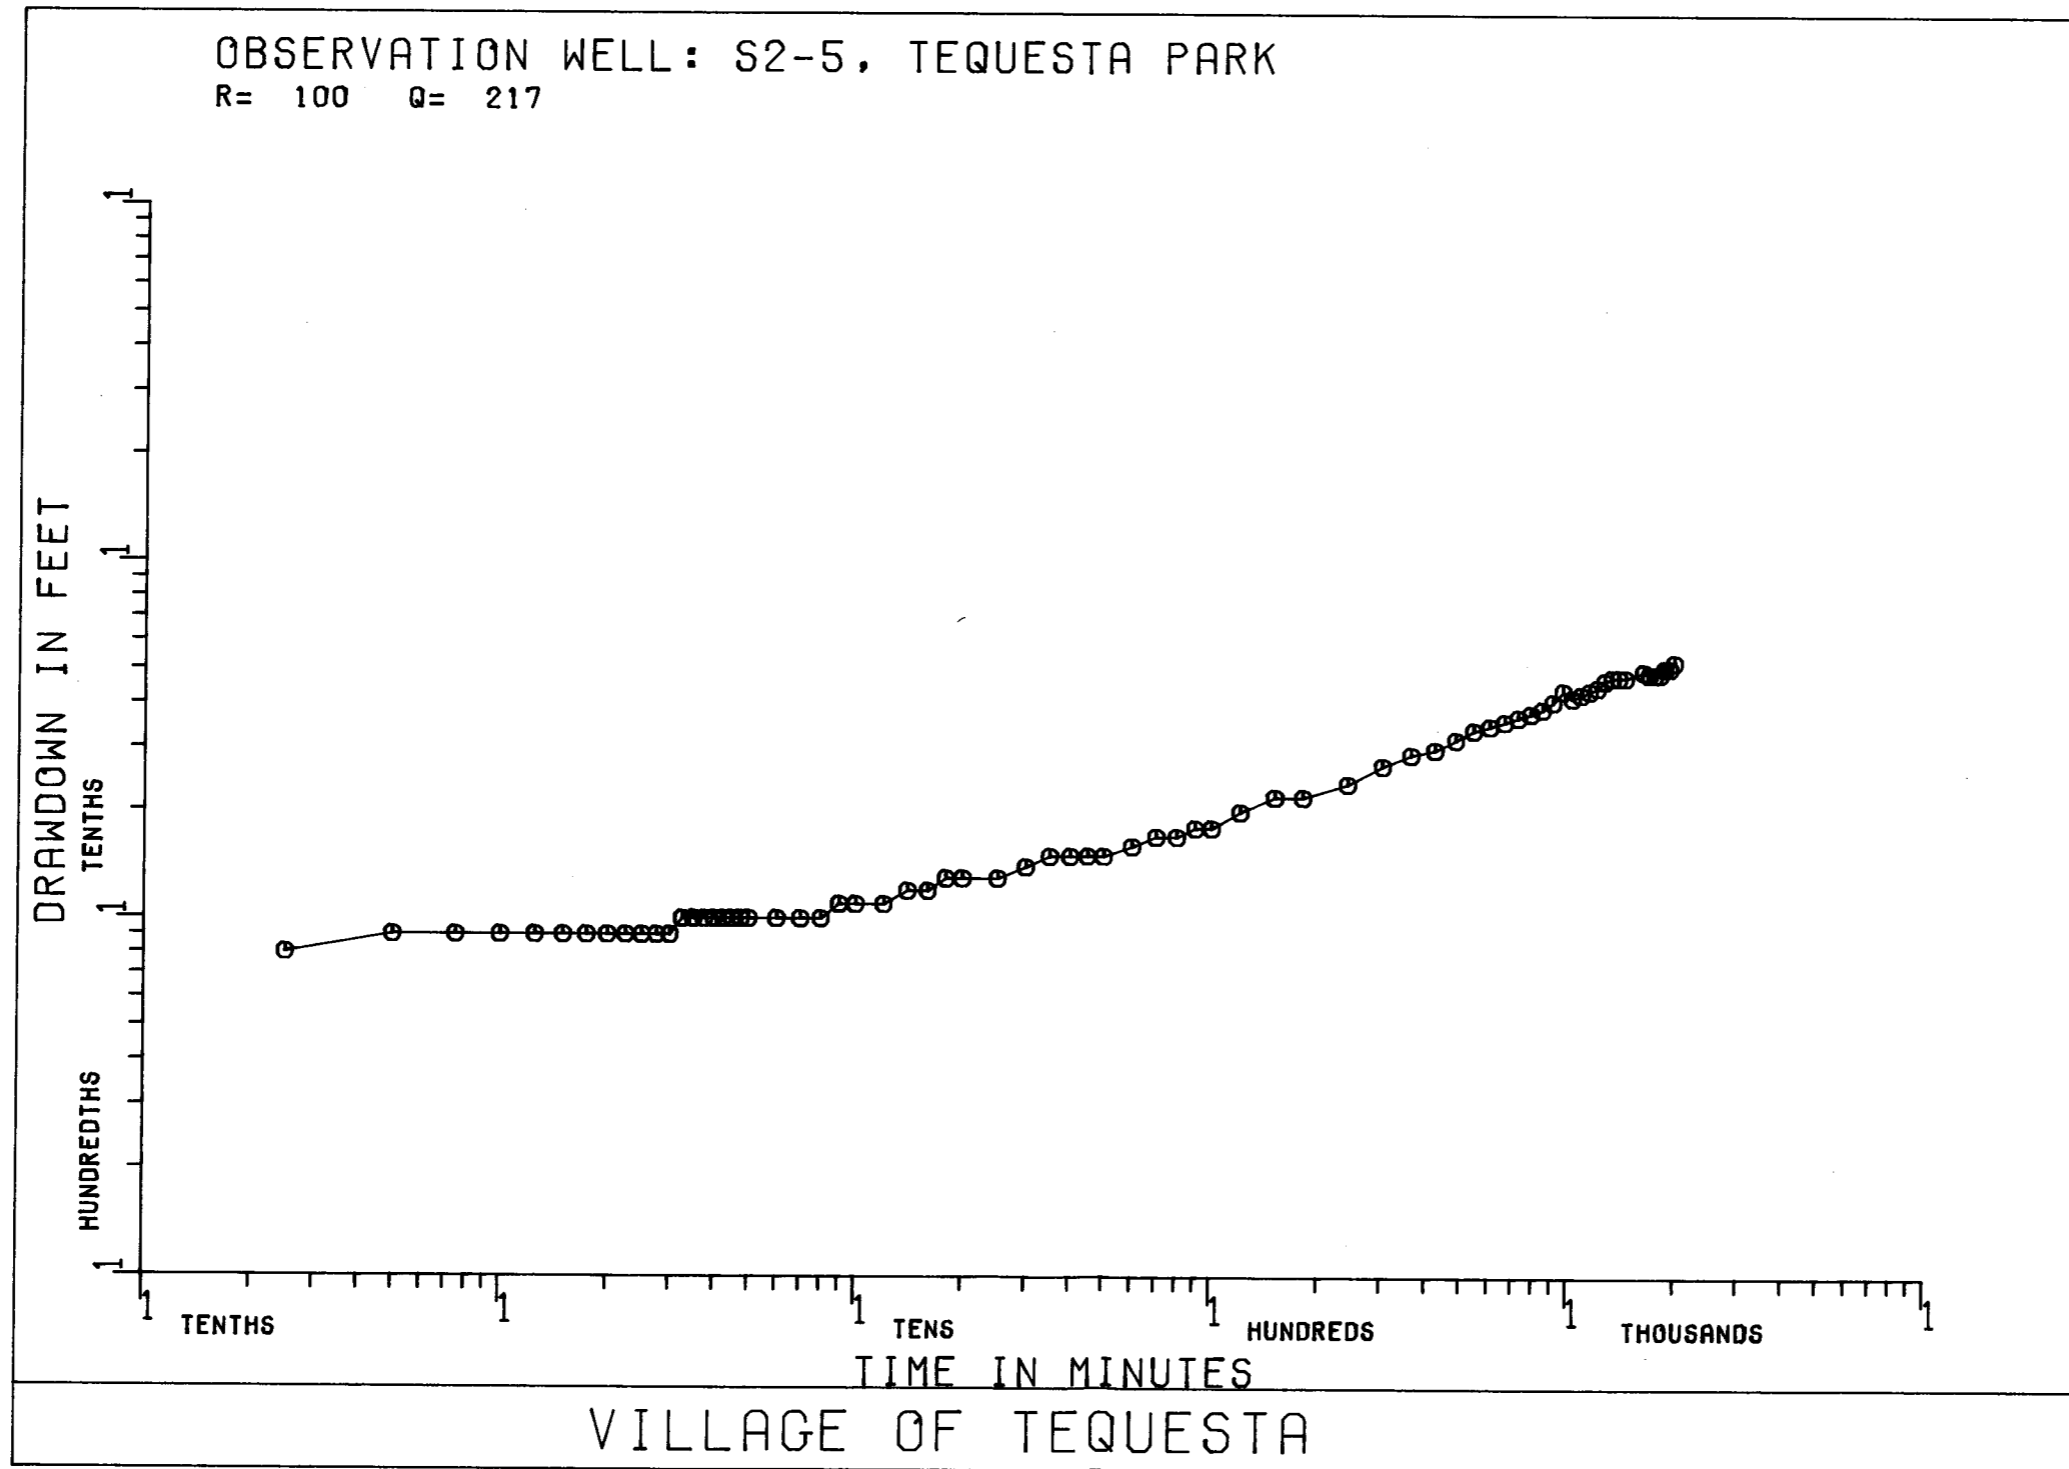

WMD

TAPENO 6265 PLOT NO 0346
USER NO NELMS DATE 86/05/05 TIME 12:49


no match

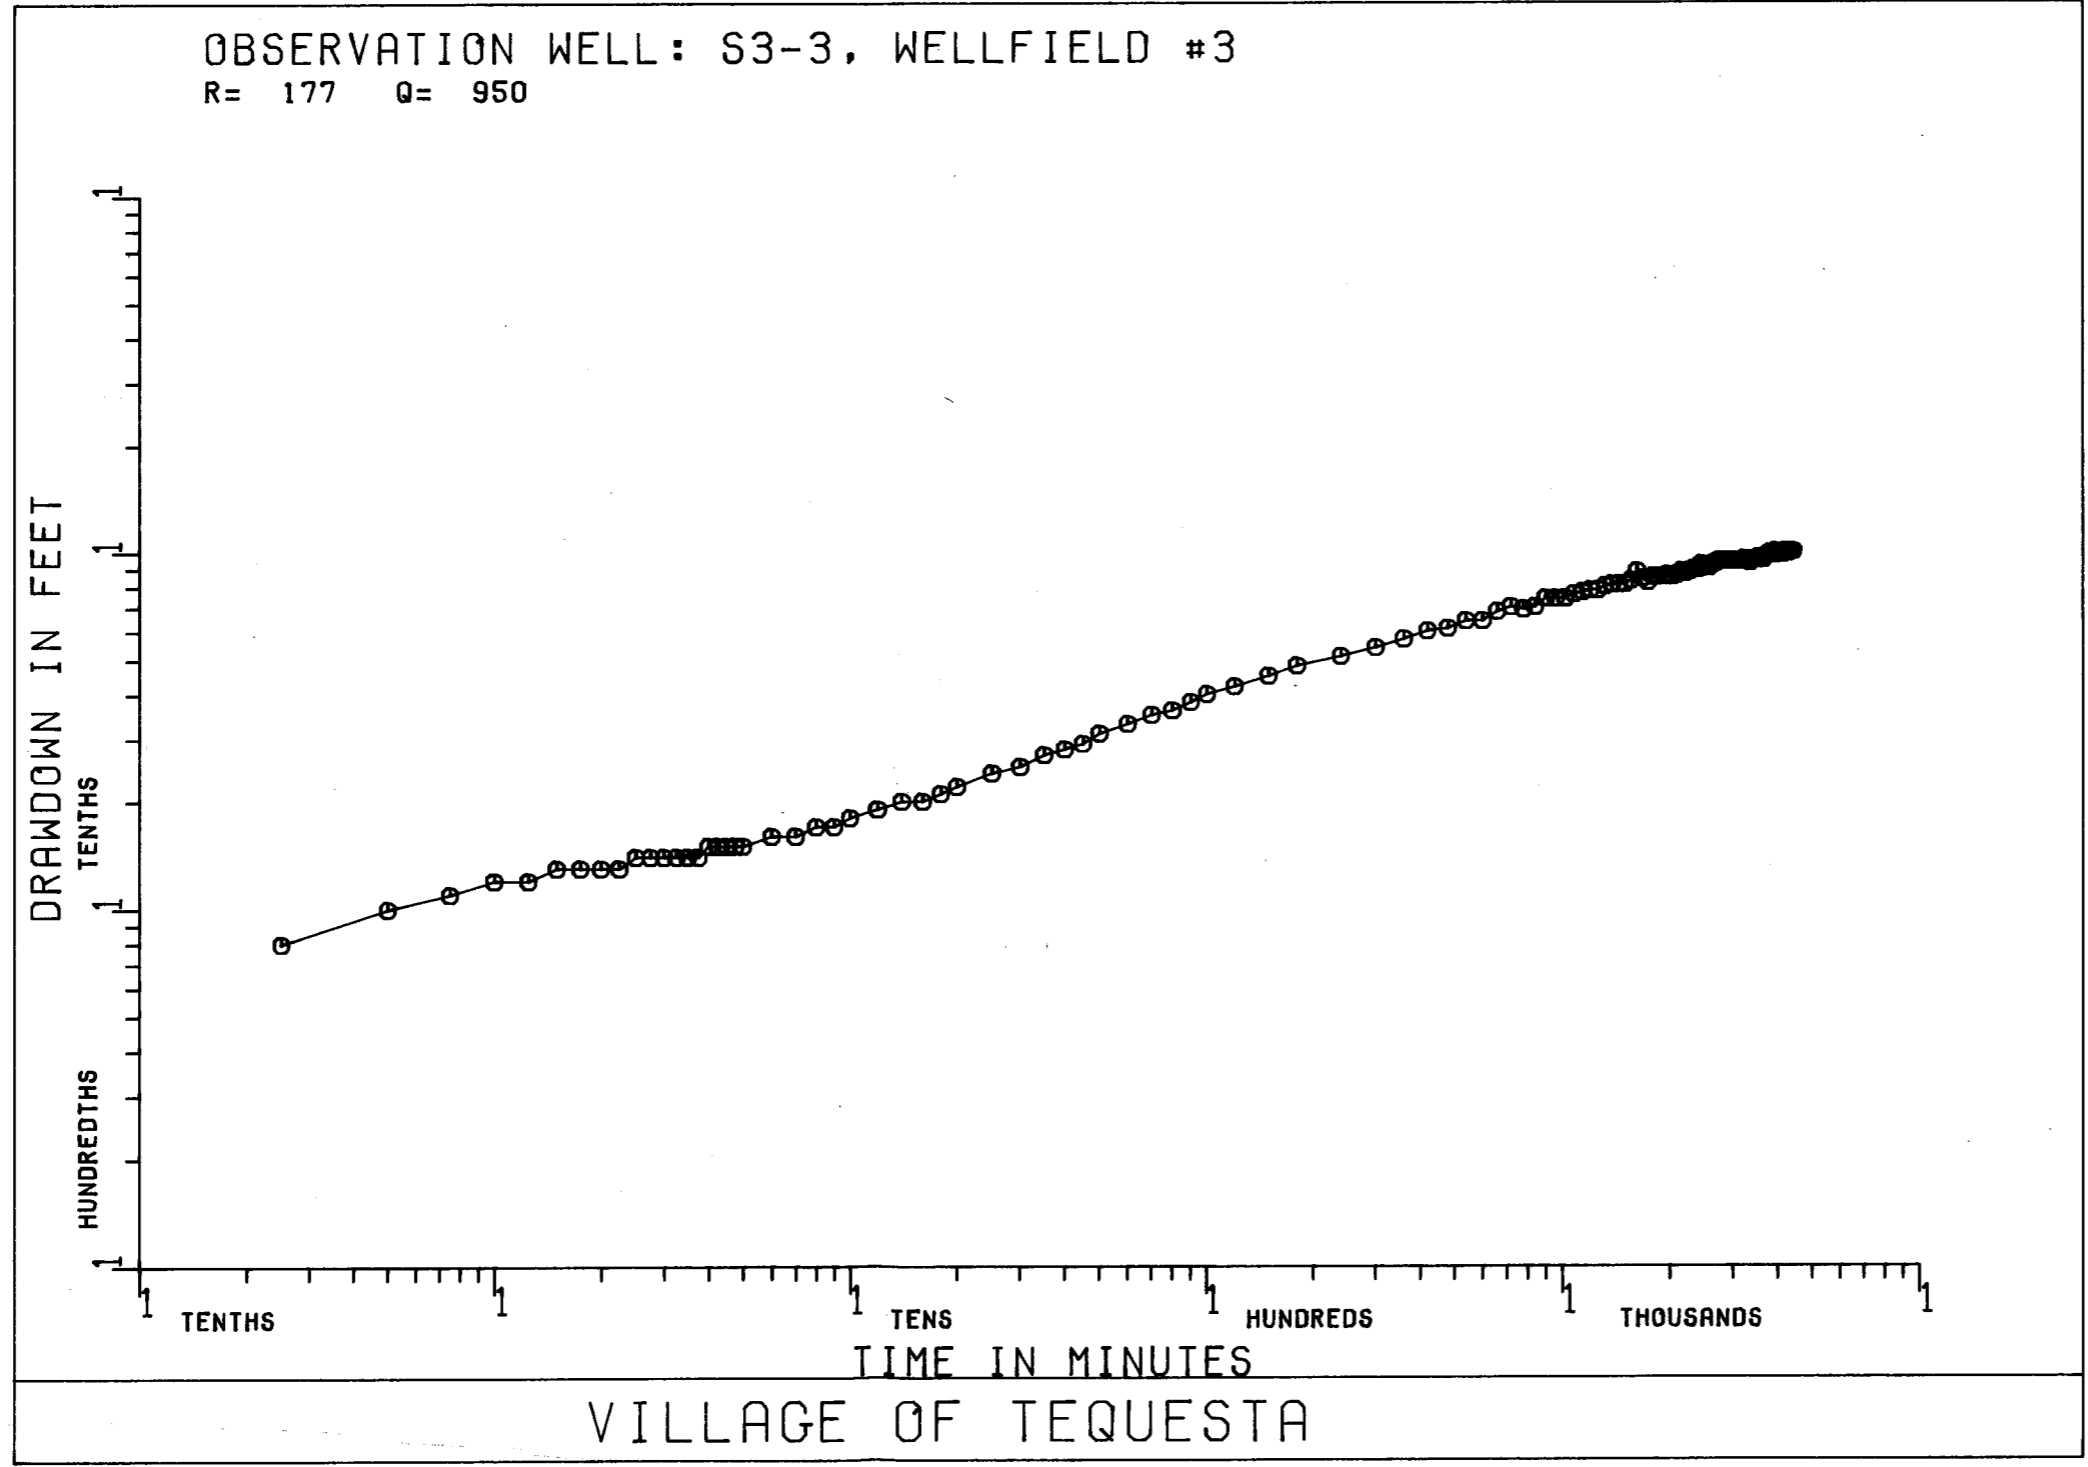

WMD

TAPENO 6265 PLOT NO 0340
USER NO NELMS DATE 86/05/05

TIME 12:48

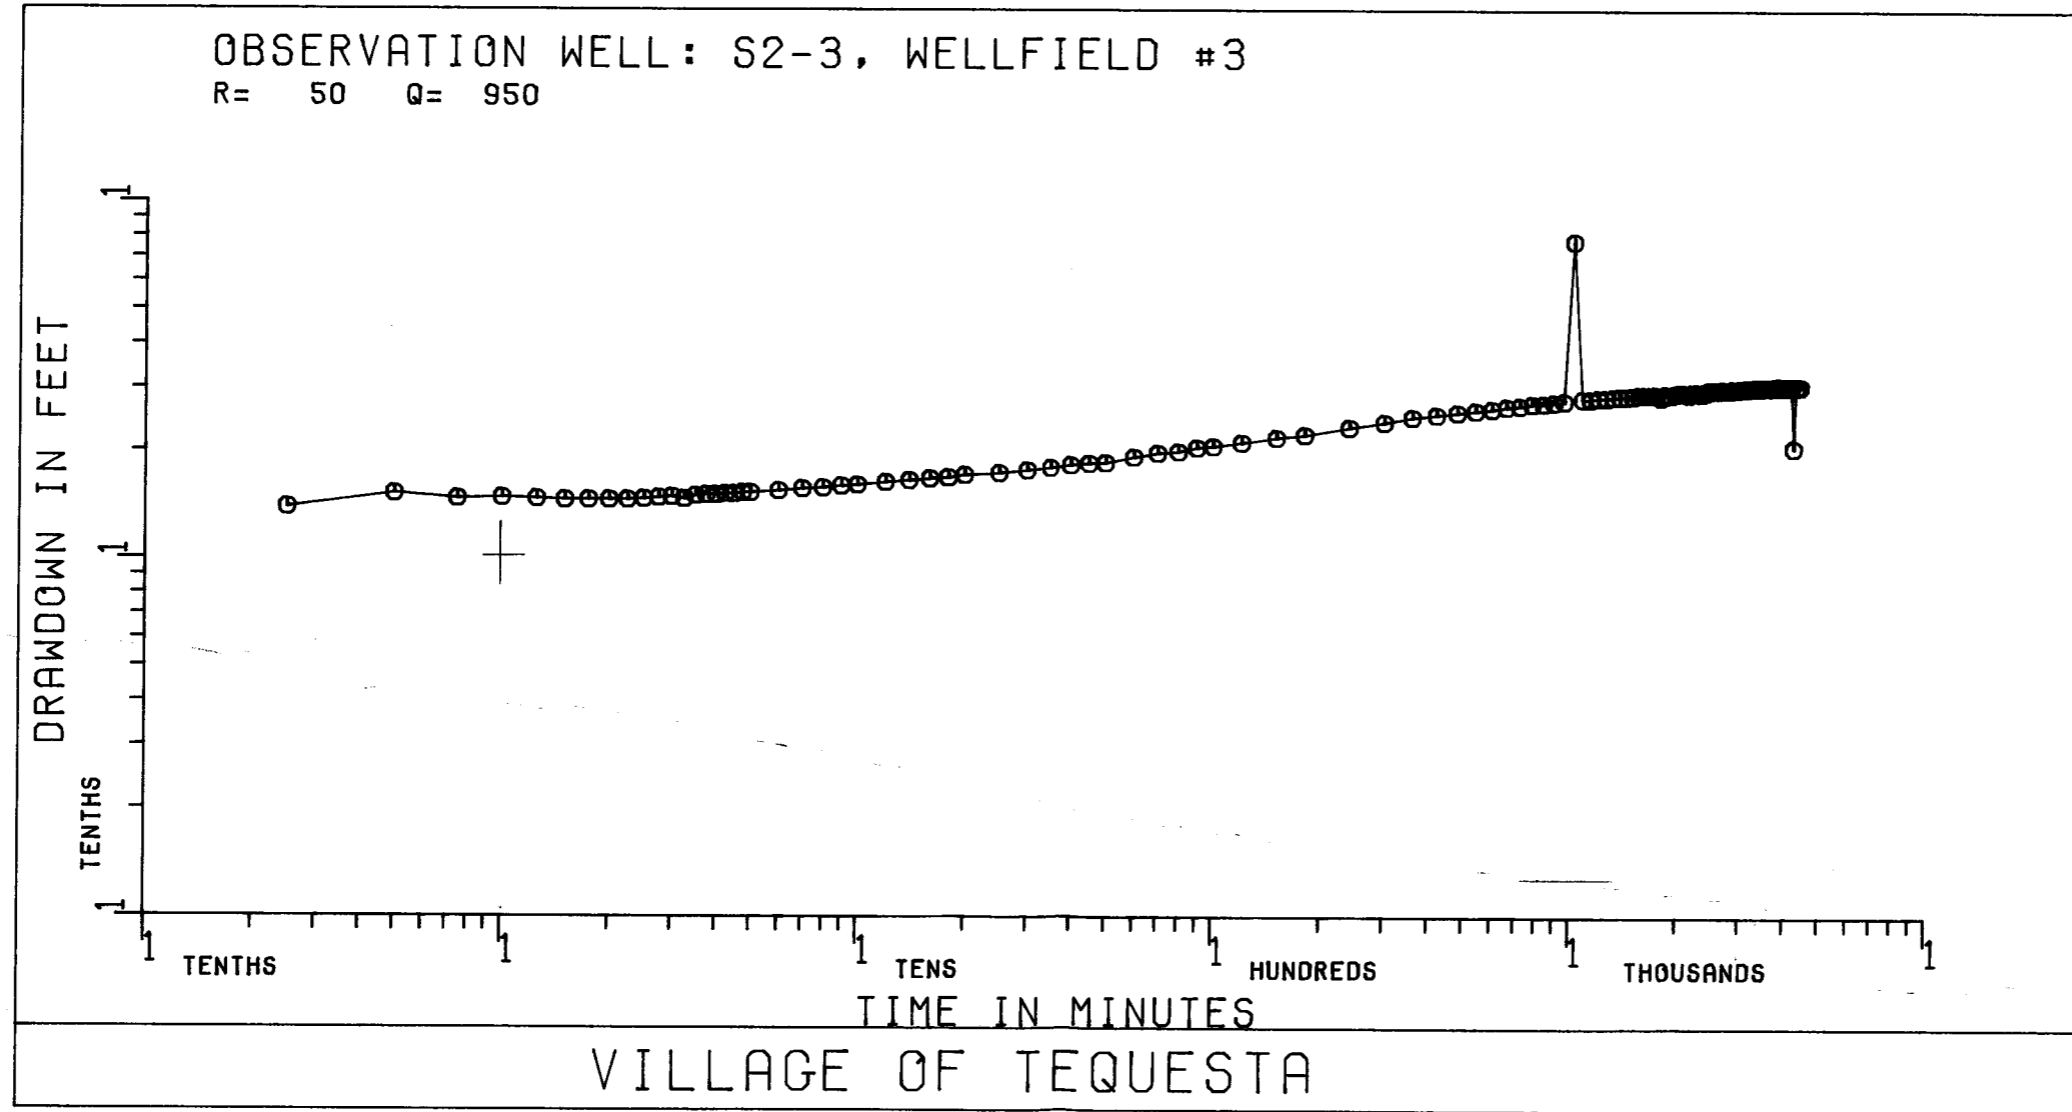


WMD

TAPENO 6265
USER NO NELMS

PLOT NO 0316


DATE 86/05/05

TIME 12:53

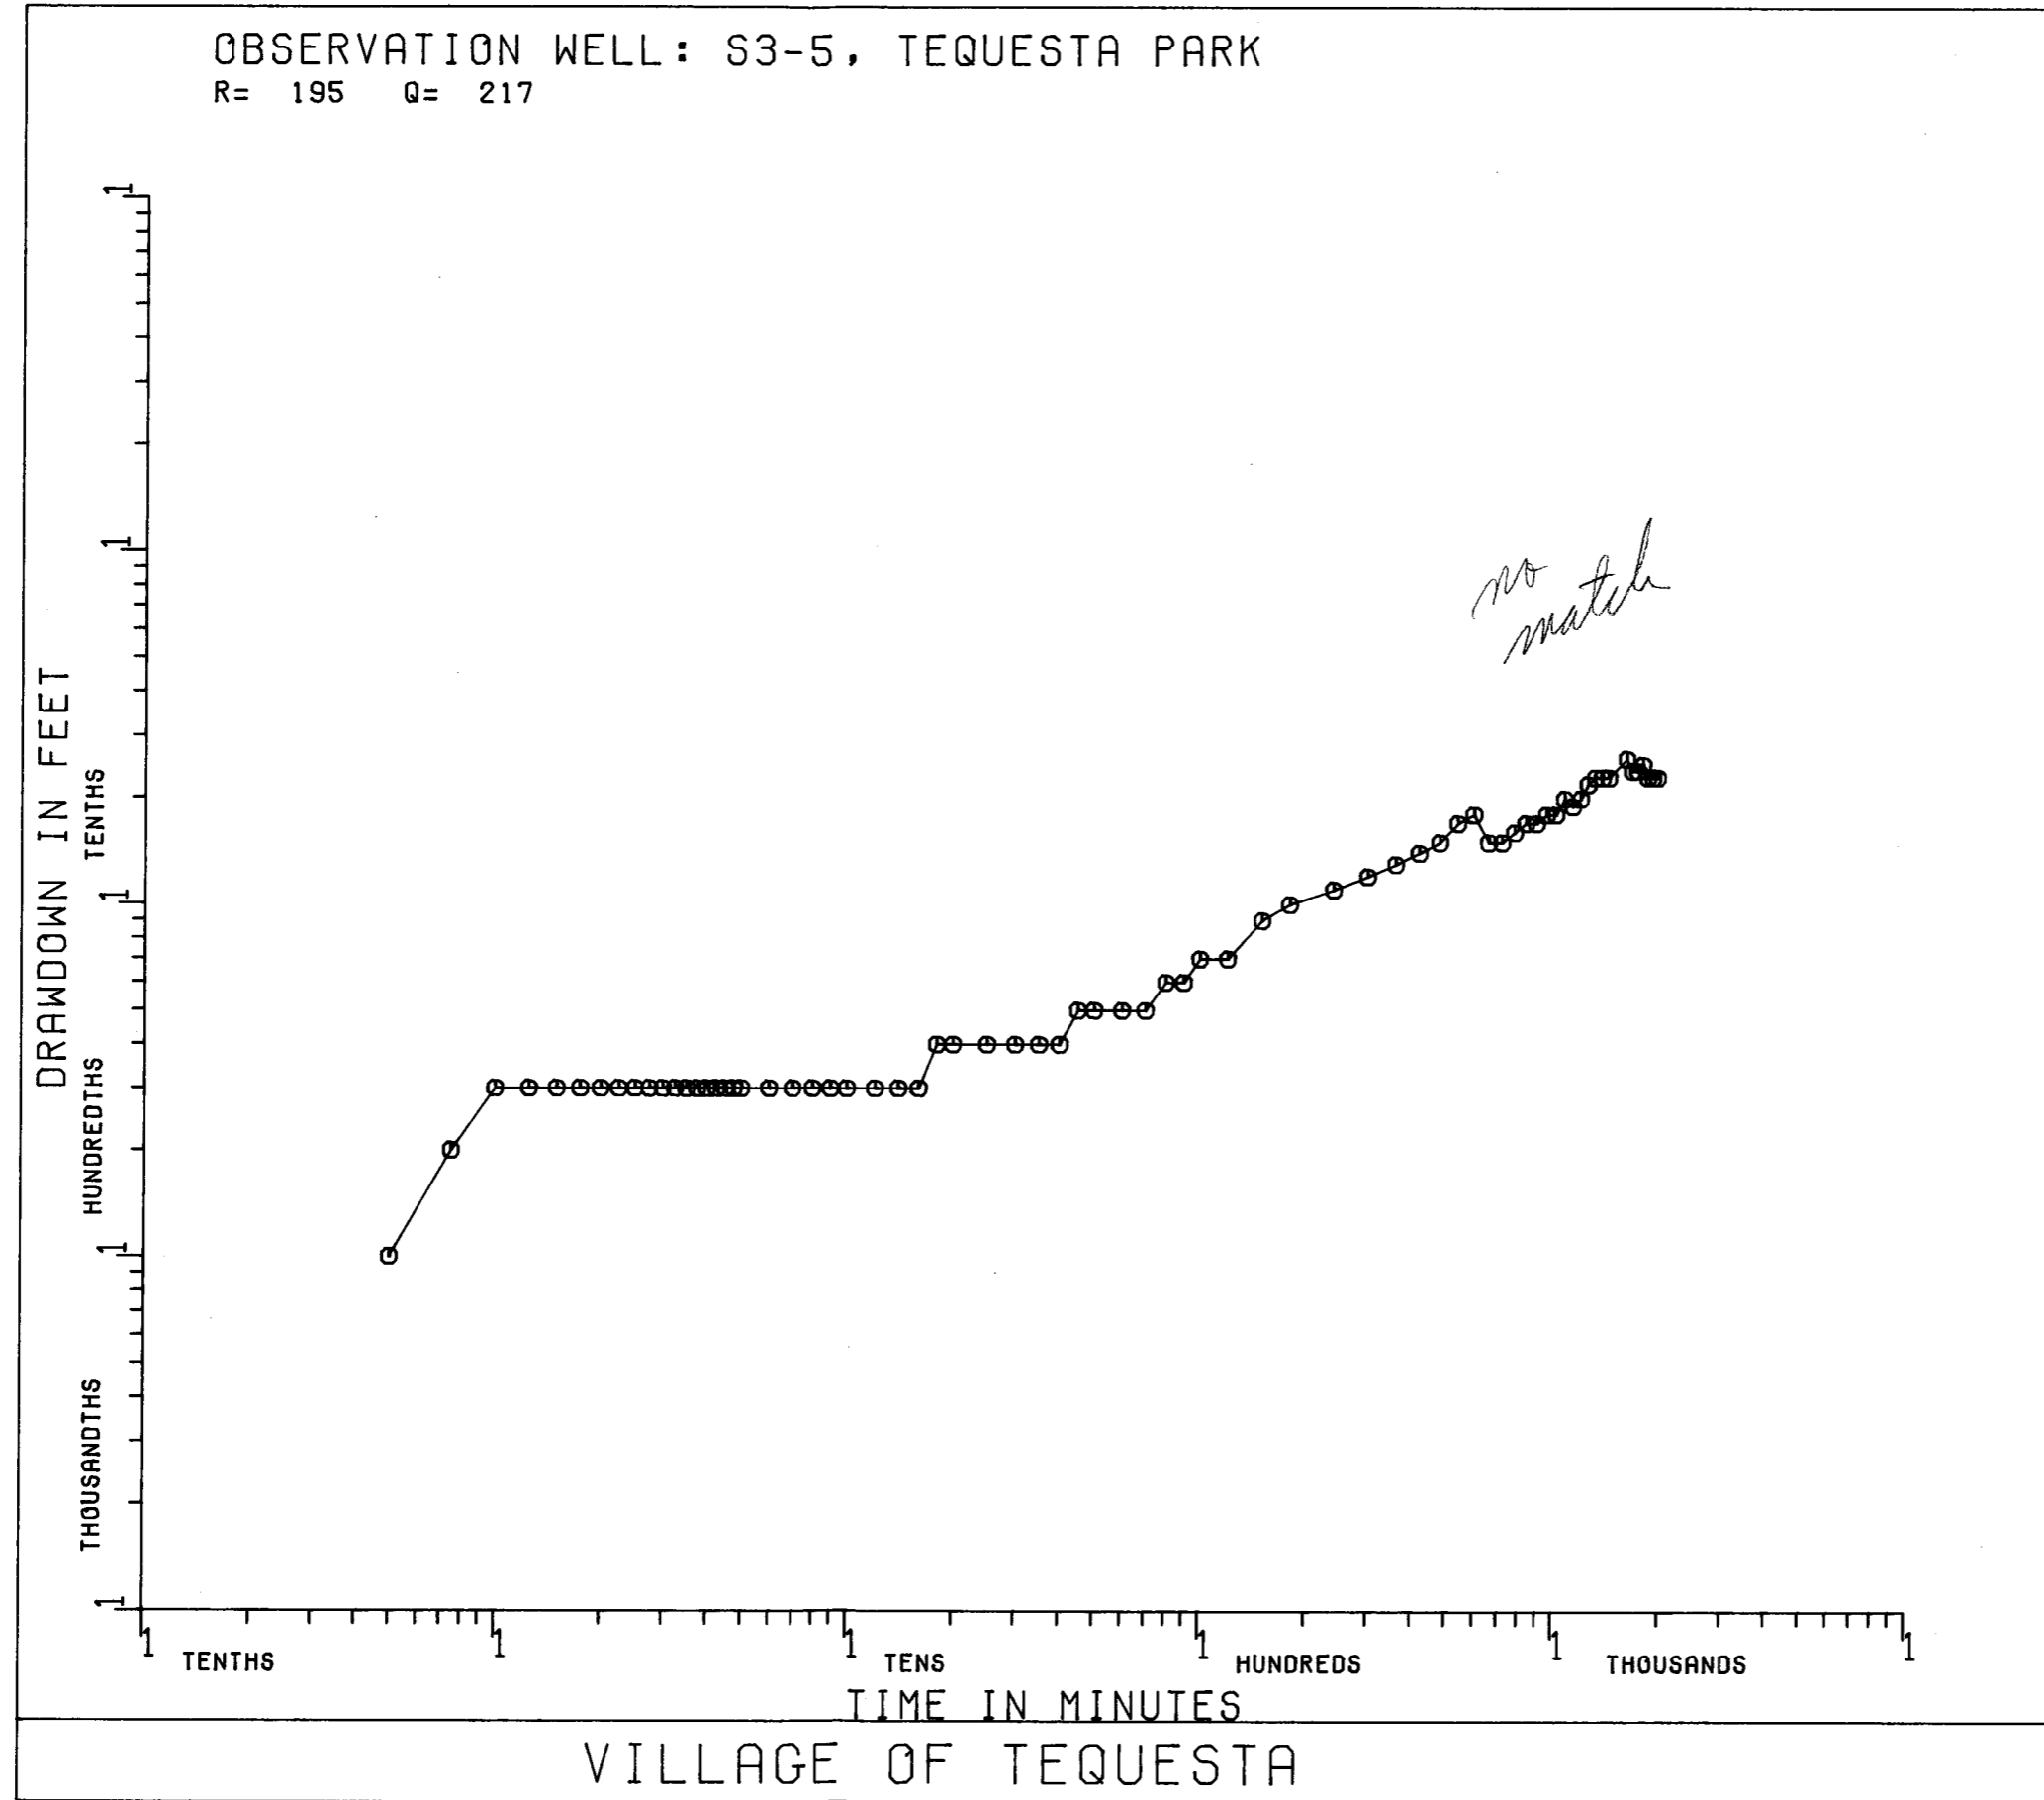


WMD

TAPENO 6265 PLOT NO 5000
USER NO RICK-BO DATE 86/06/12 TIME 15:37

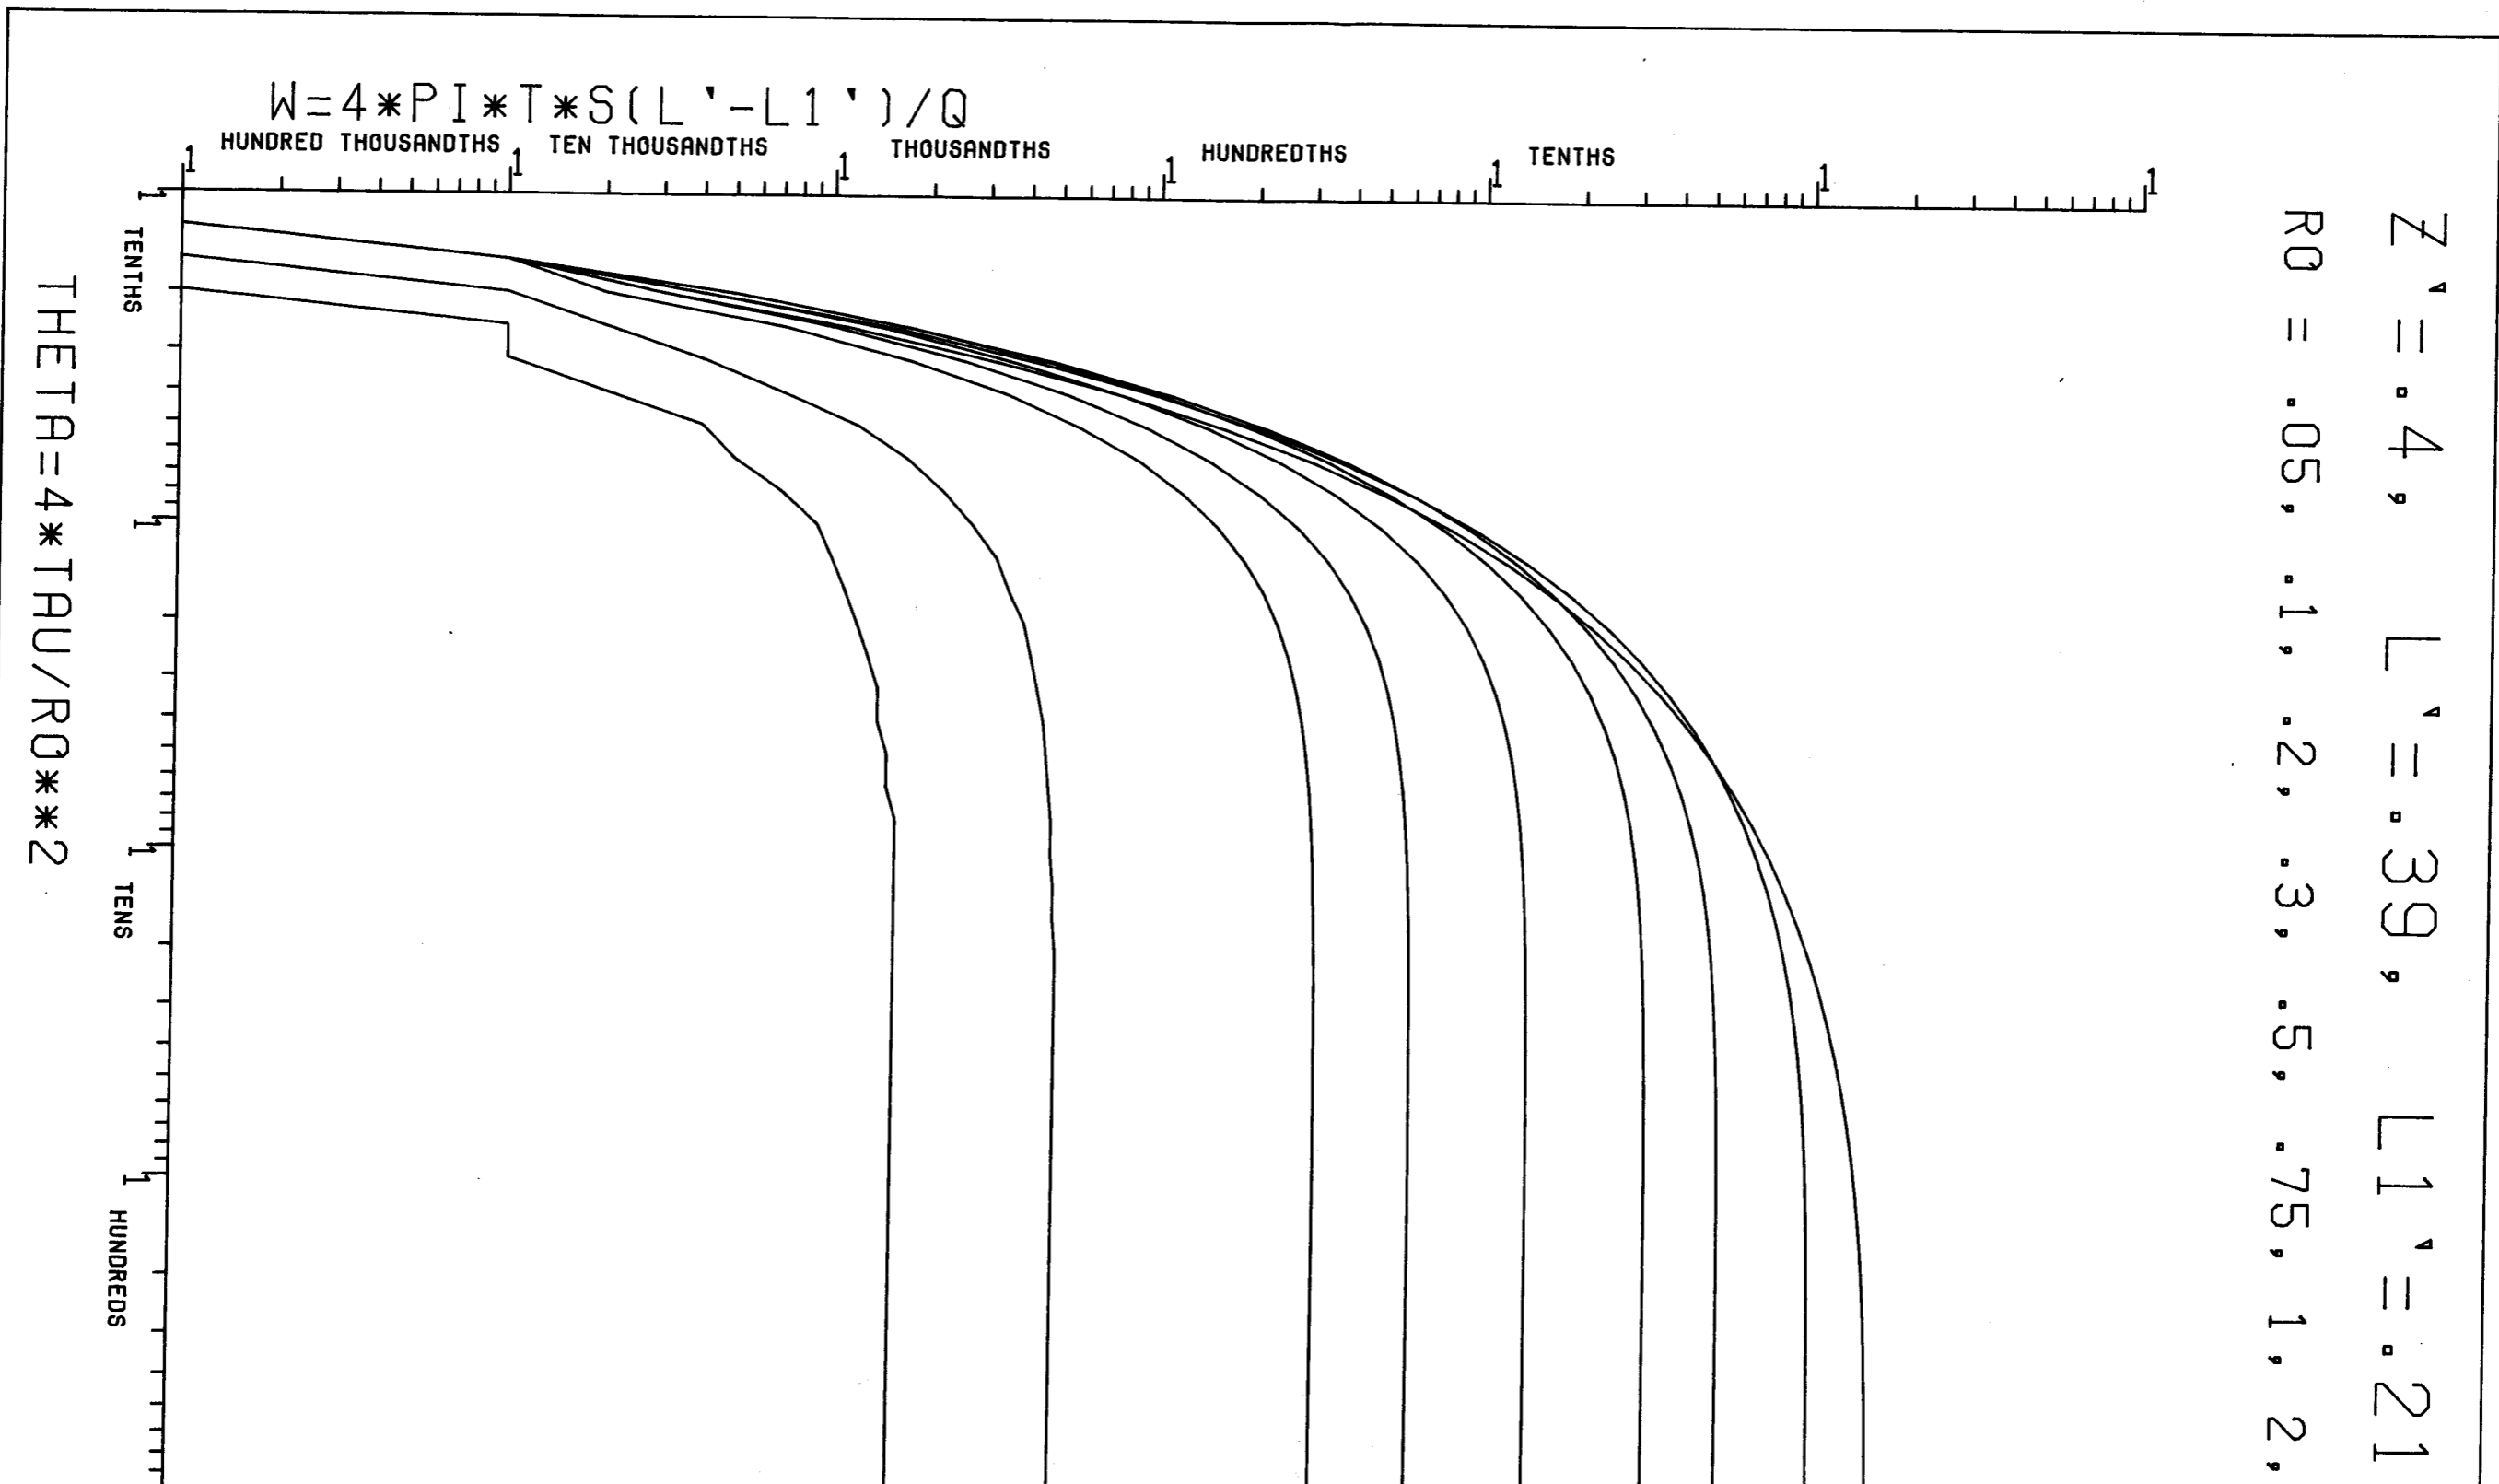


WMD

TAPENO 6265 PLOT NO 5006
USER NO RICK-BO DATE 86/06/12 TIME 15:40

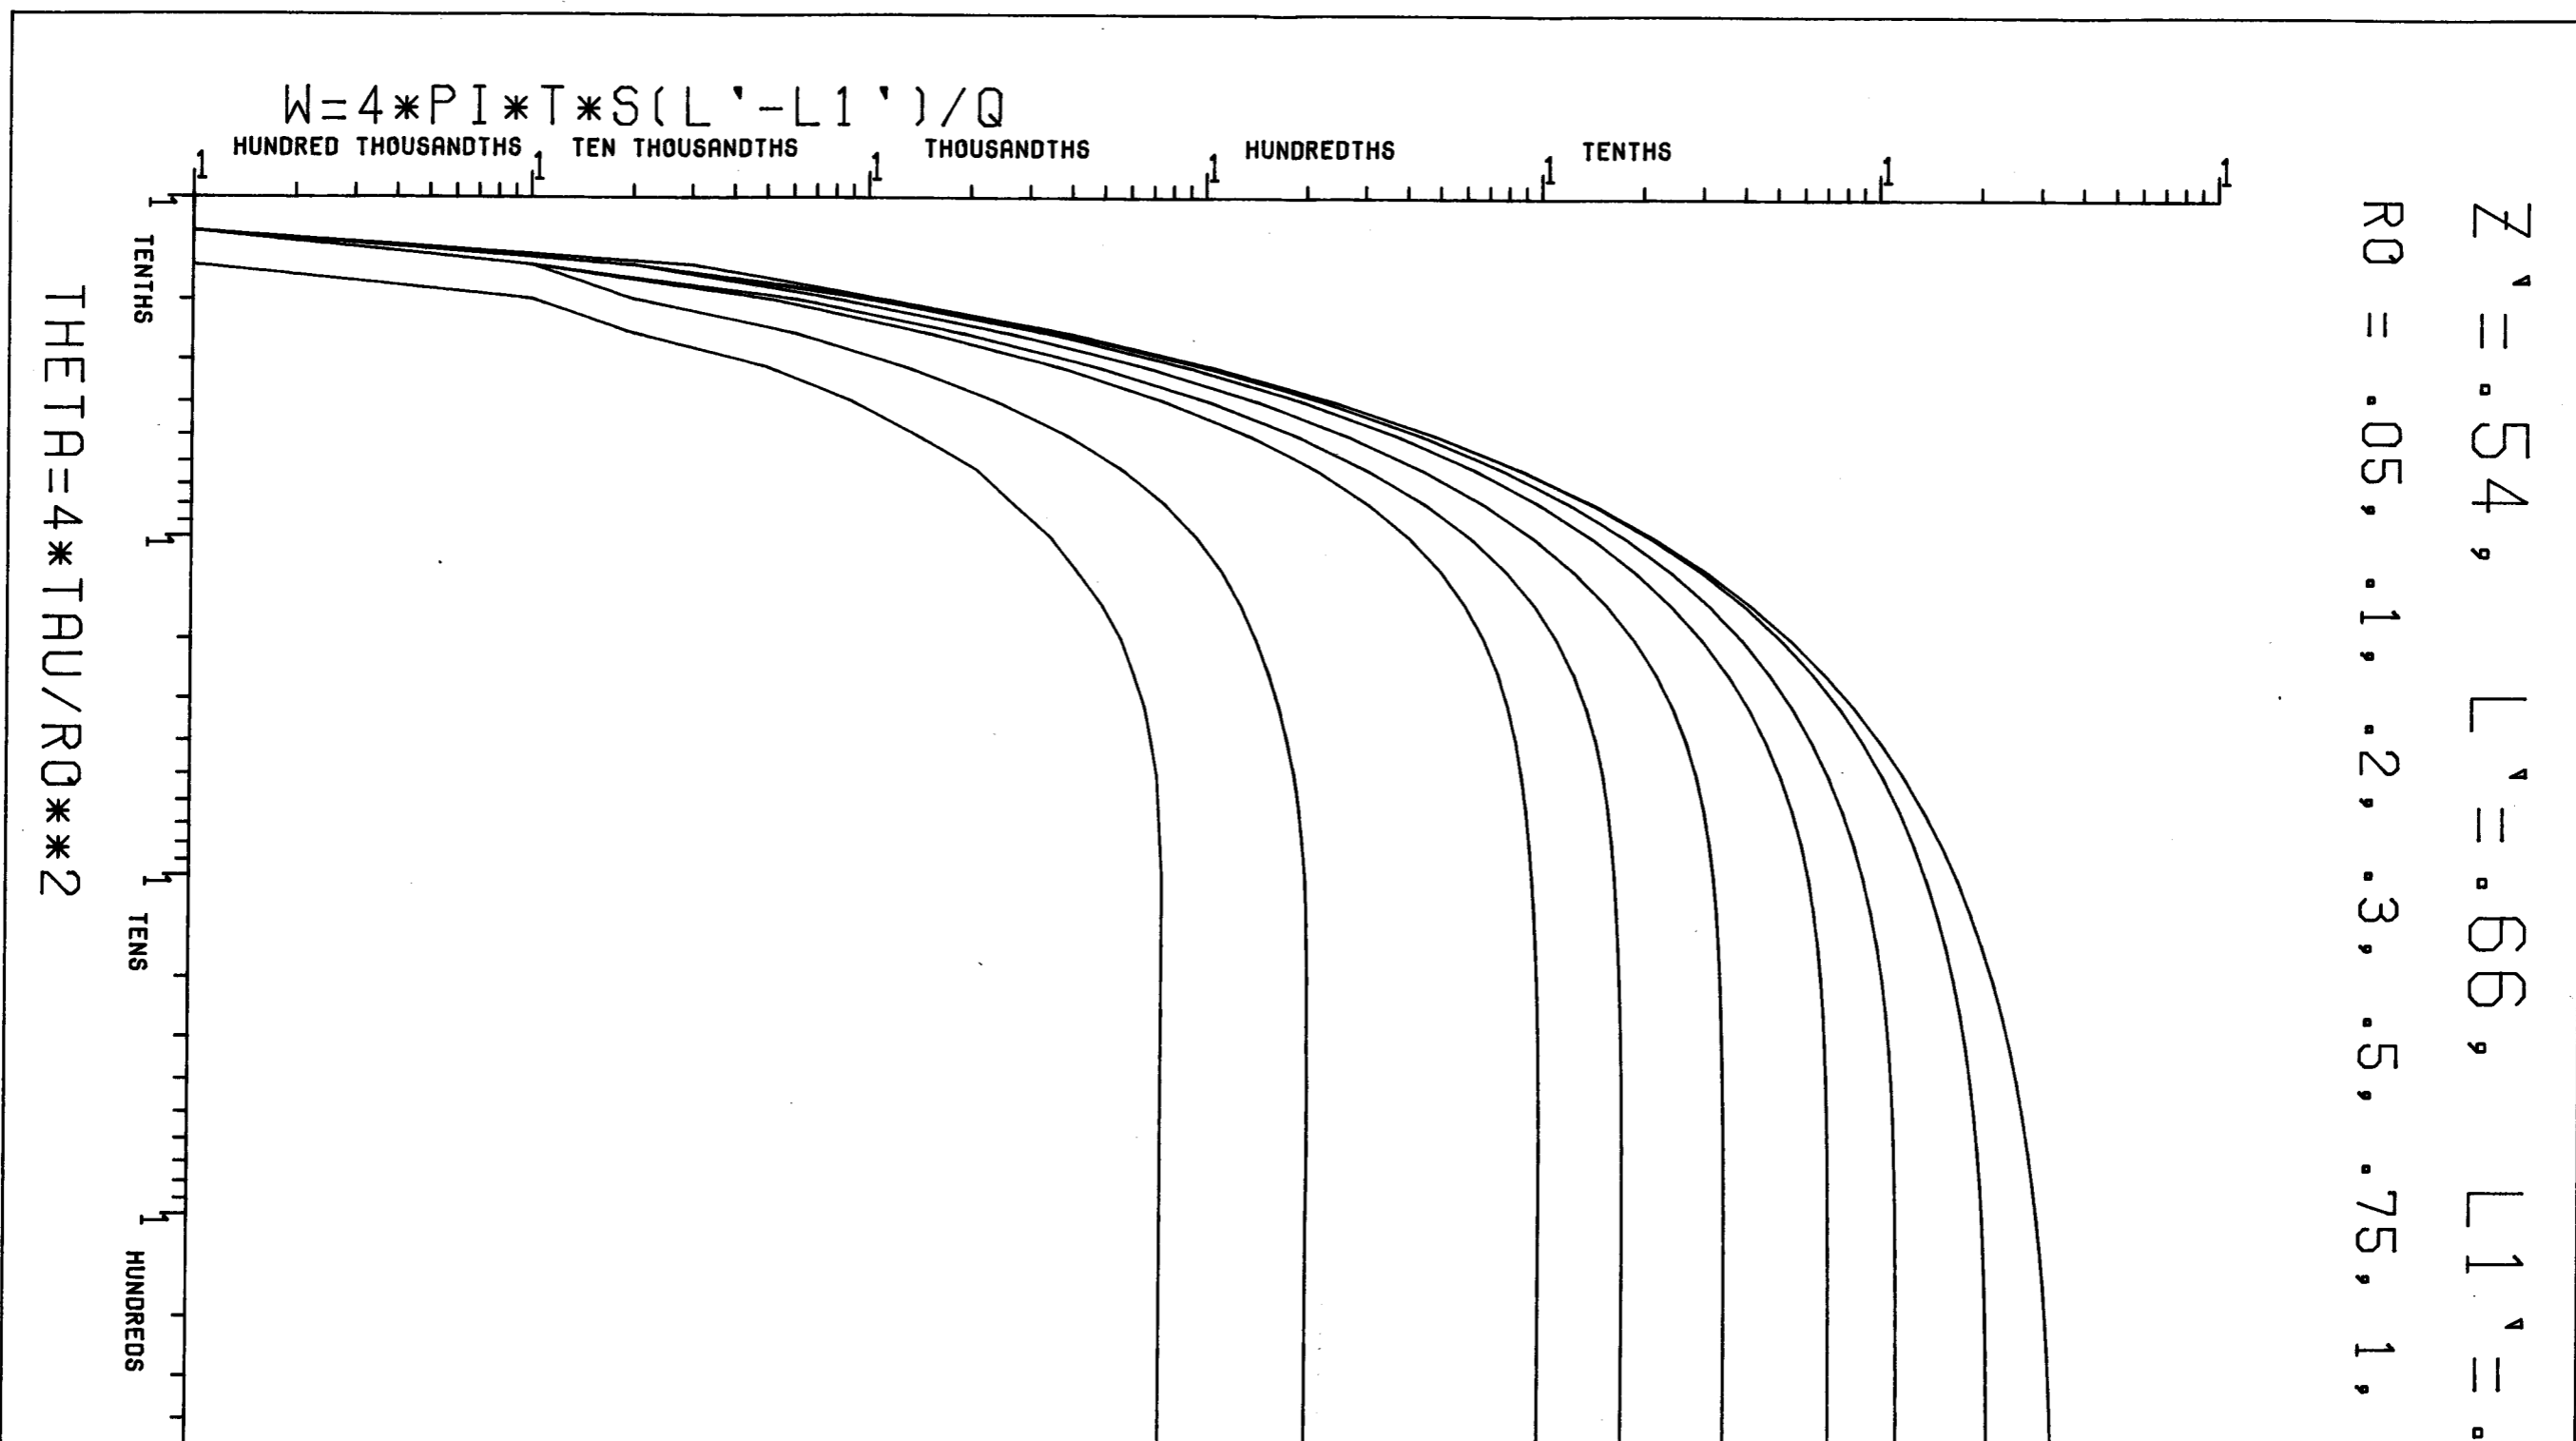

WMD


TAPENO 6265 PLOT NO 5003
USER NO RICK-BO DATE 86/06/12 TIME 15:39

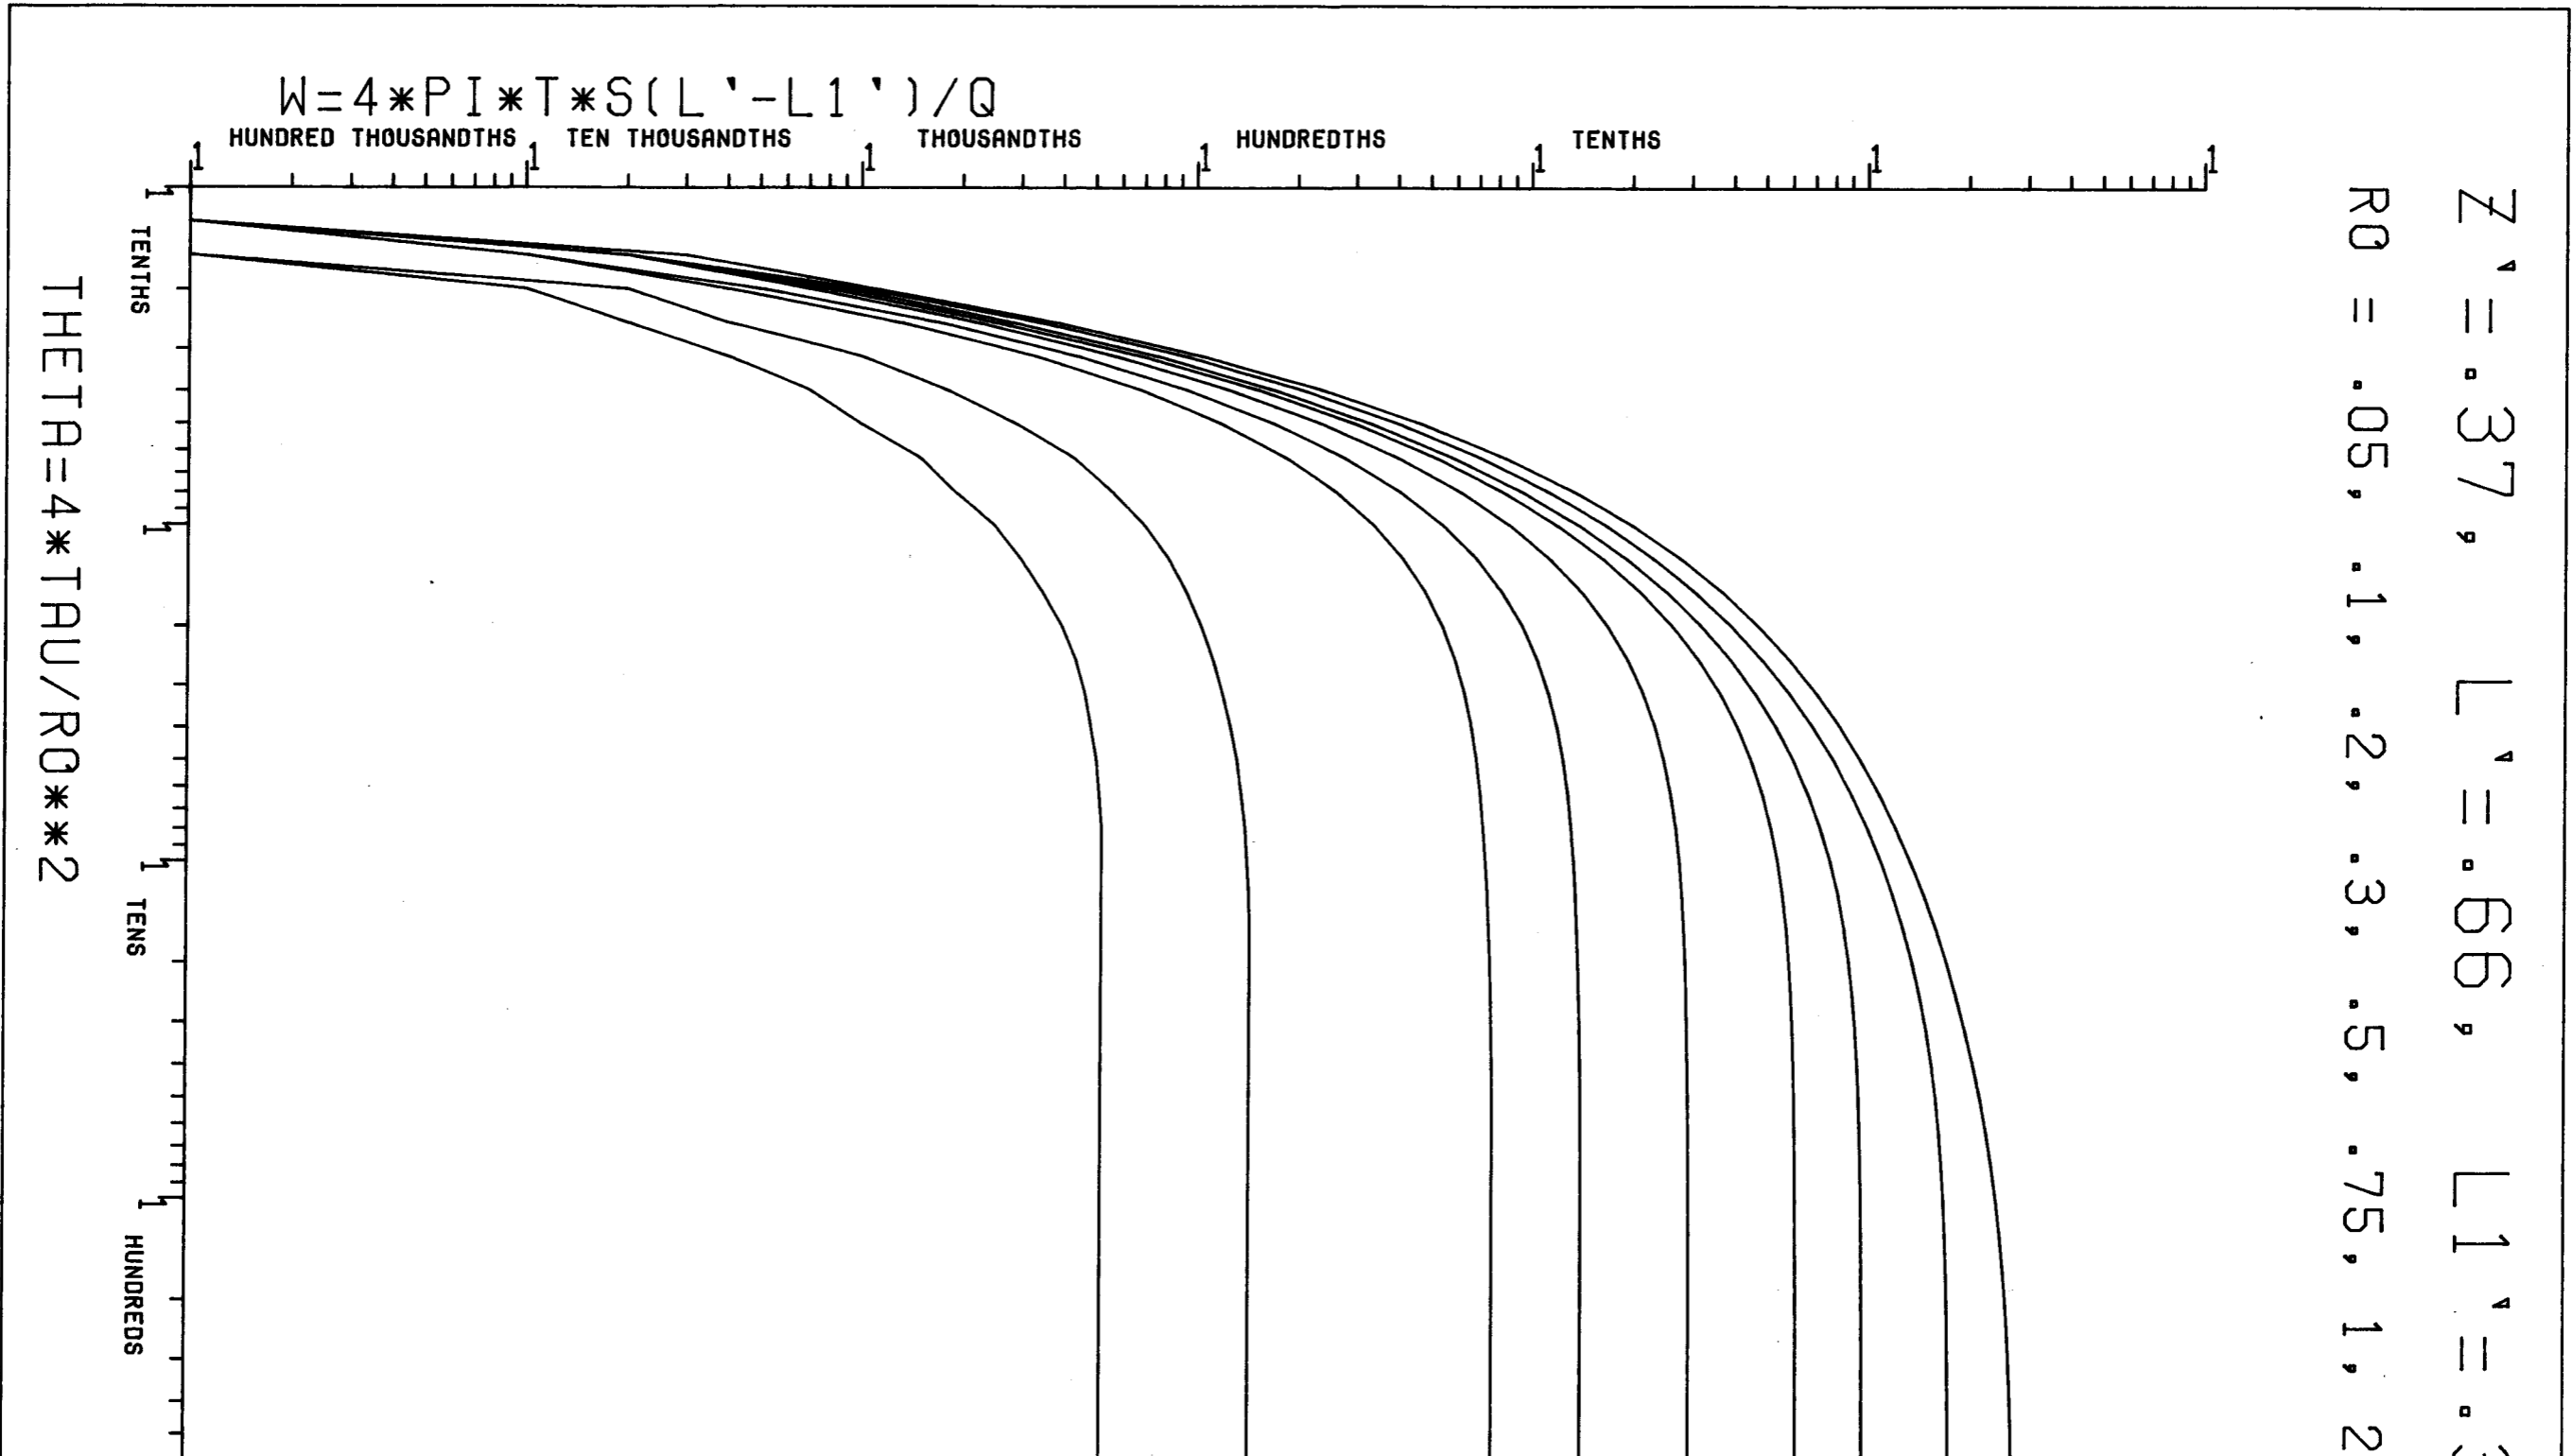

Handwritten: #2

WMD


TAPENO 6404 PLOT NO 5051
USER NO RICK-B0 DATE 86/06/12 TIME 15:35

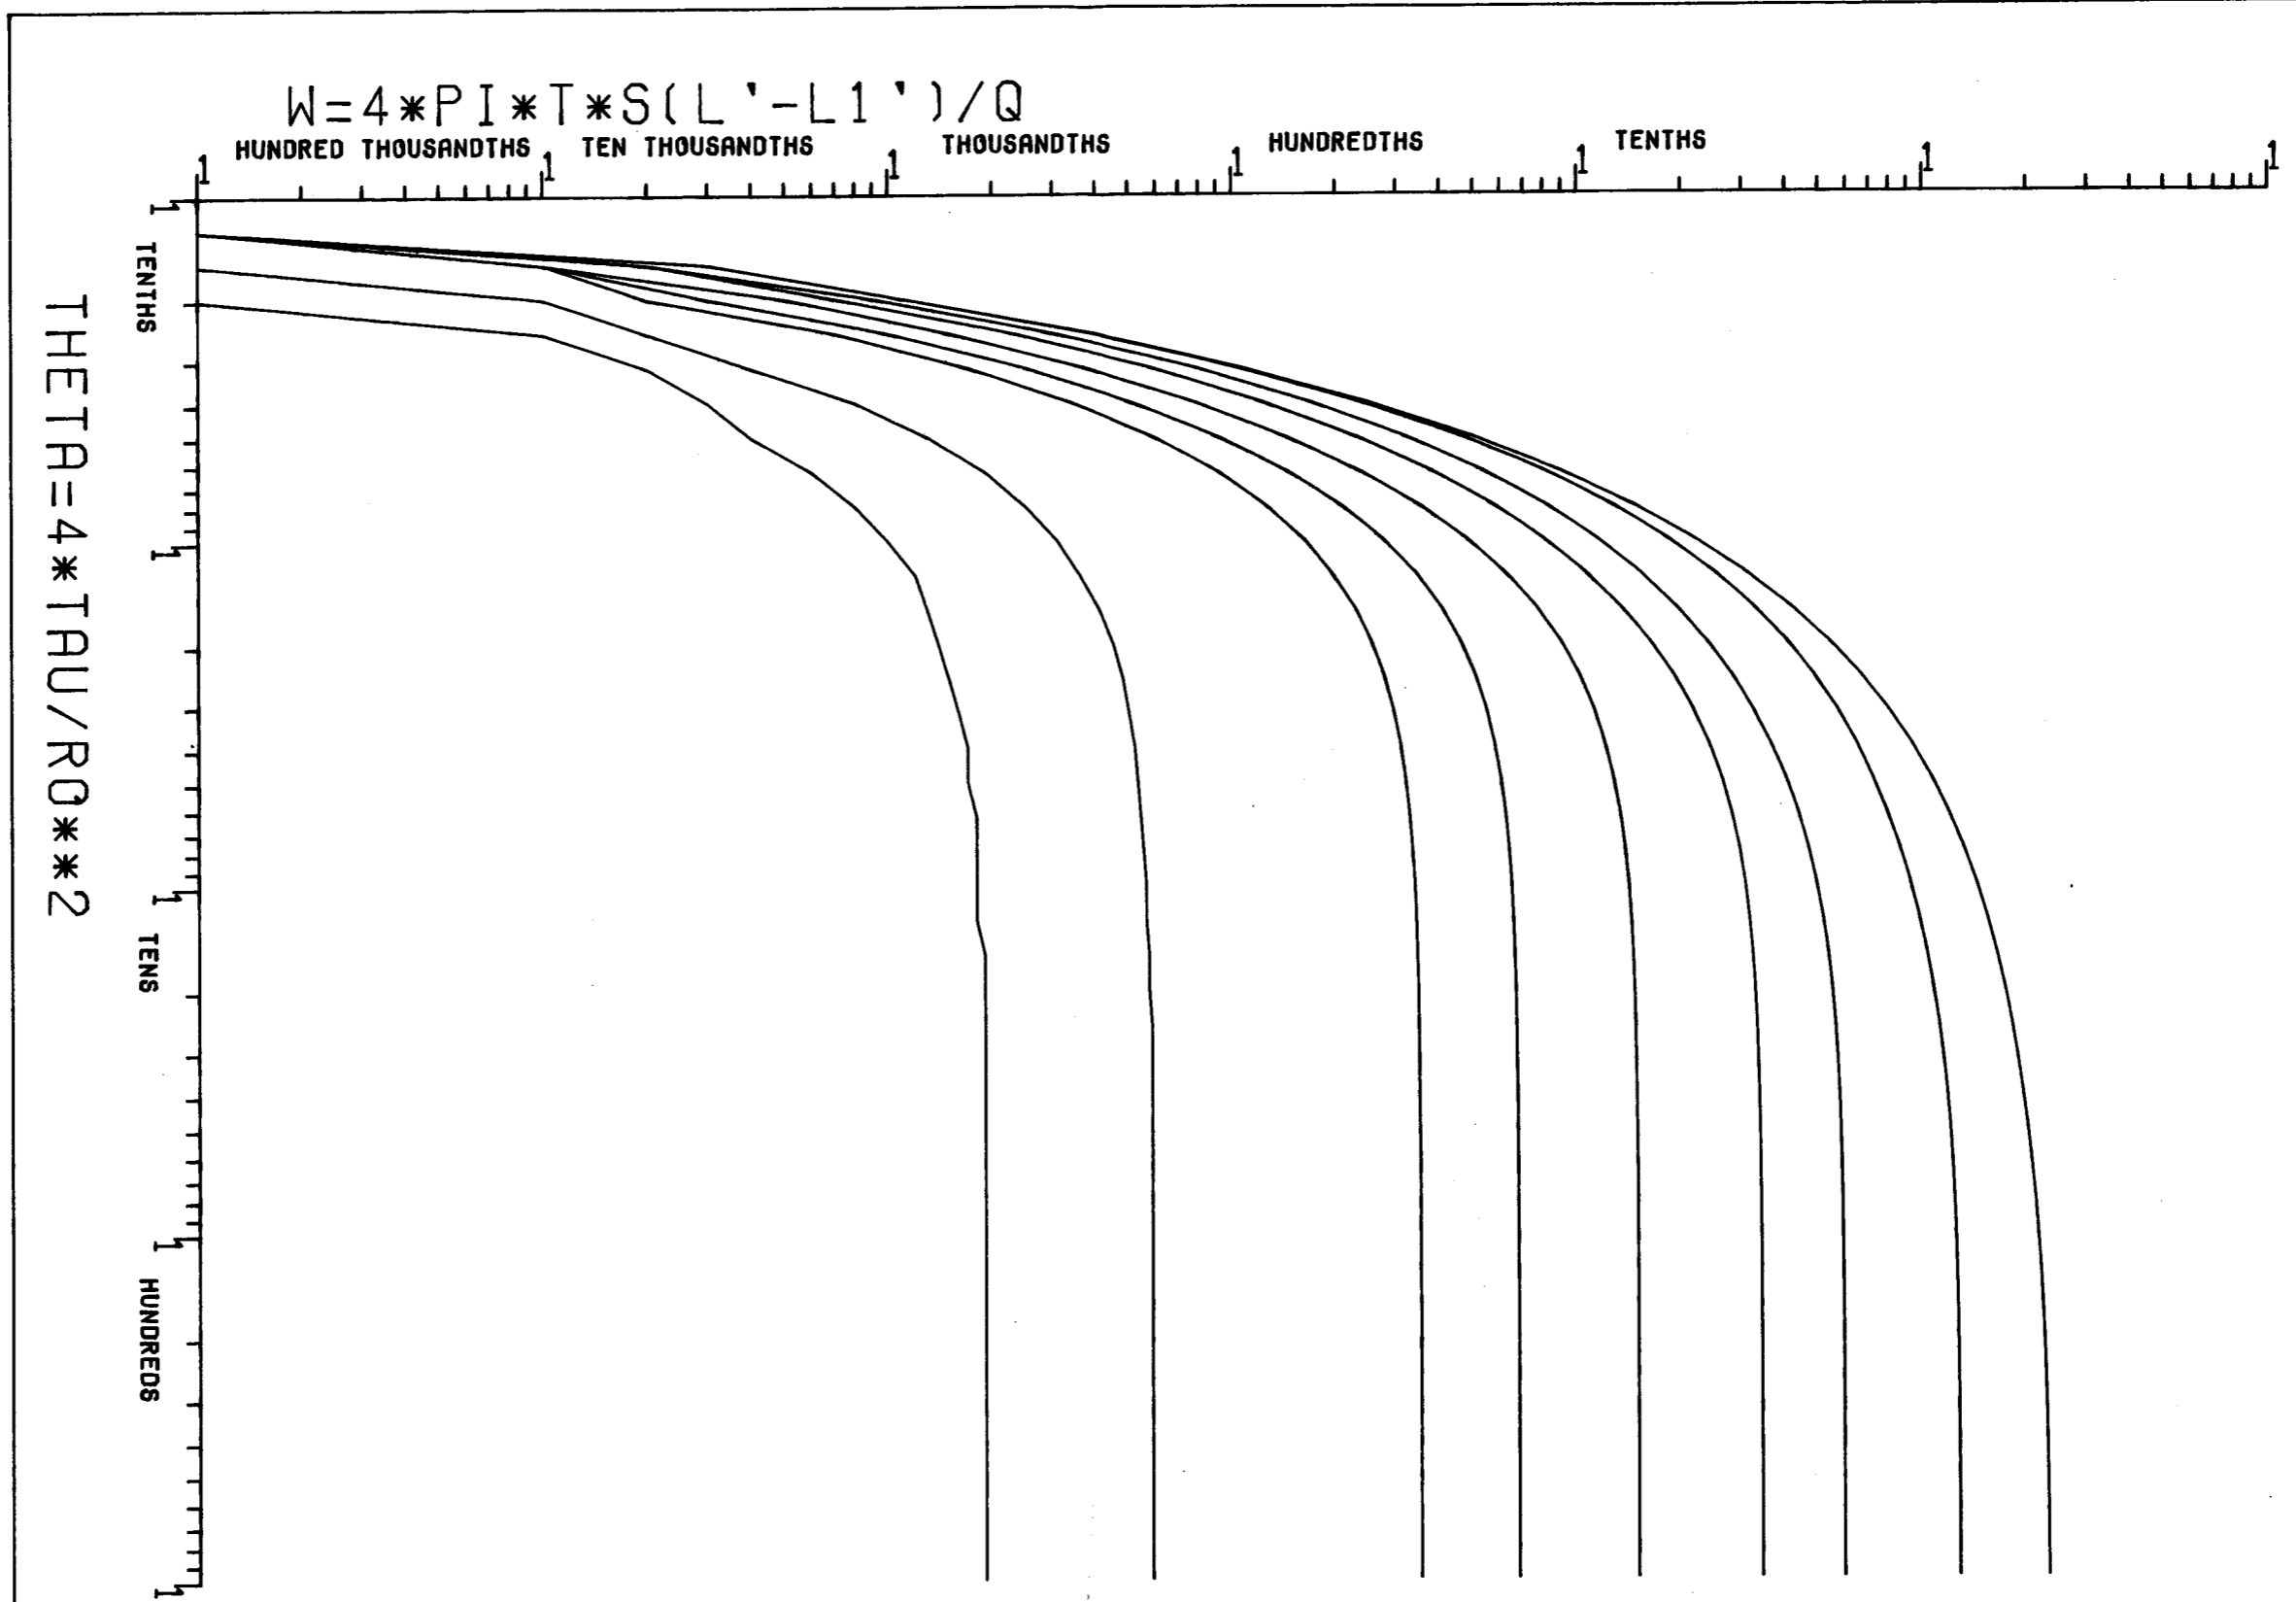

$Z' = .4, L' = .48, L1' = .32$
 $RQ = .05, .1, .2, .3, .5, .75, 1, 2, 3$

WMD

TAPENO 6404 PLOT NO 5045
USER NO RICK-BO DATE 86/06/12 TIME 15:24

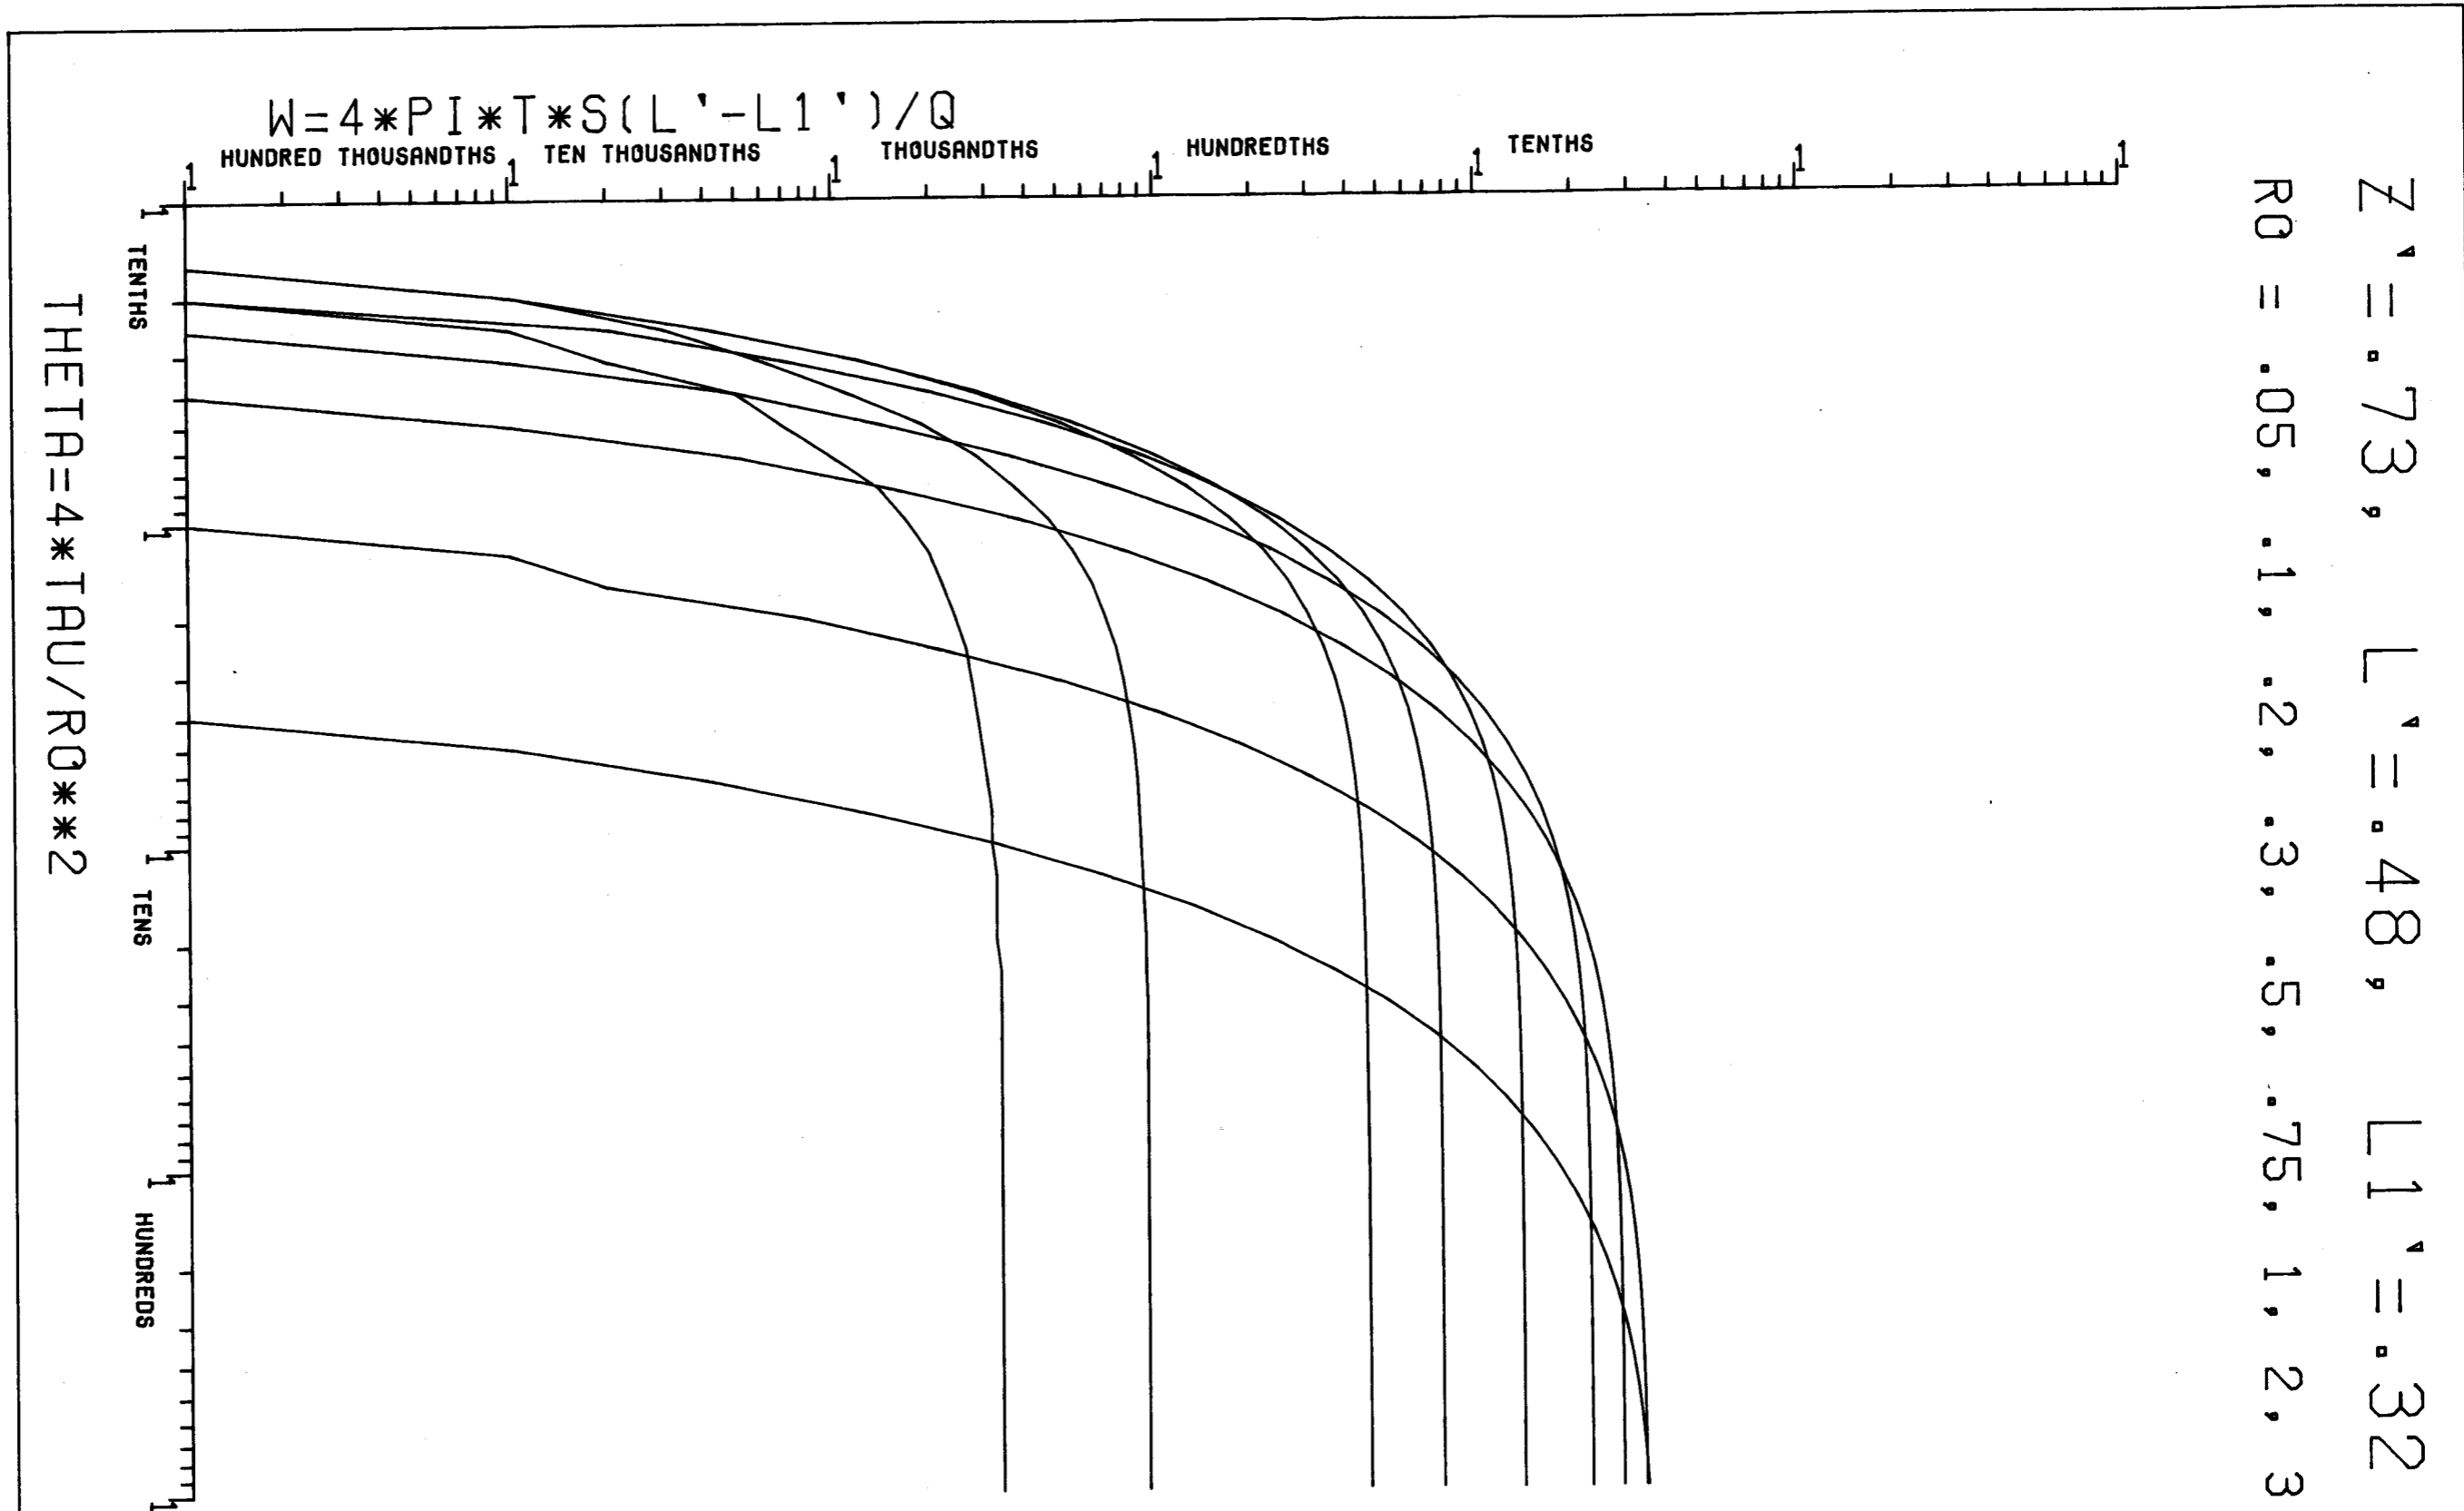

WMD

TAPENO 6404 PLOT NO 5048
USER NO RICK-BO DATE 86/06/12 TIME 15:26

