


Collier 11-00017

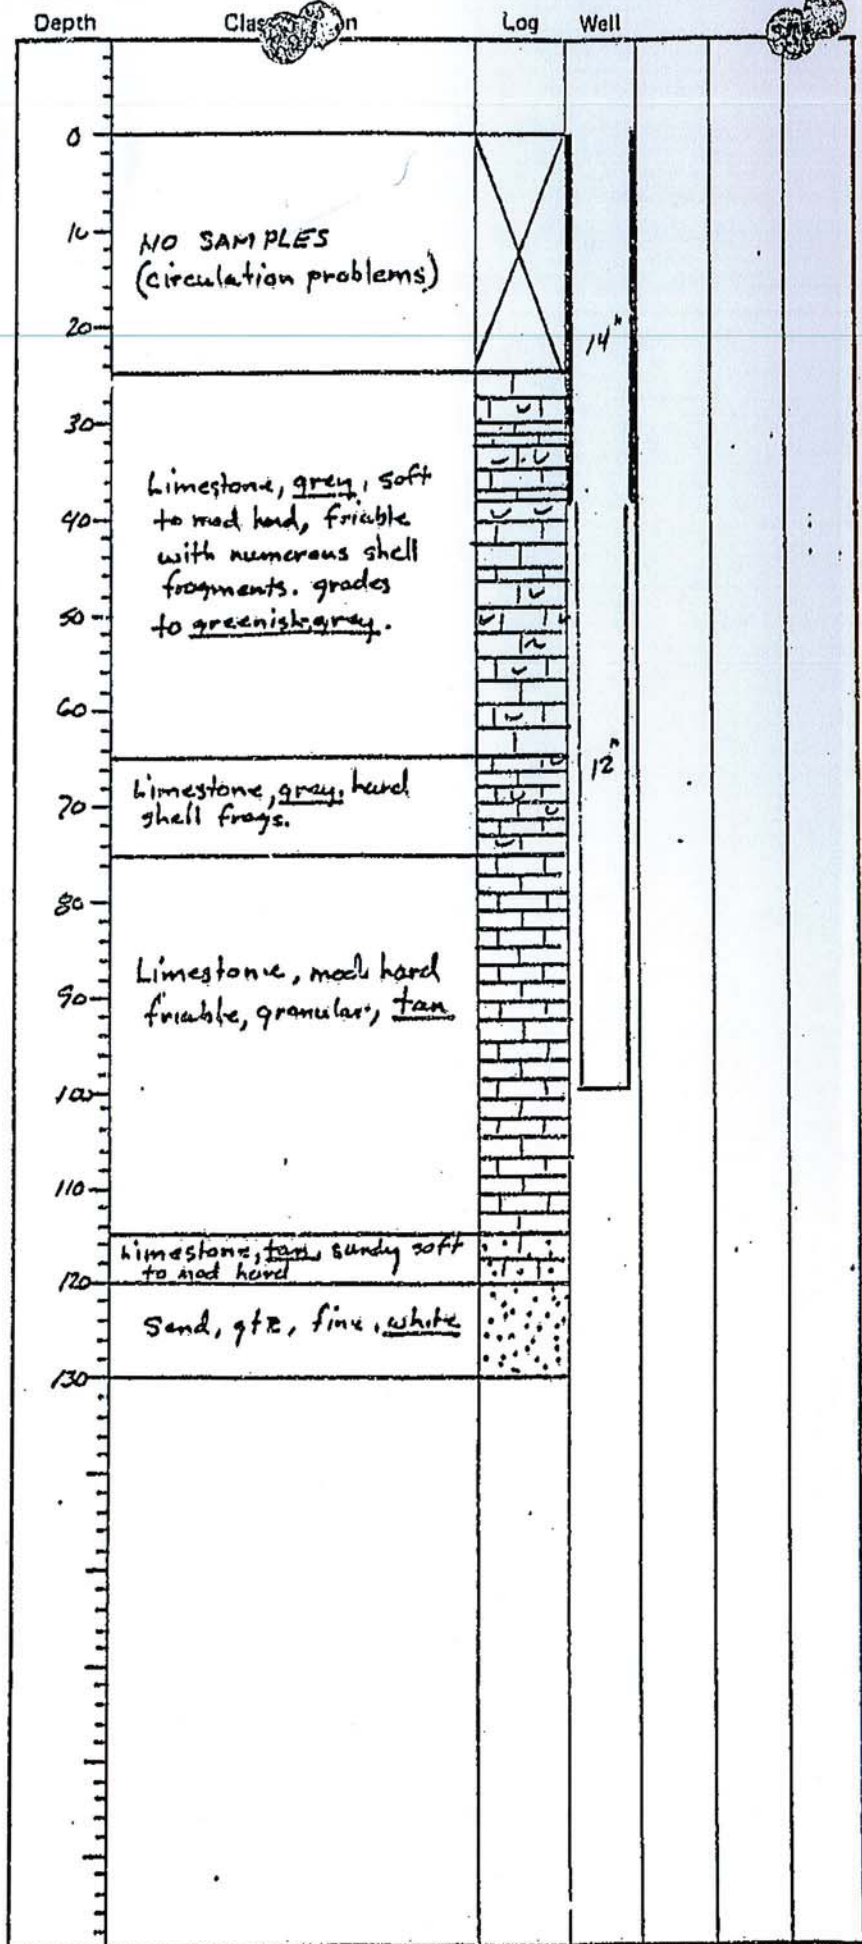

WELL DRILLING REPORT

Well: 1B (3-11)

Location: E. Golden Gate W.F.
Sec 32, T48S, R28E

County: Collier State: FL

Ground Elevation: 13' ±

Diameter: 12

Depth: 100

Static Water Level: 4.06'

Date: 10-81

Casing: 14" to 32" cemented

Screen: open hole

Construction: Air Rotary

Driller: Tamiami Well Dlg
Ft. Myers, FL

Date Finished: 10-81

Pumping Test

Specific Yield 507 gpm/ft
@ 1100 gpm

Water Analysis (ppm)

TDS	<u>340</u>
Total Hardness ¹	<u>262</u>
M.O. Alkalinity ¹	<u>280</u>
Chloride Cl	<u>37</u>
Iron Fe	<u>0.03</u>
Sulfate SO ₄	<u>6.2</u>
Color (APHA)	<u>25</u>
Calcium ¹	<u>219</u>

Compiled by S.F. Reynolds
Date 11-81

¹ As CaCO₃.