


TABLE 1
CITY OF NORTH MIAMI BEACH
WATER QUALITY FOR WELL 1F
STRADDLE PACKER AND ANNULUS TEST RESULTS

Straddle Packer	Sample Number	Depth Interval (feet)		Date	Conductivity (μmhos/cm)	Total Hardness (mg/L)	pH (S.U.)	Total Dissolved Solids (mg/L)	Chlorides (mg/L)	Total Sulfide (mg/L)	Iron (mg/L)
	4	1210	1230	02/10/03	6,840	980	7.95	4120	1850	0.80	0.86
	5	1250	1270	02/11/03	13,180	1860	7.38	8150	4440	0.80	0.97
	3	1290	1310	02/07/03	13,100	1700	7.66	8750	4400	0.40	1.1
	1	1360	1380	02/04/03	14,280	1850	7.68	8750	4490	0.40	1.78
	2	1470	1490	02/06/03	18,330	2400	7.72	11,880	6150	0.40	1.83

Annulus	Sample Number	Depth Interval (feet)		Date	Conductivity (μmhos/cm)	Total Hardness (mg/L)	pH (S.U.)	Total Dissolved Solids (mg/L)	Chlorides (mg/L)	Total Sulfide (mg/L)	Iron (mg/L)
	4	1020	1210	02/10/03	5,470	790	7.72	3330	1480	2.00	0.06
	5	1020	1250	02/11/03	5,440	760	7.96	3460	1580	2.80	BDL
	3	1020	1290	02/07/03	5,480	740	7.62	3360	1490	2.80	BDL
	1	1020	1360	02/04/03	5,590	805	7.9	3440	1520	2.00	0.47
	2	1020	1470	02/06/03	5,950	860	7.92	3750	1690	2.40	BDL

BDL – Below Detectable Limit

CITY OF NORTH MIAMI BEACH
 WATER QUALITY FOR WELL 1F
 STRADDLE PACKER TEST RESULTS

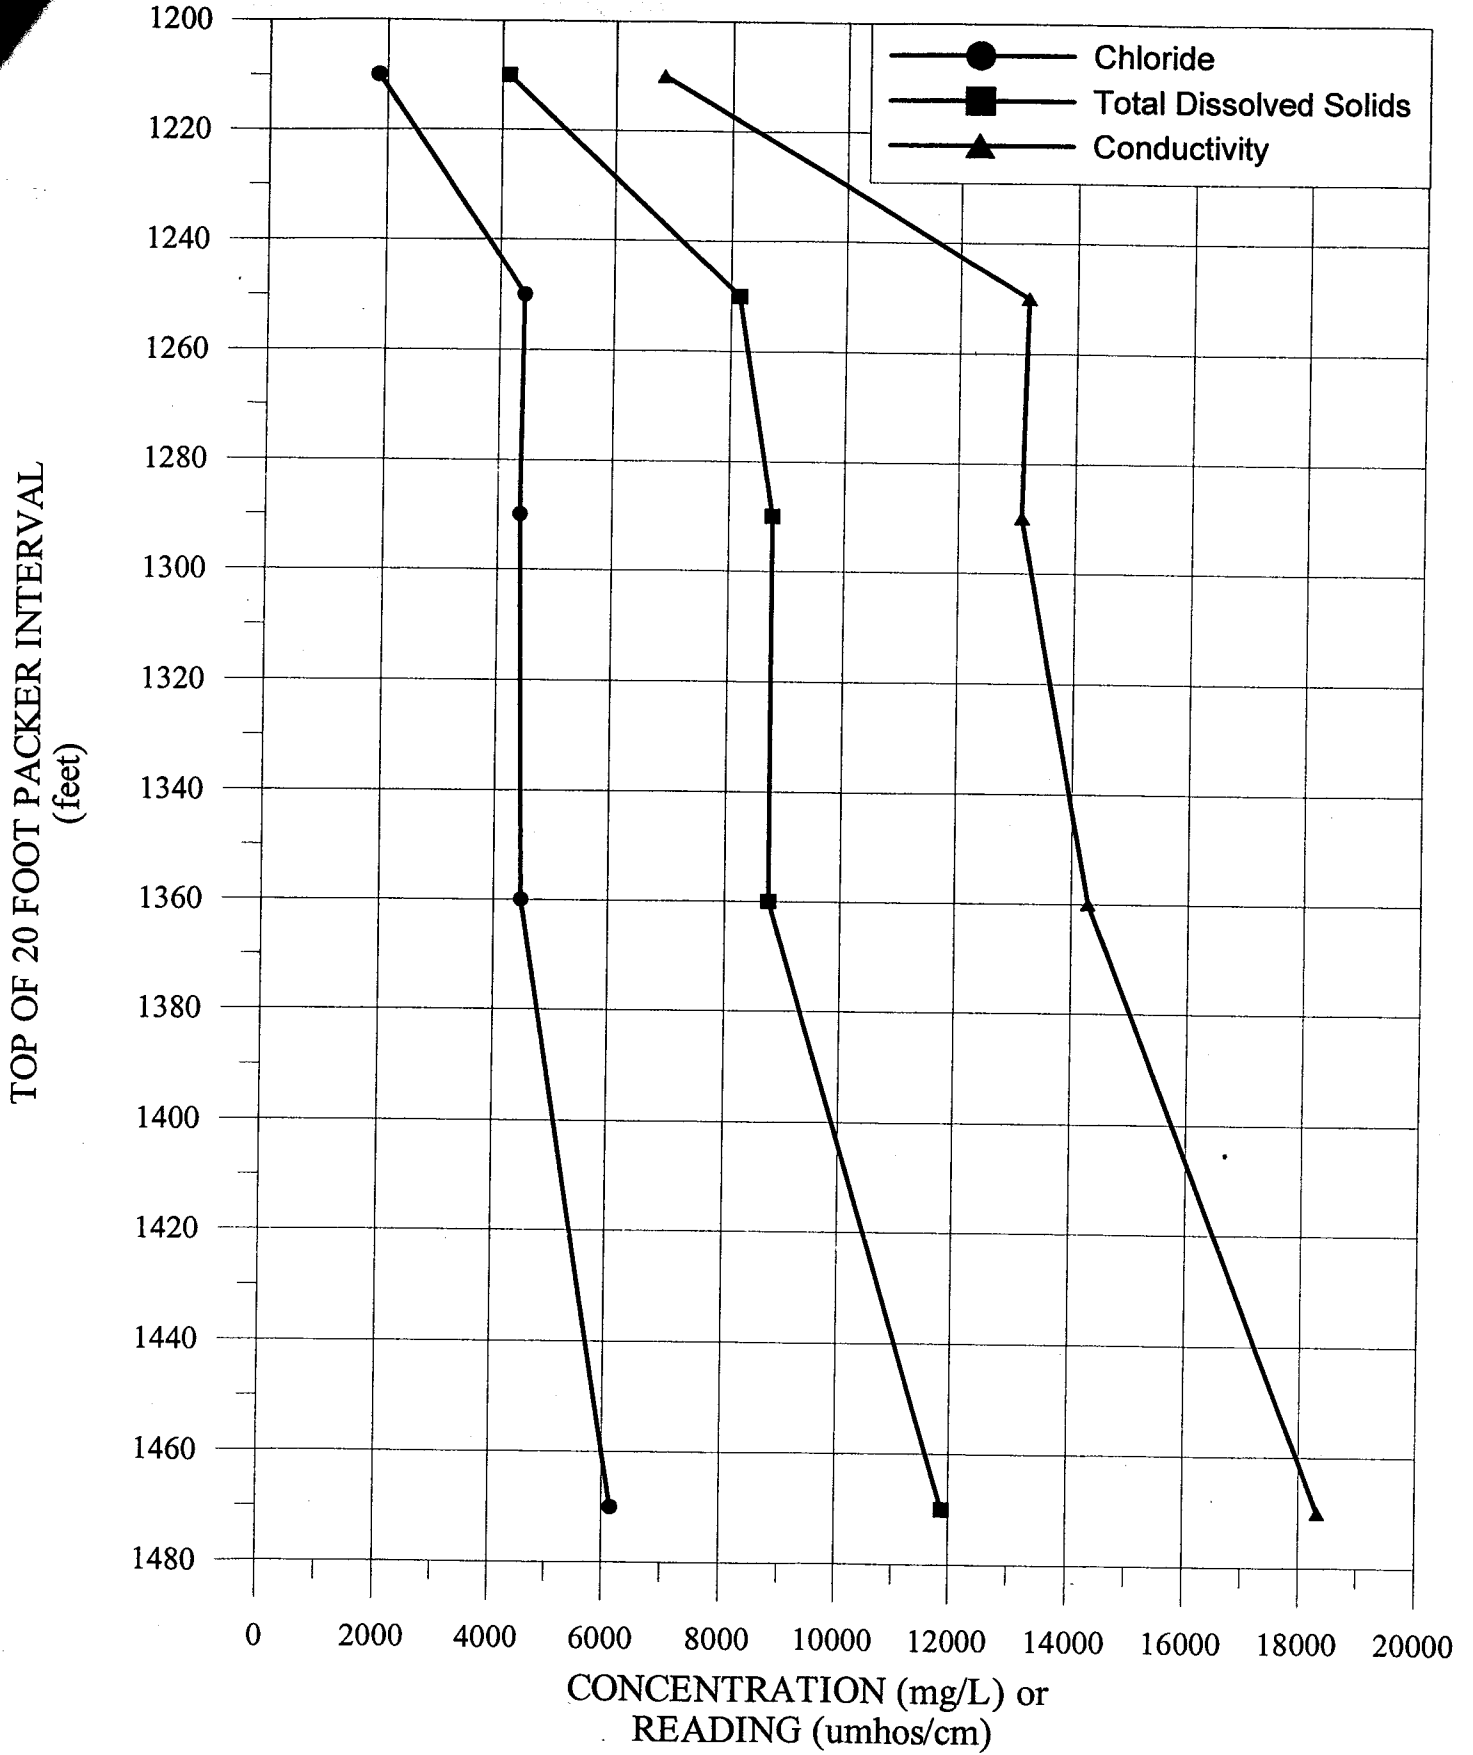

CITY OF NORTH MIAMI BEACH
WATER QUALITY FOR WELL 1F
ANNULUS TEST RESULTS

