


STU-MZL, -M24



11-8-06
(N)

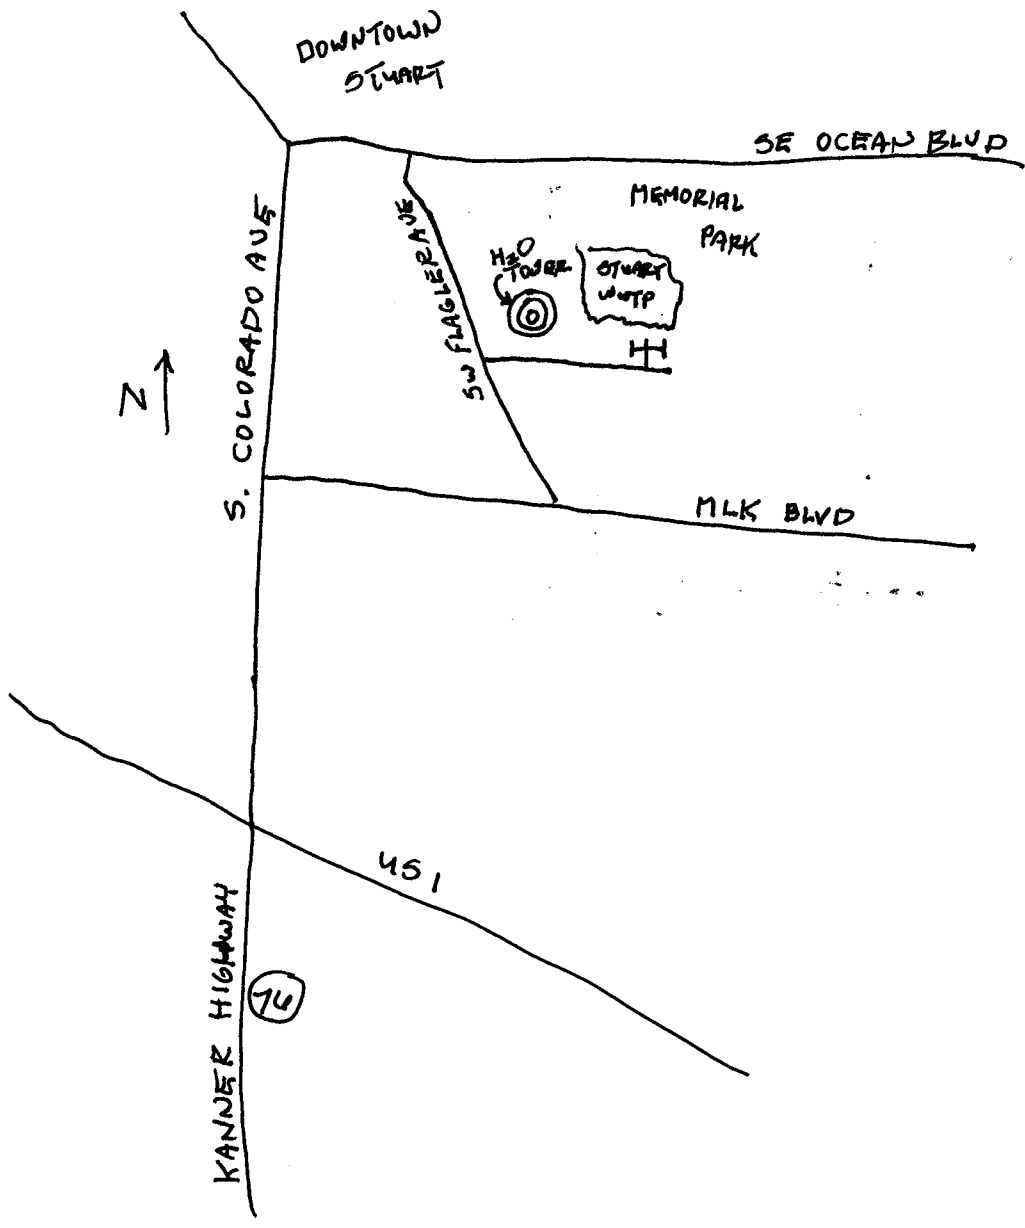

STU - MZL
- MZU

11-8-06
①

---- SIDEWALK
xxxxx Fence

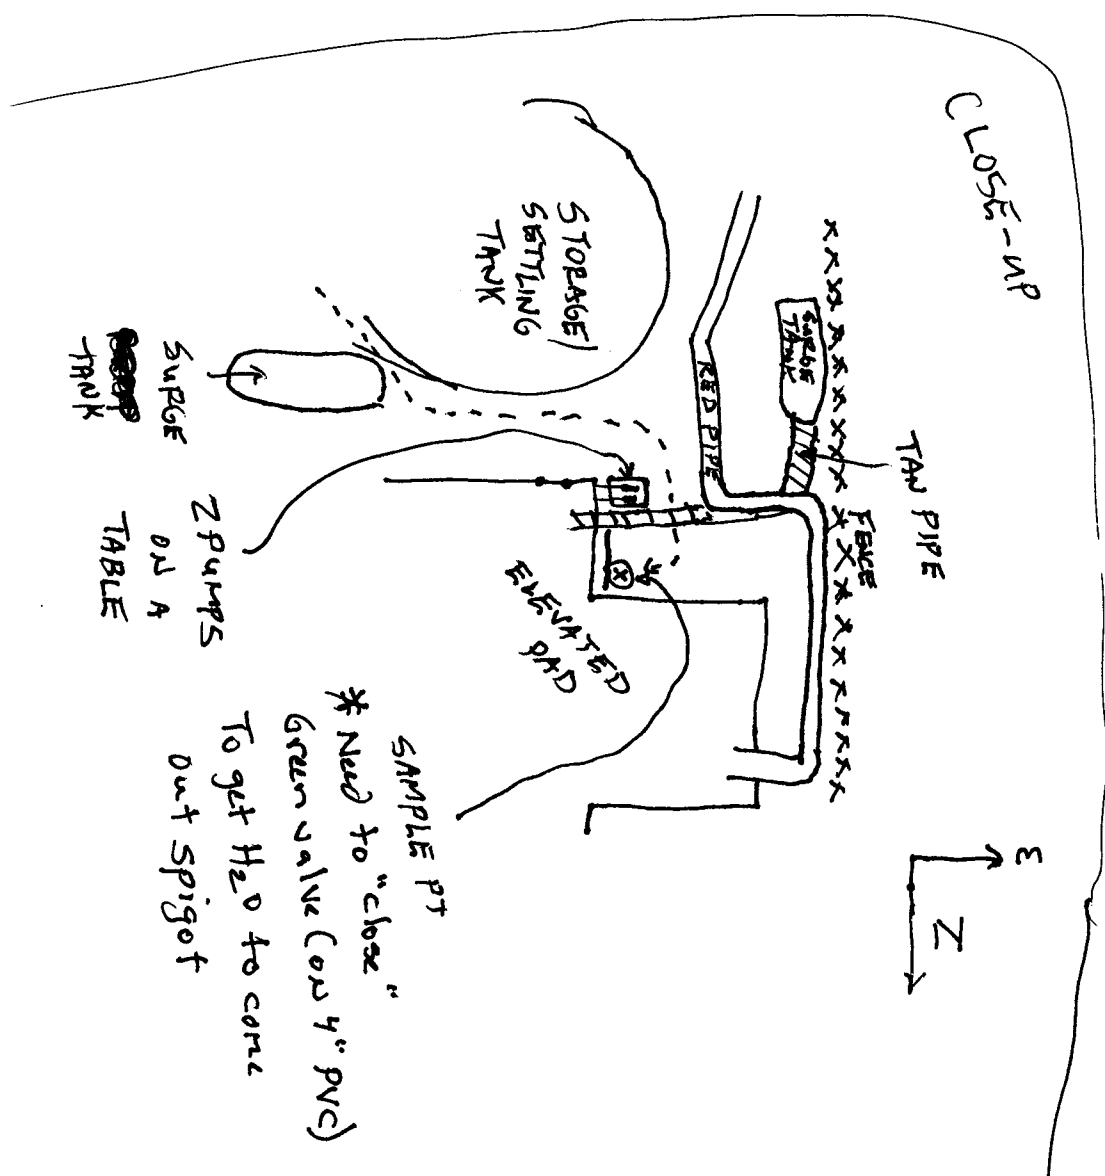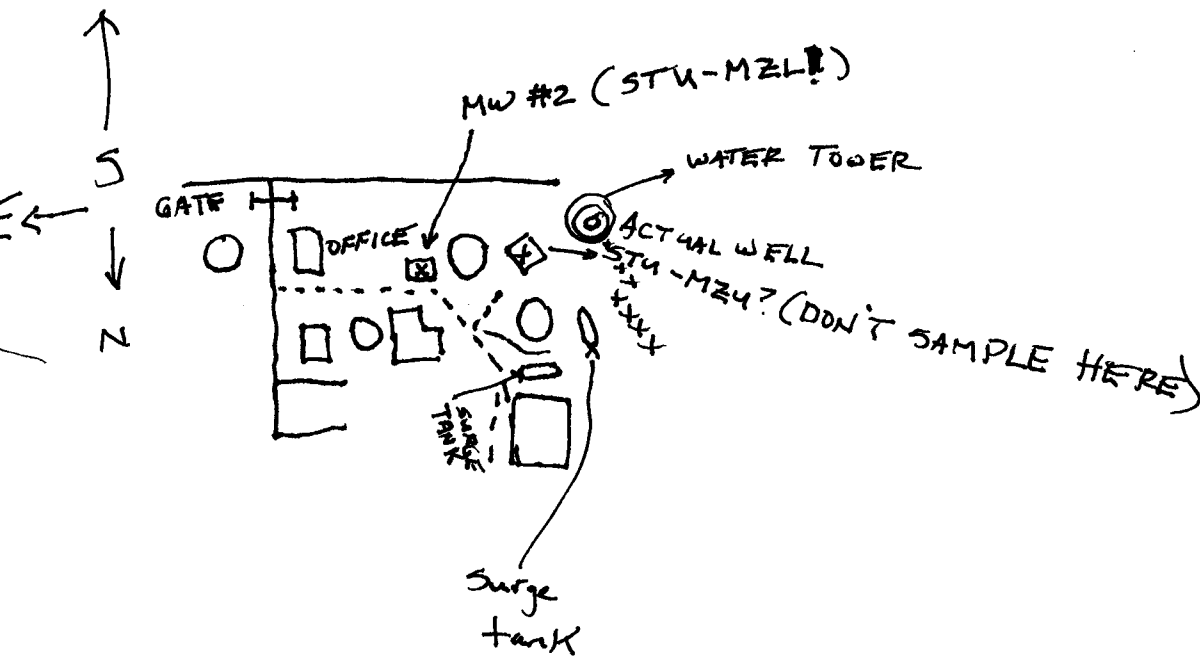

STUART WWTP

RFGW

NR 11-8-06

STU-MZL, -MZU



AR 1010

SAMPLING → CALL THE DAY BEFORE
THEY WILL PURGE THE
WELLS

1ST PIC → (Facing West)
MW #2 6" DIA

STU-MZL

Sample spot on left (green handle)

2ND PIC → (Facing West) STU-MZU
16" DIA

Well, H₂O Tower in background

3RD PIC → Draw path in between 2 tanks to
reach actual well, draw path between
tank in middle + surge pump to reach sample
pt.

4TH PIC - facing 2ND surge tank → draw path
to right

5TH PIC → 2 pumps on table + tan pipe
needed to cross to sample

6TH PIC - sample pt
while well is pumping/purging, close
green valve on (3"?) PVC pipe to get H₂O
to discharge thru 2" PVC
(1.5"?)

LV 1115