
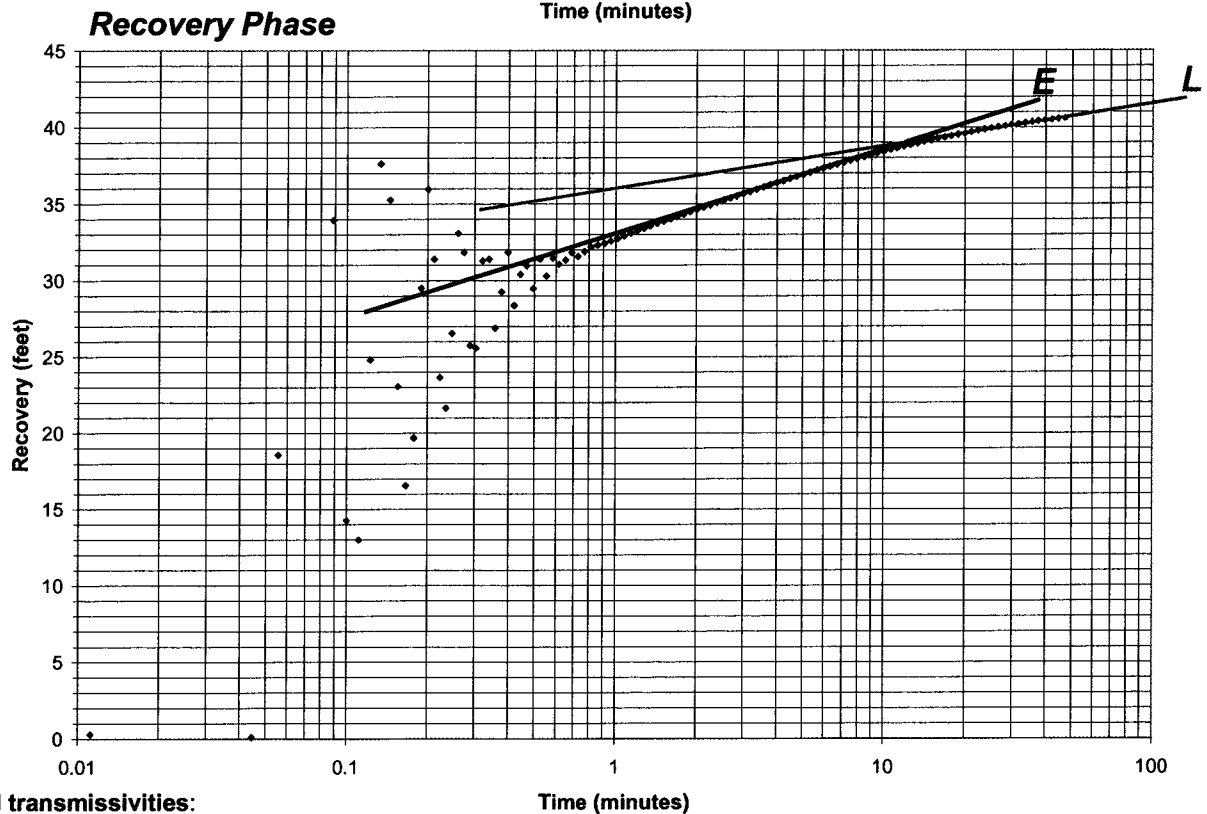


**Figure 4-1**  
**PBCWUD Lake Region Water Treatment Plant**  
**Observation well, pumping phase**

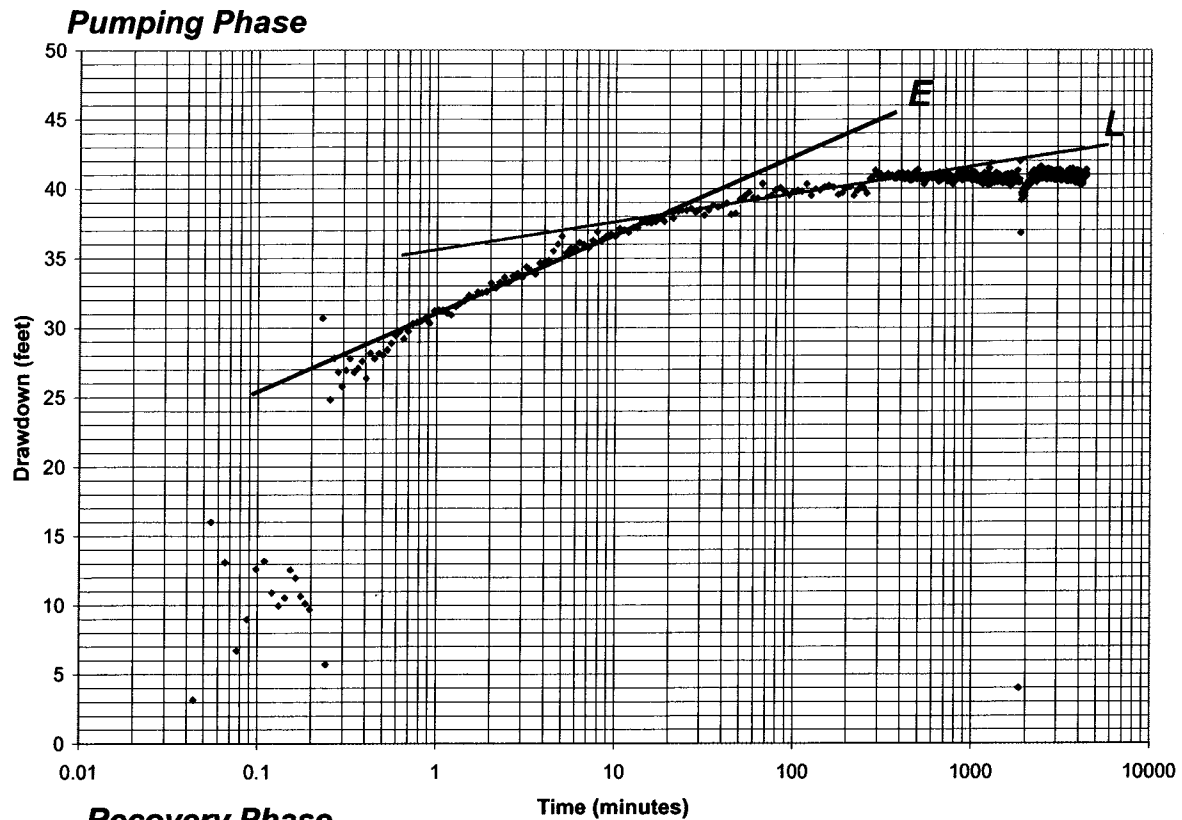

**Calculated transmissivities:**

Pumping phase early (E) data = 51,800 gpd/ft,

Pumping phase late (L) data = 189,000 gpd/ft

Recovery phase early (E) data = 75,000 gpd/ft

Recovery phase late (L) data = 135,000 gpd/ft

**Figure 4-2**

**PBCWUD - Lake Region Water Treatment Plant  
Aquifer Performance Test -Pumping Well (TP-1) Data**