



FORM 0395
Rev 10/87

SOUTH FLORIDA WATER MANAGEMENT DISTRICT


WELL LOCATION

County OKEECHOBEE
 Station I. D. 0930000017
 Date 11/19/92 Well No. OKF-96D
 Latitude 27° 31.29' Longitude 80° 57.05'
 NE $\frac{1}{4}$ SE $\frac{1}{4}$ NW $\frac{1}{4}$ Section 32 Township 34S Range 34E
 Owner S.F.W.M.D. (1st RANCH) Phone _____
 Driller T. LARRANO Date Drilled 11/8/92
 WELL CONSTRUCTION
 Drilling Method: Rot. Air Auger _____ Other _____
 T. Depth - Driller 855' T. Depth - Logger 854'
 Casing Depth Driller 360' Casing Depth Logger 360'
 Bit Size 5 7/8" Casing Dia. I.D. 5.8" / 7.8"
 Hole Dia. 8" From 0' To 80' Dia. 6" From 80' To 854'
 Type of Casing P.V.C. Casing Thickness 0.2"
 Type of Screen OPEN HOLE Screen Int. From _____ To _____
 Type of Packing _____ Well Use PUMP TEST
 Static Water Level 23' Date 11/19/92
 Yield Flow _____ Pump 90 G.P.M.

WELL LOG

DATUM
 K.B. _____ L.S. + 67.00 NGVD T.O.C. _____
 FLUID QUALITY
 Date _____ Time _____ Source of Sample _____
 Cl _____ mg/l Type of Fluid _____ @ _____ °C
 Temp. _____ °C Field Density _____ @ _____ °C
 T.D.S. _____ mg/l Spec. Cond. _____ μ mhos/cm
 Logged By: E.P. DUBENHAUER Witnessed By: J. HERR
 Comments: Well was pumped with 2" pump at 90 G.P.M. For Temp & Flow Logs.

TYPE OF SURVEYS RUN
 Lateral 6'
 Calliper
 Flow meter
 16" 64" normals
 Neutron
 Natural Gamma
 Fluid Resistivity
 Density
 ccl
 Fluid Sampler
 Temperature
 Delta Temp.
 SP
 Single pt. Res.

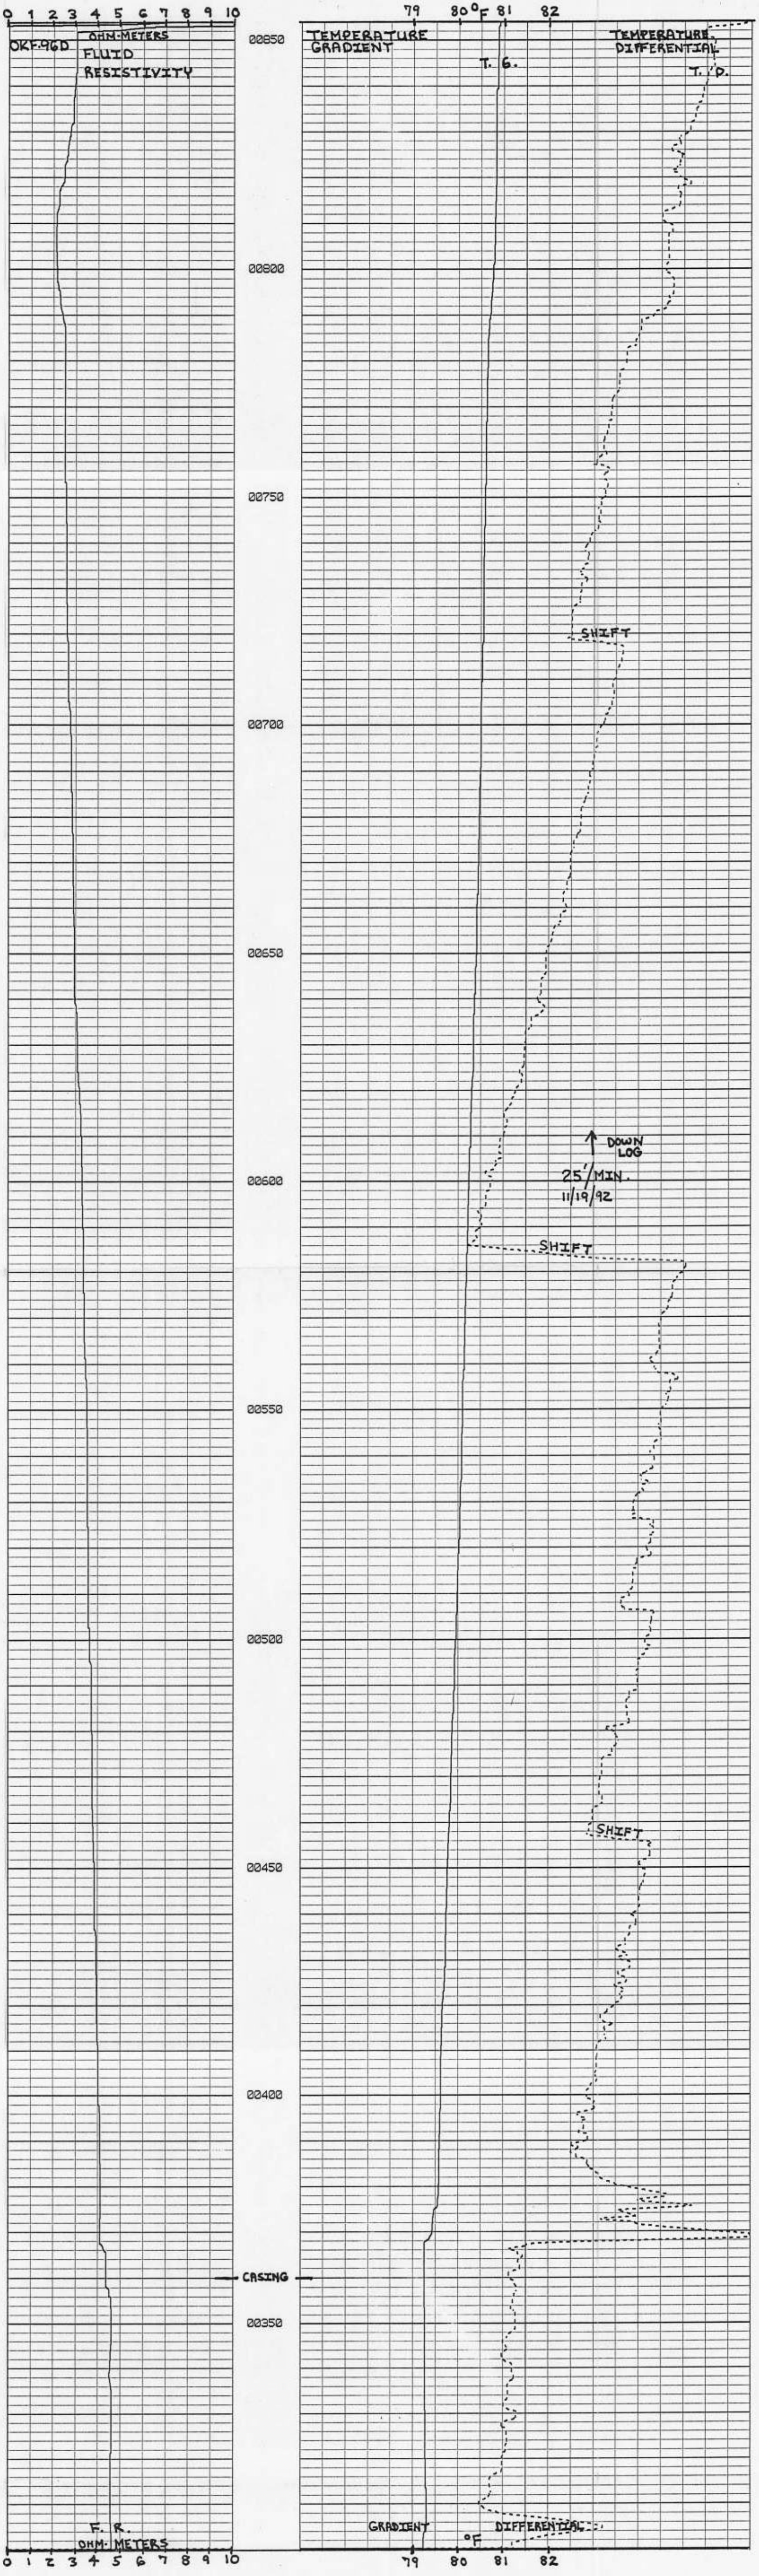



FORM 0395
Rev. 10/87

SOUTH FLORIDA WATER MANAGEMENT DISTRICT

WELL LOG

WELL LOCATION

County OKECHOBEE

Station I. D. 0 9 3 0 0 0 0 0 7 9

Date 06/04/93 Well No. OKF-96P

Latitude 27° 31' 24" Longitude 80° 57' 07"

S.W. 1/4 S.W. 1/4 SE 1/4 Section 08 Township 34S Range 34E

Owner S.F. WILM.D. Phone (407) 686-8800

Driller T. LUGERANO Date Drilled _____

WELL CONSTRUCTION

Drilling Method: Rot. Air CT Auger Other _____

T. Depth - Driller _____ T. Depth - Logger 500'

Casing Depth Driller _____ Casing Depth Logger 352'

Bit Size _____ Casing Dia. I.D. 7.8"

Hole Dia. 8" From 0' To 66' Dia. 6" From 66' To 500'

Type of Casing P.V.C. Casing Thickness 0.2"

Type of Screen OPENHOLE Screen Int. From _____ To _____

Type of Packing _____ Well Use MONITORS/A.P.T.

Static Water Level -25.00' Date _____

Yield Flow _____ Pump _____

DATUM

K.B. _____ L.S. +69.00' N.G.V.D. T.O.C. +1.0'

FLUID QUALITY

Date _____ Time _____ Source of Sample _____

Cl _____ mg/l Type of Fluid _____

Temp. _____ °C Field Density _____ @ _____ °C

T.D.S. _____ mg/l Spec. Cond. _____ μmhos/cm

Logged By: E.R. DAUENHAUER Witnessed By: S. HEER

Comments: _____

TYPE OF SURVEYS RUN

- | | | | |
|-------------------|-------------------------------------|---------------|-------------------------------------|
| Lateral 6' | <input checked="" type="checkbox"/> | Density | <input type="checkbox"/> |
| Caliper | <input checked="" type="checkbox"/> | ocl | <input type="checkbox"/> |
| Flow meter | <input type="checkbox"/> | Fluid Sampler | <input type="checkbox"/> |
| 16" 64" normals | <input type="checkbox"/> | Temperature | <input type="checkbox"/> |
| Neutron | <input checked="" type="checkbox"/> | Delta Temp. | <input checked="" type="checkbox"/> |
| Natural Gamma | <input checked="" type="checkbox"/> | SP | <input checked="" type="checkbox"/> |
| Fluid Resistivity | <input checked="" type="checkbox"/> | Single pt. | <input checked="" type="checkbox"/> |

FT. DEPTH SURV. (57)

OKF-96P





FORM 0395
Rev. 10/87

SOUTH FLORIDA WATER MANAGEMENT DISTRICT

WELL LOCATION

County OKECHOBEE
 Station I. D. 093000079
 Date 06/09/93 Well No. OKF-96P
 Latitude 27° 31' 24" Longitude 80° 57' 07"
 SW $\frac{1}{4}$ SW $\frac{1}{4}$ SE $\frac{1}{4}$ Section 08 Township 34S Range 34E
 Owner S.F.W.M.D. Phone (407) 686-8800
 Driller J. L. LUBIANO Date Drilled _____
 WELL CONSTRUCTION _____
 Drilling Method: Rot X Air CT Auger _____ Other _____
 T. Depth - Driller _____ T. Depth - Logger 500'
 Casing Depth Driller _____ Casing Depth Logger 352'
 Bit Size _____ Casing Dia. I.D. 7.8"
 Hole Dia. 8" From 0' To 66' Dia. 6" From 66' To 500'
 Type of Casing P.V.C. Casing Thickness 0.2"
 Type of Screen OPENHOLE Screen Int. From _____ To _____
 Type of Packing _____ Well Use MONITOR/A.P.T.
 Static Water Level -25.00' Date _____
 Yield Flow _____ Pump _____



WELL LOG

DATUM _____ K.B. _____ L.S. +69.00' N.G.V.D. T.O.C. +1.0'
 FLUID QUALITY _____
 Date _____ Time _____ Source of Sample _____
 Cl _____ mg/l Type of Fluid _____
 Temp. _____ °C Field Density _____ @ _____ °C
 T.D.S. _____ mg/l Spec. Cond. _____ μ mhos/cm
 Logged By: E.P. DAUENHAUER Witnessed By: J. HERR
 Comments: _____

TYPE OF SURVEYS RUN

Lateral 6'	<input checked="" type="checkbox"/>	Density	<input type="checkbox"/>
Caliper	<input checked="" type="checkbox"/>	ocl	<input type="checkbox"/>
Flow meter	<input type="checkbox"/>	Fluid Sampler	<input type="checkbox"/>
16", 64" normals	<input checked="" type="checkbox"/>	Temperature	<input checked="" type="checkbox"/>
Neutron	<input checked="" type="checkbox"/>	Delta Temp.	<input checked="" type="checkbox"/>
Natural Gamma	<input checked="" type="checkbox"/>	SP	<input checked="" type="checkbox"/>
Fluid Resistivity	<input checked="" type="checkbox"/>	Single-pt.	<input checked="" type="checkbox"/>

FT. DRUM S.W. (57)

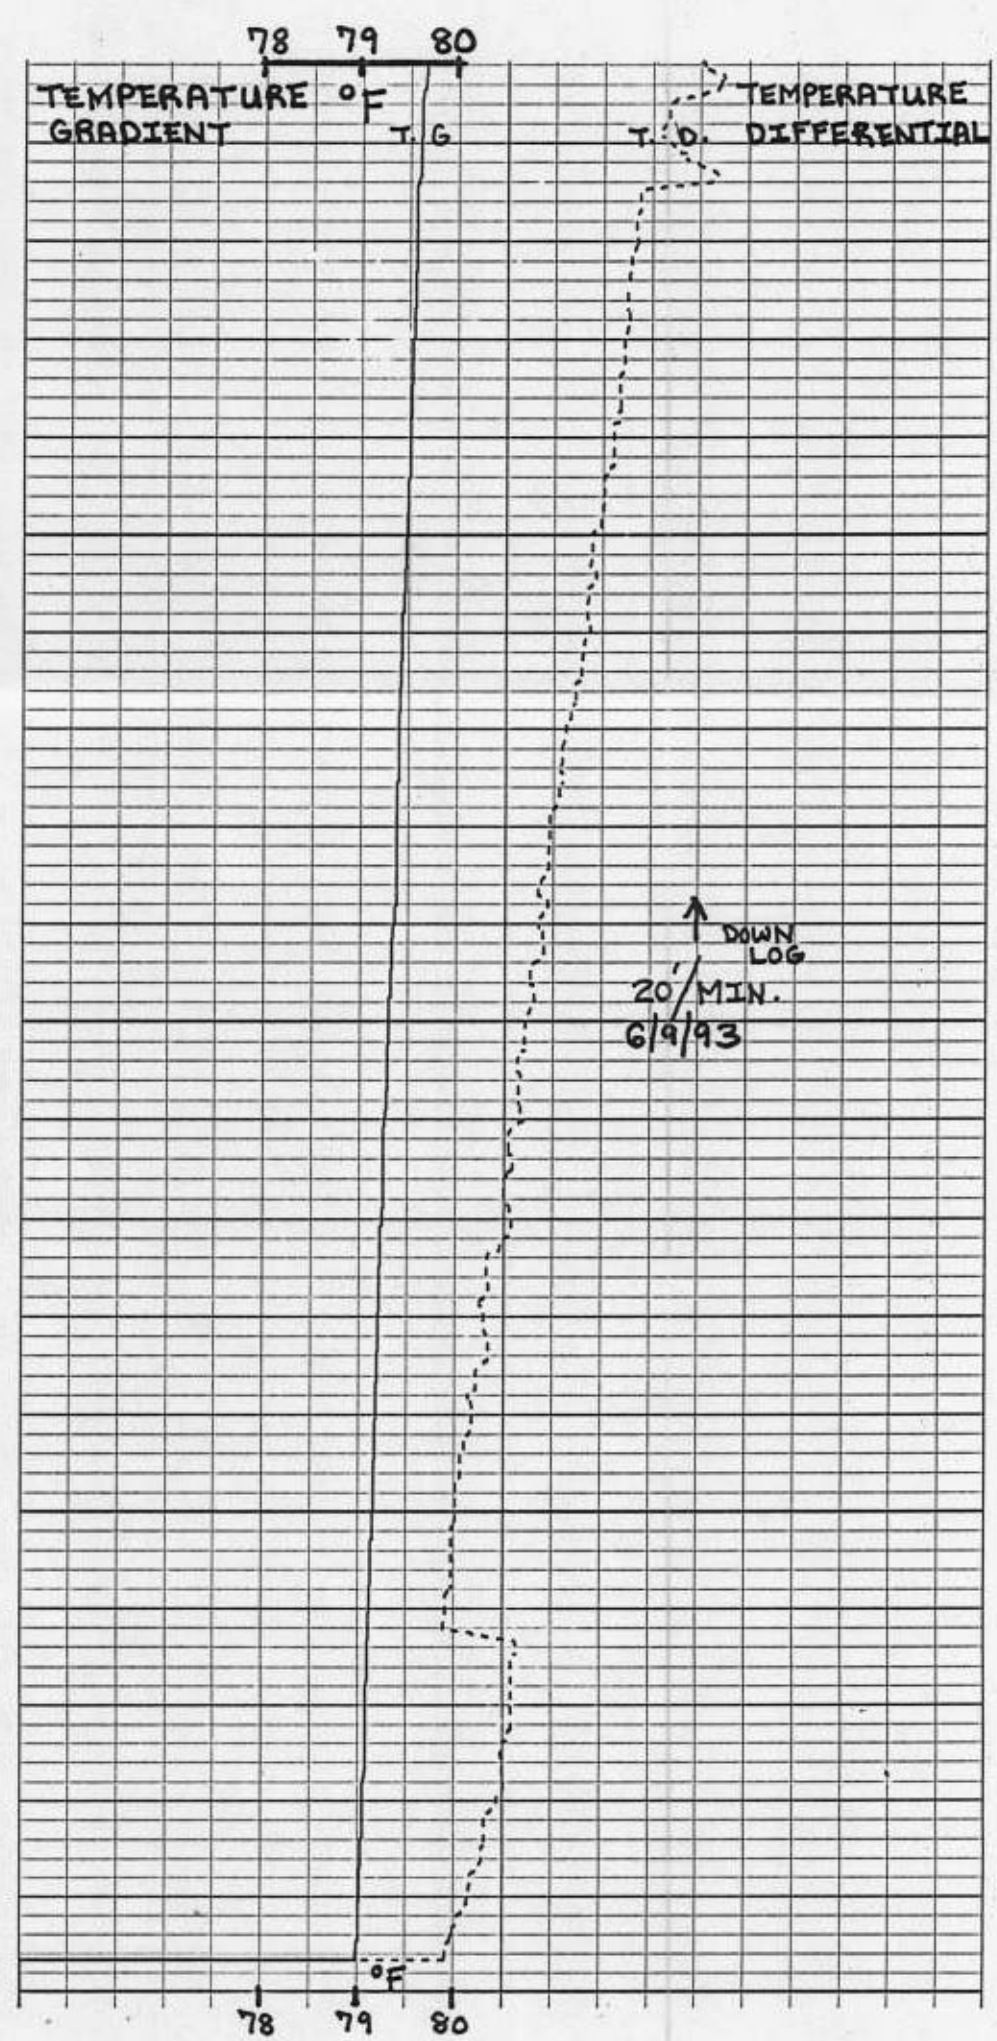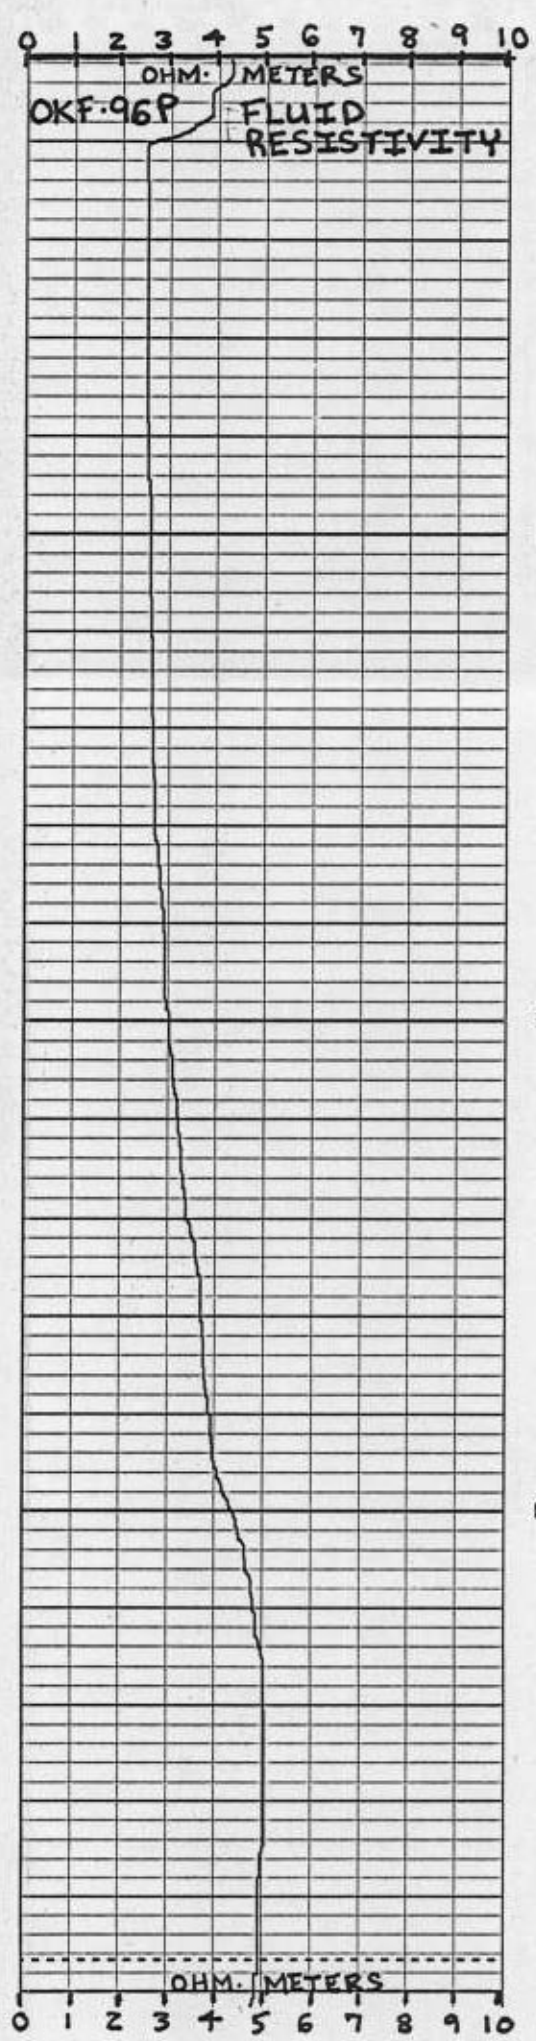



FORM 0395
Rev. 10/87

SOUTH FLORIDA WATER MANAGEMENT DISTRICT

WELL LOG

WELL LOCATION

County OKEECHOBEE

Station I. D. 093000019

Date 06/09/93 Well No. OKF-96P

Latitude 27° 31' 24" Longitude 80° 57' 07"

SW $\frac{1}{4}$ SW $\frac{1}{4}$ SE $\frac{1}{4}$ Section 08 Township 34S Range 34E

Owner S.F.W.M.D. Phone (407) 686-8800

Driller T. LUGERANO Date Drilled _____

WELL CONSTRUCTION

Drilling Method: Rot. Air CT Auger Other _____

T. Depth - Driller _____ T. Depth - Logger 500'

Casing Depth Driller _____ Casing Depth Logger 352'

Bit Size _____ Casing Dia. I.D. 7.8"

Hole Dia. 8" From 0' To 66' Dia. 6" From 66' To 500'

Type of Casing P.V.C. Casing Thickness 0.2"

Type of Screen OPENHOLE Screen Int. From _____ To _____

Type of Packing _____ Well Use MONITOR/A.P.T.

Static Water Level -25.00' Date _____

Yield Flow _____ Pump _____

DATUM

K.B. _____ L.S. + 69.00' N.G.V.D. T.O.C. +1.0'

FLUID QUALITY

Date _____ Time _____ Source of Sample _____

Cl _____ mg/l Type of Fluid _____

Temp. _____ °C Field Density _____ @ _____ °C

T.D.S. _____ mg/l Spec. Cond. _____ μ mhos/cm


Logged By: E.P. DALENSHAUER Witnessed By: J. HEER

Comments: _____

TYPE OF SURVEYS RUN

- | | | | |
|-------------------|-------------------------------------|---------------|-------------------------------------|
| Lateral 6' | <input checked="" type="checkbox"/> | Density | <input type="checkbox"/> |
| Caliper | <input checked="" type="checkbox"/> | cel | <input type="checkbox"/> |
| Flow meter | <input type="checkbox"/> | Fluid Sampler | <input type="checkbox"/> |
| 16", 64" normals | <input checked="" type="checkbox"/> | Temperature | <input checked="" type="checkbox"/> |
| Neutron | <input checked="" type="checkbox"/> | Delta Temp. | <input checked="" type="checkbox"/> |
| Natural Gamma | <input checked="" type="checkbox"/> | SP | <input checked="" type="checkbox"/> |
| Fluid Resistivity | <input checked="" type="checkbox"/> | Single-pt. | <input checked="" type="checkbox"/> |

FT. DEPTH SCALE (57)

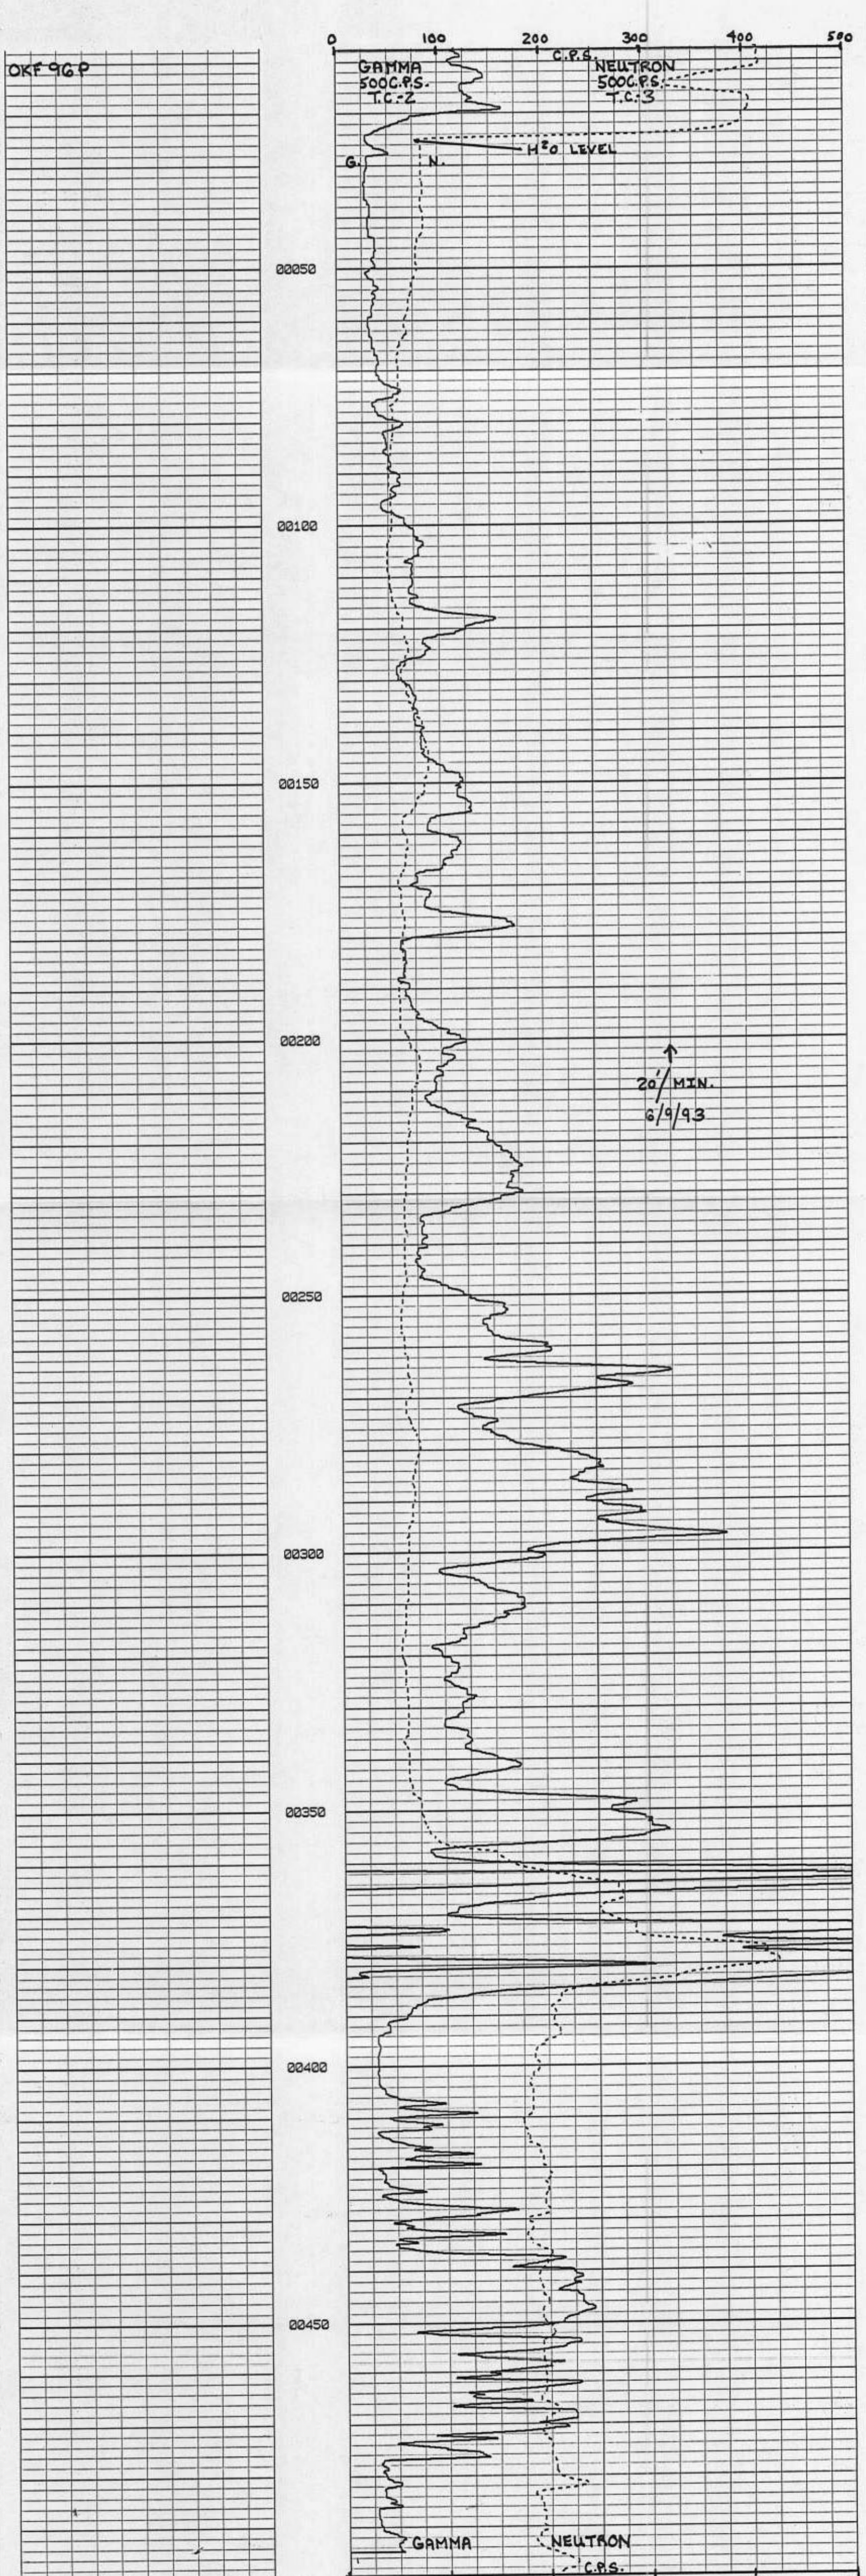

OKF 96P



FORM 0395
Rev. 10/87

SOUTH FLORIDA WATER MANAGEMENT DISTRICT

WELL LOCATION

County OKEECHOBEE

Station I. D. 093000079

Date 06/09/93 Well No. OKF-96P

Latitude 27° 31' 24" Longitude 80° 57' 07"

SW 1/4 SW 1/4 SE 1/4 Section 08 Township 34S Range 34E

Owner S.F.W.M.D. Phone (407) 686-8800

Driller T. LUBRANO Date Drilled _____

WELL CONSTRUCTION

Drilling Method: Rot. X Air CT Auger _____ Other _____

T. Depth - Driller _____ T. Depth - Logger 500'

Casing Depth Driller _____ Casing Depth Logger 352'

Bit Size _____ Casing Dia. I.D. 7.8"

Hole Dia. 8" From 0' To 66' Dia. 6" From 66' To 500'

Type of Casing P.V.C. Casing Thickness 0.2"

Type of Screen OPENHOLE Screen Int. From _____ To _____

Type of Packing _____ Well Use Monitor/A.P.T.

Static Water Level -25.00' Date _____

Yield Flow _____ Pump _____

WELL LOG

DATUM

K.B. _____ L.S. +69.00' N.G.V.D. T.O.C. +1.0'

FLUID QUALITY

Date _____ Time _____ Source of Sample _____

Cl _____ mg/l Type of Fluid _____

Temp. _____ °C Field Density _____ @ _____ °C

T.D.S. _____ mg/l Spec. Cond. _____ μmhos/cm


Logged By: E.P. DAUENHAUER Witnessed By: J. HERR

Comments:

TYPE OF SURVEYS RUN

- | | | | |
|-------------------|-------------------------------------|---------------|-------------------------------------|
| Lateral 6' | <input checked="" type="checkbox"/> | Density | <input type="checkbox"/> |
| Caliper | <input checked="" type="checkbox"/> | ocl | <input type="checkbox"/> |
| Flow meter | <input type="checkbox"/> | Fluid Sampler | <input type="checkbox"/> |
| 16", 64" normals | <input checked="" type="checkbox"/> | Temperature | <input checked="" type="checkbox"/> |
| Neutron | <input checked="" type="checkbox"/> | Delta Temp. | <input checked="" type="checkbox"/> |
| Natural Gamma | <input checked="" type="checkbox"/> | SP | <input checked="" type="checkbox"/> |
| Fluid Resistivity | <input checked="" type="checkbox"/> | Single pt. | <input checked="" type="checkbox"/> |

FT. DRUM SW (57)

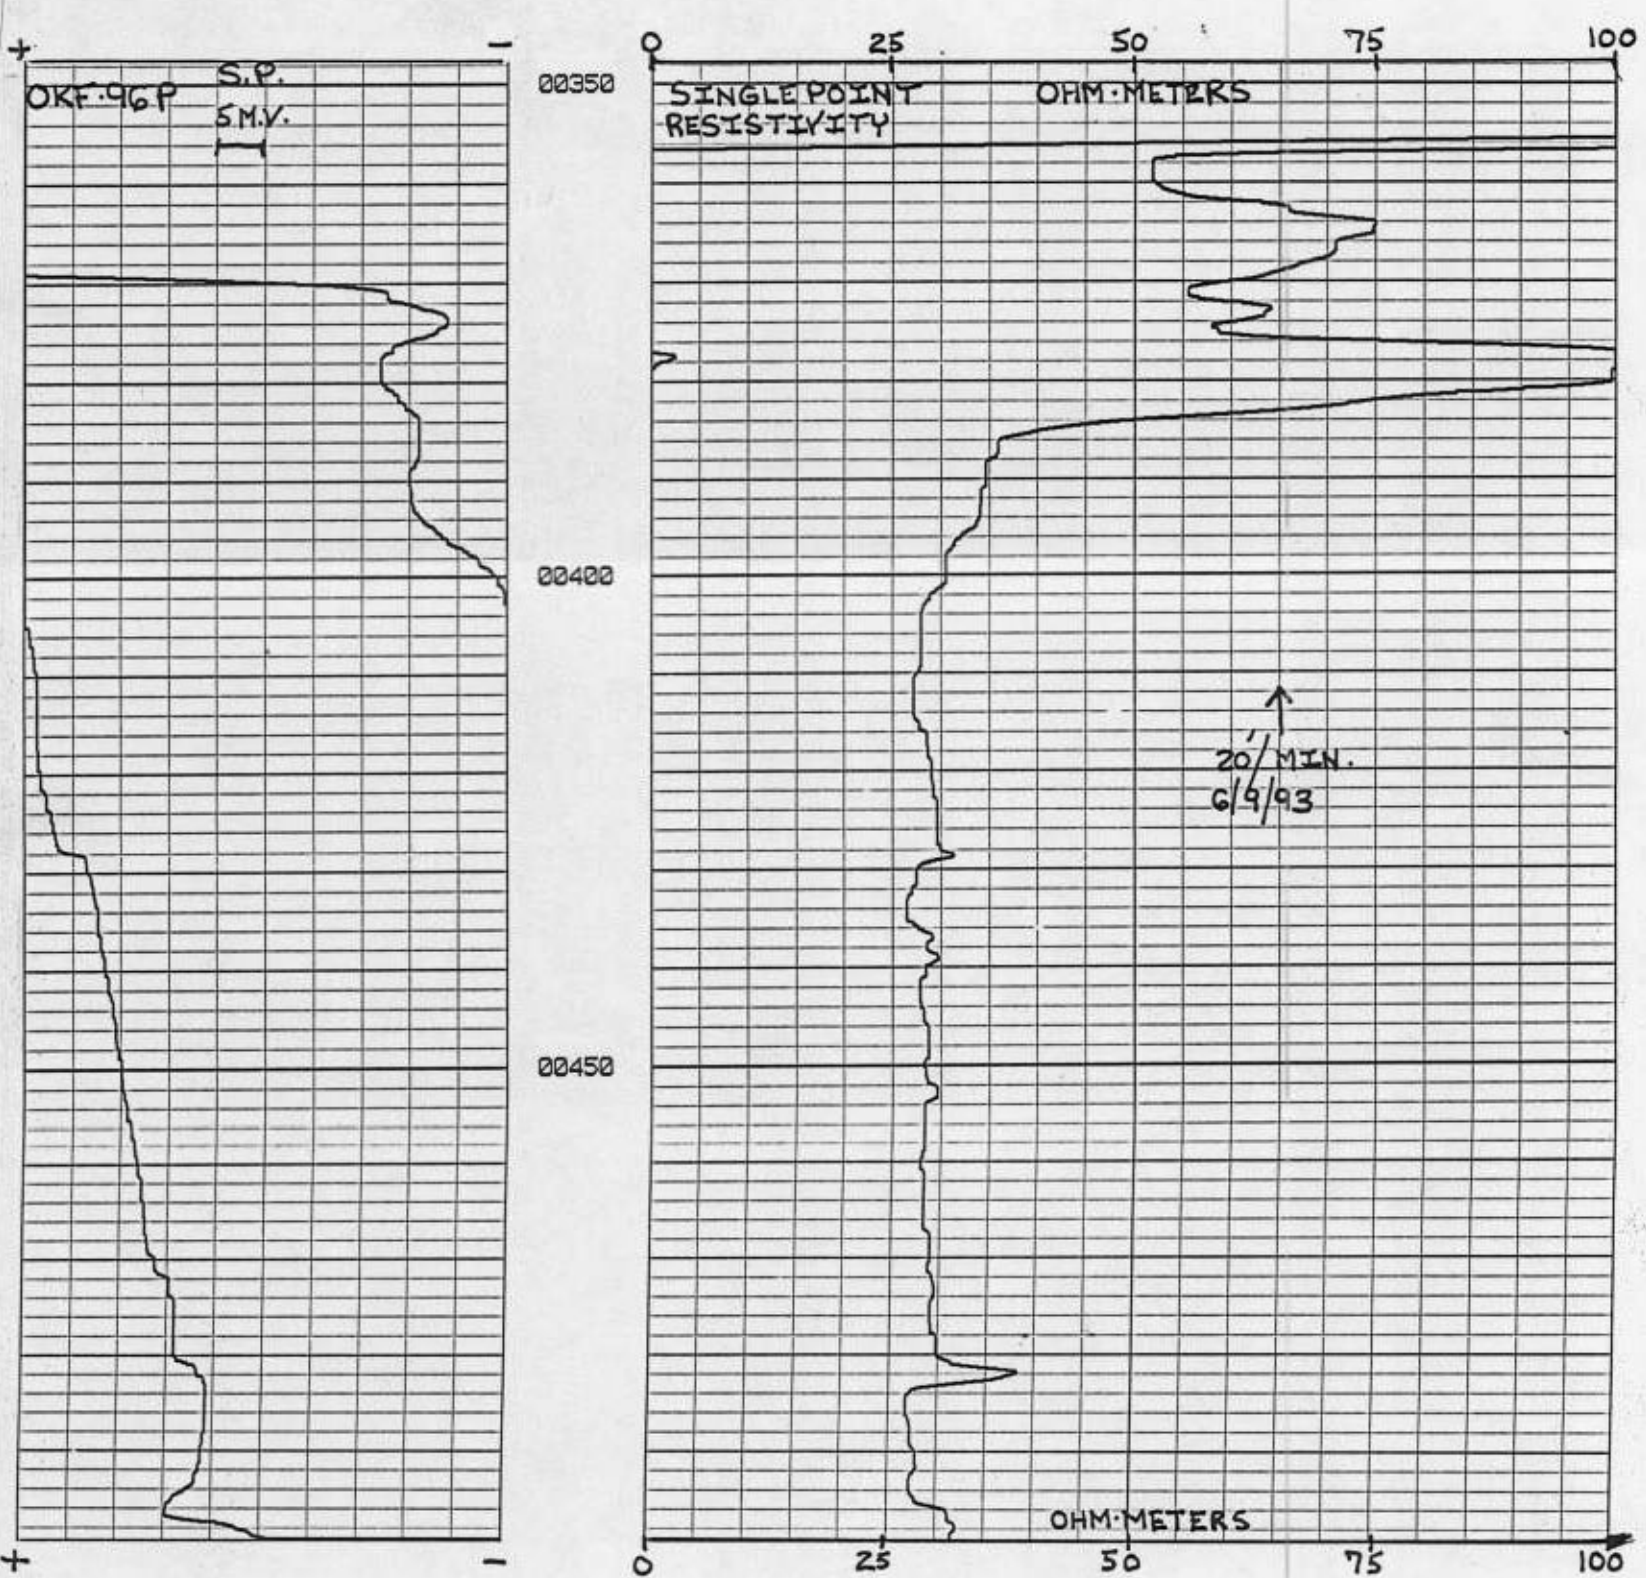



FORM 0395
Rev. 10/87

SOUTH FLORIDA WATER MANAGEMENT DISTRICT

WELL LOCATION

County OKEECHOBEE

Station I. D. 0 2 3 0 0 0 0 7 9

Date 06/09/93 Well No. OKF-96P

Latitude 27° 31' 24" Longitude 80° 57' 07"

SW $\frac{1}{4}$ SW $\frac{1}{4}$ SE $\frac{1}{4}$ SW Section 08 Township 34S Range 34E

Owner S.E.W.M.D. Phone (407) 686-8800

Driller T. LUBRANO Date Drilled _____

WELL CONSTRUCTION

Drilling Method: Rot. Air CT Auger Other _____

T. Depth - Driller _____ T. Depth - Logger 500'

Casing Depth Driller _____ Casing Depth Logger 352'

Bit Size _____ Casing Dia. I.D. 7.8"

Hole Dia. 8" From 0' To 66' Dia. 6" From 66' To 500'

Type of Casing P.V.C. Casing Thickness 0.2"

Type of Screen OPEN HOLE Screen Int. From _____ To _____

Type of Packing _____ Well Use MONITOR/A.P.T.

Static Water Level -25.00' Date _____

Yield Flow _____ Pump _____

WELL LOG

DATUM

K.B. _____ L.S. + 69.00' N.G.V.D. T.O.C. +1.0'

FLUID QUALITY

Date _____ Time _____ Source of Sample _____

Cl _____ mg/l Type of Fluid _____

Temp. _____ °C Field Density _____ @ _____ °C

T.D.S. _____ mg/l Spec. Cond. _____ μ mhos/cm


Logged By: E.P. DAUENHAUER Witnessed By: J. HEER

Comments: _____

TYPE OF SURVEYS RUN

- | | | | |
|-------------------|-------------------------------------|---------------|-------------------------------------|
| Lateral 6' | <input checked="" type="checkbox"/> | Density | <input type="checkbox"/> |
| Caliper | <input checked="" type="checkbox"/> | ccl | <input type="checkbox"/> |
| Flow meter | <input type="checkbox"/> | Fluid Sampler | <input type="checkbox"/> |
| 16", 64" normals | <input checked="" type="checkbox"/> | Temperature | <input type="checkbox"/> |
| Neutron | <input checked="" type="checkbox"/> | Delta Temp. | <input checked="" type="checkbox"/> |
| Natural Gamma | <input checked="" type="checkbox"/> | SP | <input checked="" type="checkbox"/> |
| Fluid Resistivity | <input checked="" type="checkbox"/> | Single pt. | <input checked="" type="checkbox"/> |

FT. DRUM S.W. (57)

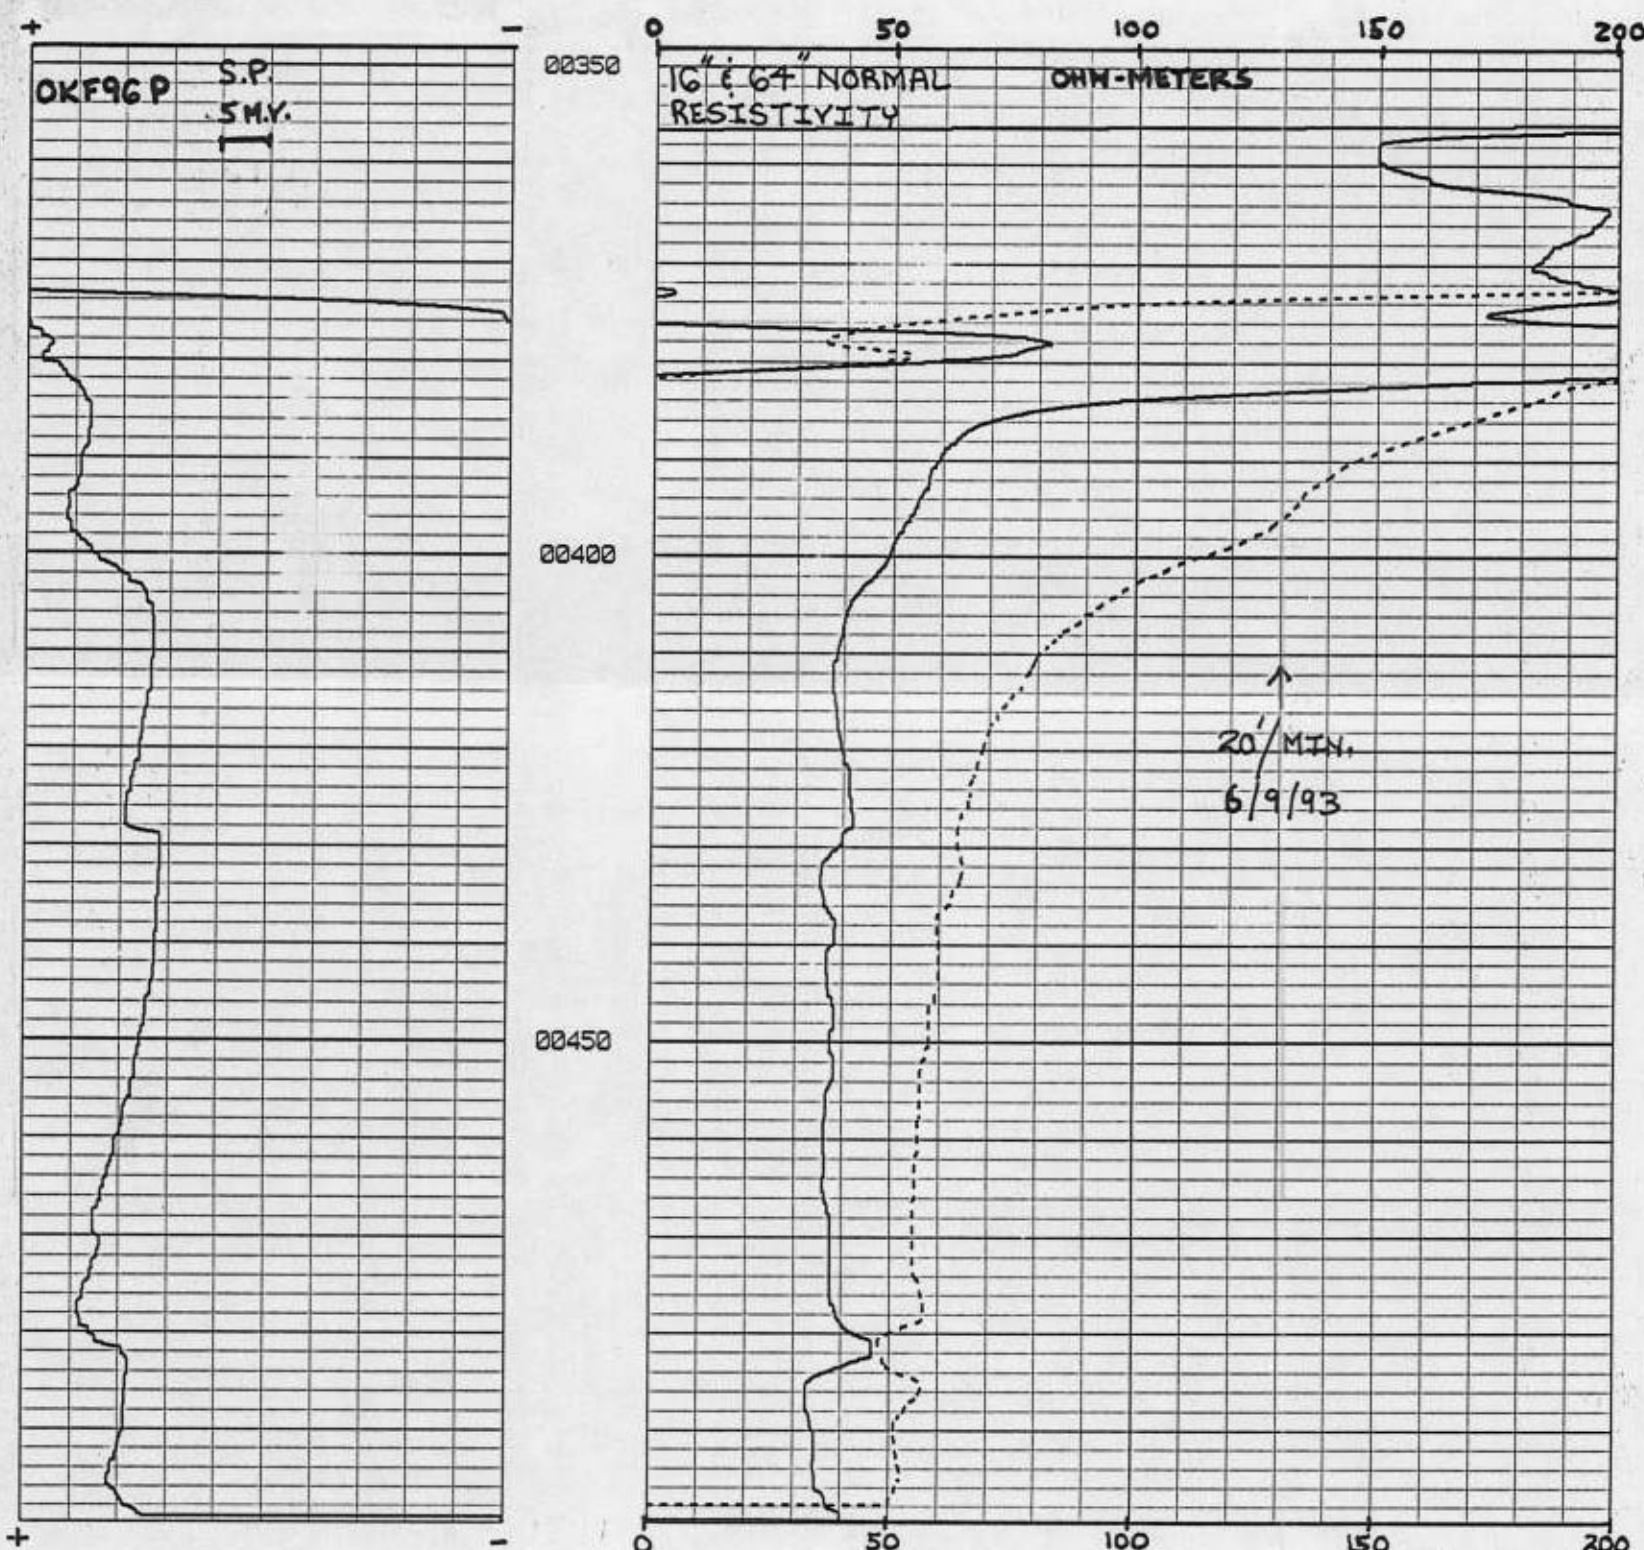



FORM 0395
Rev 10/87

SOUTH FLORIDA WATER MANAGEMENT DISTRICT

WELL LOCATION

County OKECHOBEE
 Station I. D. 093000079
 Date 06/09/93 Well No. OKF-96P
 Latitude 27° 31' 24" Longitude 80° 57' 07"
 SW $\frac{1}{4}$ SW $\frac{1}{4}$ SE $\frac{1}{4}$ Section 08 Township 34S Range 34E
 Owner S.F.W.M.D. Phone (407) 686-8800
 Driller T. LUBRANO Date Drilled _____
 WELL CONSTRUCTION
 Drilling Method: Rot. Air Auger Other _____
 T. Depth - Driller _____ T. Depth - Logger 500'
 Casing Depth Driller _____ Casing Depth Logger 352'
 Bit Size _____ Casing Dia. I.D. 7.8"
 Hole Dia. 8" From 0' To 66' Dia. 6" From 66' To 500'
 Type of Casing P.V.C. Casing Thickness 0.2"
 Type of Screen OPENHOLE Screen Int. From _____ To _____
 Type of Packing _____ Well Use MONITOR/A.P.T.
 Static Water Level -25.00' Date _____
 Yield Flow _____ Pump _____

WELL LOG

DATUM
 K.B. _____ L.S. + 69.00' N.G.V.D. T.O.C. + 1.0'
 FLUID QUALITY
 Date _____ Time _____ Source of Sample _____
 Cl _____ mg/l Type of Fluid _____
 Temp. _____ °C Field Density _____ @ _____ °C
 T.D.S. _____ mg/l Spec. Cond. _____ μ mhos/cm
 Logged By: E.P. DAUENHAUER Witnessed By: S. HERR
 Comments: _____

TYPE OF SURVEYS RUN
 Lateral 6'
 Caliper
 Flow meter
 16", 64" normals
 Neutron
 Natural Gamma
 Fluid Resistivity
 Density
 ocl
 Fluid Sampler
 Temperature
 Delta Temp.
 SP
 Single pt.

FT. DRUM SW (57)

